



- NOTES:**
1. SEE MCC #1A, #1B SINGLE LINE DIAGRAM AND DP-A11 & DP-A12 POWER DISTRIBUTION FOR 600V POWER REQUIREMENT.
  2. ALL 120 AND 208V LOADS ARE FED FROM LP-A11.
  3. PROVIDE STAIRWELL SMOKE DETECTORS AT EVERY THIRD FLOOR AND AT TOP.

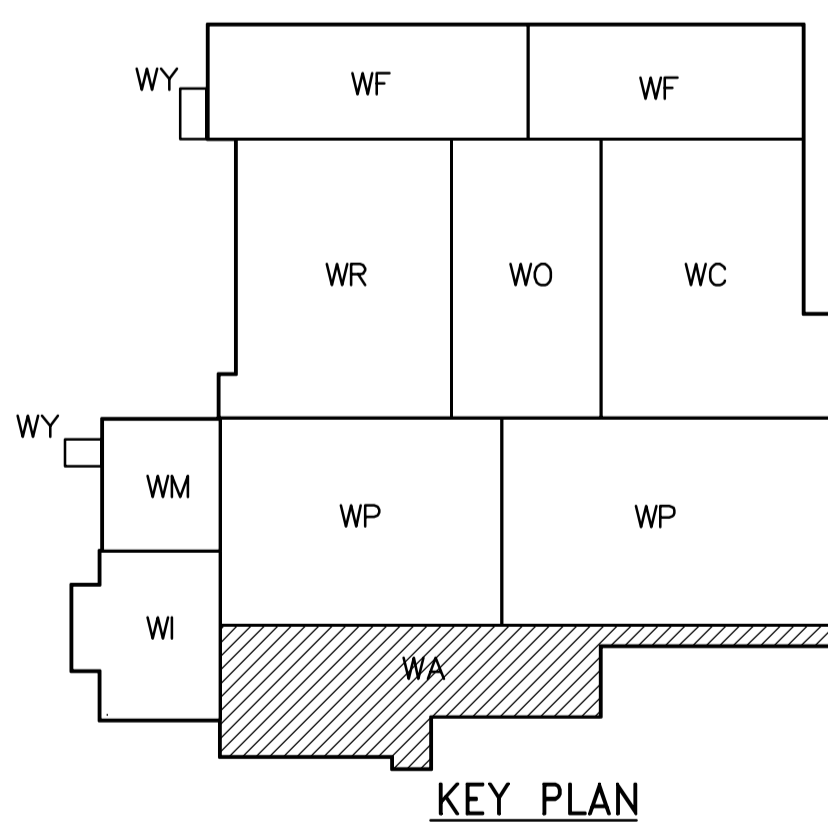

**LOWER LEVEL FACILITY PLAN**  
1:100

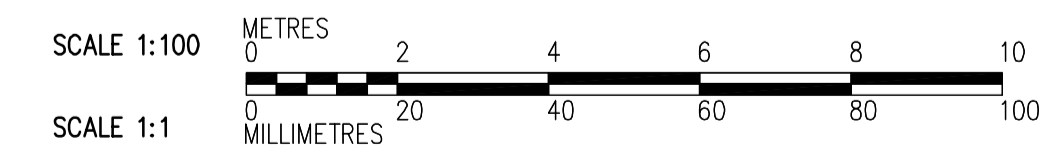

CABLE TRAY TAGGING  
SEE DETAIL  
3  
WB-E0455

**APEG**  
Certificate of Authorization  
CH2M HILL Canada Ltd.  
No. 1441 Expiry: April 30, 2007

B.M. ELEV.					
DESIGNED BY	JT	CHECKED BY	ND		
DRAWN BY	KJ	APPROVED BY	AHL		
SCALE:	1:100	RELEASED FOR CONSTRUCTION BY:	R. SOROKOWSKI		
NO. REVISIONS	DATE	BY	DATE	2005/08/18	2006/03/29

ENGINEER'S SEAL  
ORIGINAL SIGNED BY  
L.D. LLEWELLYN  
2006/03/29  
CONSULTANT DRAWING NO.  
WA-E0101

**THE CITY OF WINNIPEG**  
WATER AND WASTE DEPARTMENT  
ENGINEERING DIVISION

WATER TREATMENT PLANT  
ADMINISTRATION  
MECHANICAL AND ELECTRICAL

ELECTRICAL  
ADMINISTRATION AREA  
LOWER LEVEL FACILITY PLAN

CITY FILE NUMBER  
SHEET OF  
CITY DRAWING NUMBER  
1-0601A-A-E0101-001-01D