
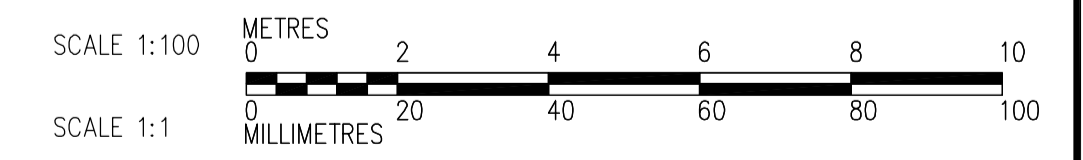


- NOTES:**
1. PROVIDE STAIRWELL SMOKE DETECTORS AS SHOWN ON FIRE PROTECTION DRAWINGS.
  2. SEE MCC 4A & 4B AND PANEL SCHEDULE DP-H31 & DP-H32 FOR 600V DISTRIBUTION.
  3. SEE DRAWING WB-E0401 FOR CABLE TRAY MOUNTING DETAILS.

FOR CABLE TRAY TAGGING SEE DETAIL 3 WB-E0455

THIRD FLOOR FACILITY PLAN  
1:100

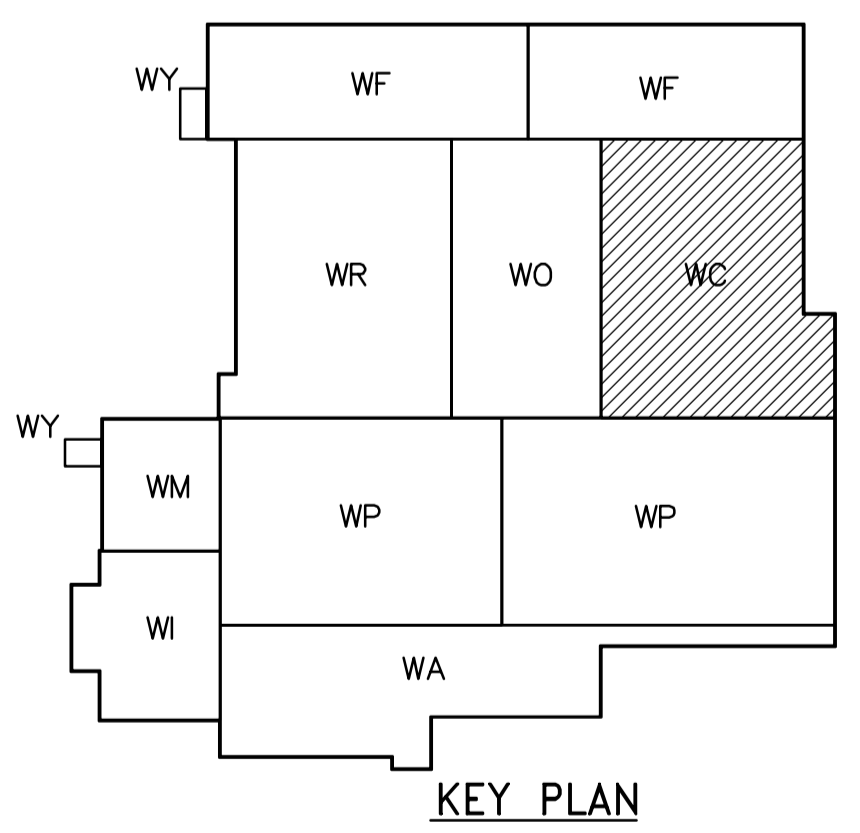

NO.	REVISIONS	DATE	BY
02	742-2005 ADDENDUM 4	06/05/12	LL
01	742-2005 ADDENDUM 3	06/05/05	LL
00	ISSUED FOR TENDER	06/03/29	LL

<b>CH2MHILL</b> Frederickson Cooper ARCHITECTS		<b>EarthTech</b> A Tyco International Ltd. Company	
DESIGNED BY	LL	CHECKED BY	ND
DRAWN BY	TL	APPROVED BY	AHL
SCALE:	1:100	RELEASED FOR CONSTRUCTION BY:	R. SOROKOWSKI
DATE	2005/07/08	DATE	2006/03/29

ENGINEER'S SEAL  
ORIGINAL SIGNED BY  
L.D. LLEWELLYN  
2006/03/29  
CONSULTANT DRAWING NO.  
WC-E0131

**THE CITY OF WINNIPEG**  
WATER AND WASTE DEPARTMENT  
ENGINEERING DIVISION

WATER TREATMENT PLANT  
CHEMICAL FEED SYSTEMS  
MECHANICAL AND ELECTRICAL

ELECTRICAL  
CHEMICAL AREA  
THIRD FLOOR FACILITY PLAN

CITY FILE NUMBER  
SHEET OF  
CITY DRAWING NUMBER  
1-0601C-A-E0131-001-020