


SUB-BASEMENT CEILING LEVEL

SUB-BASEMENT CEILING LEVEL

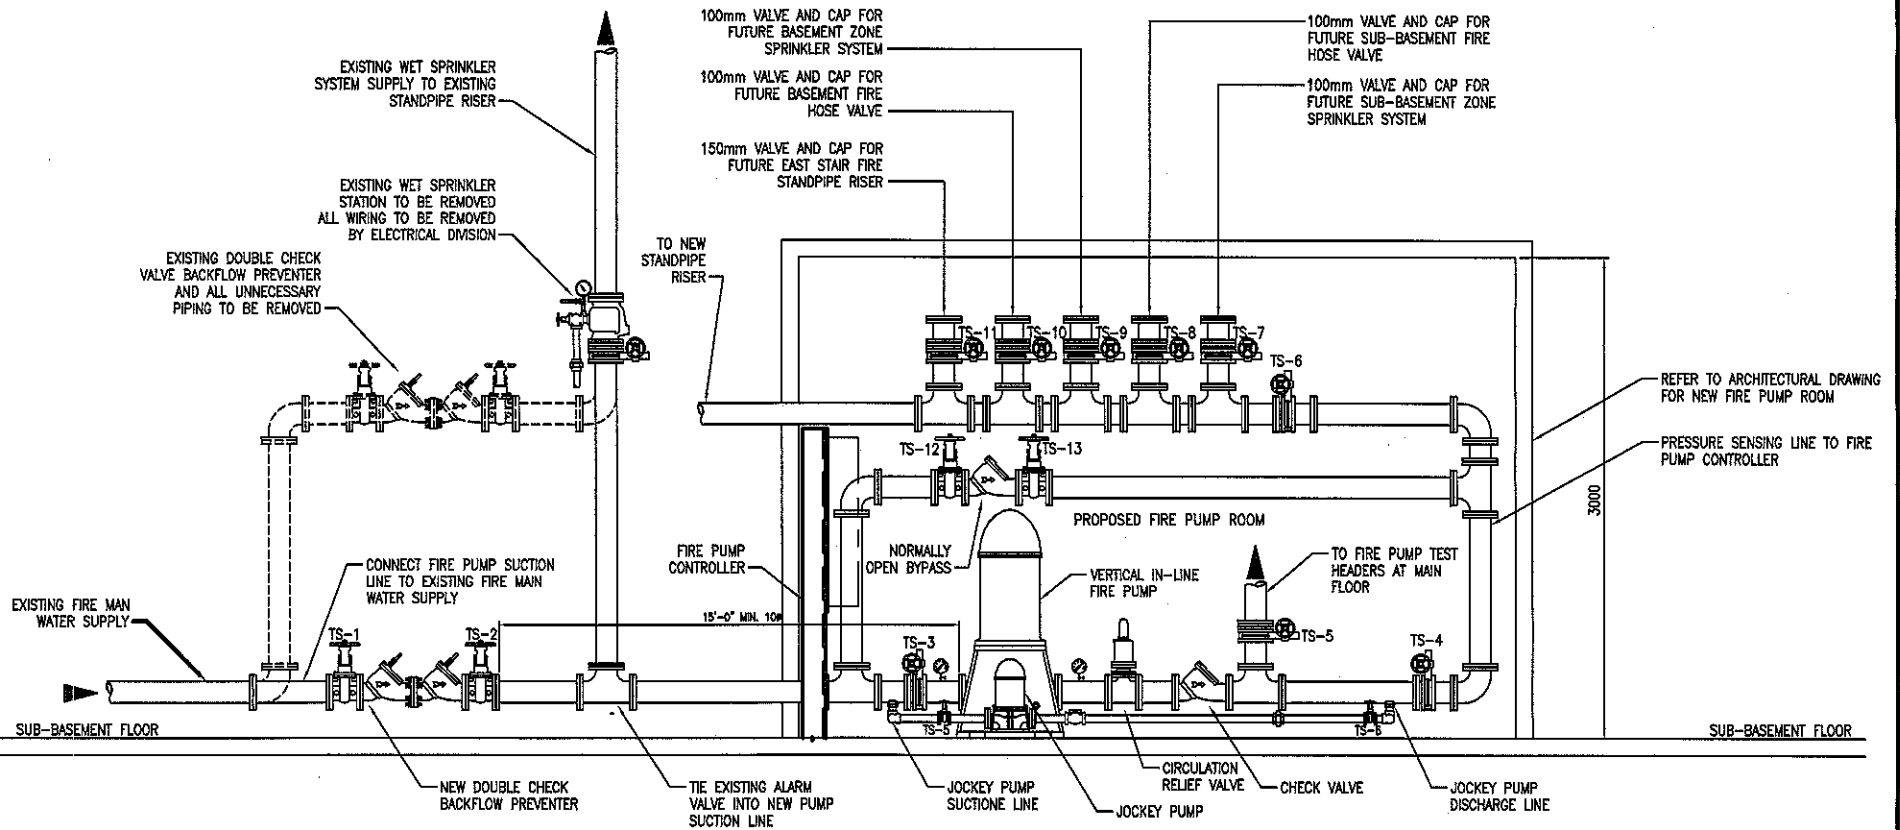

3 FIRE PUMP ROOM SECTION
 FP-3 SCALE: 1:30

SMS ENGINEERING

SMS Engineering Ltd. Consulting Engineers
 770 Bradford Street Winnipeg MB Canada R3H 0N3
 Telephone 204.775.0291 Fax 204.772.2153
 sms@smsg.com

Project Title

CITY OF WINNIPEG
 HALON SYSTEM REPLACEMENT
 510 MAIN STREET

510 MAIN STREET

MANITOBA

FIRE PUMP REVISIONS

Drawn By TL	Approved By JS	Reference FP-3
File No. 07-176-02	Date MAR/2009	Detail Sheet SK-2