
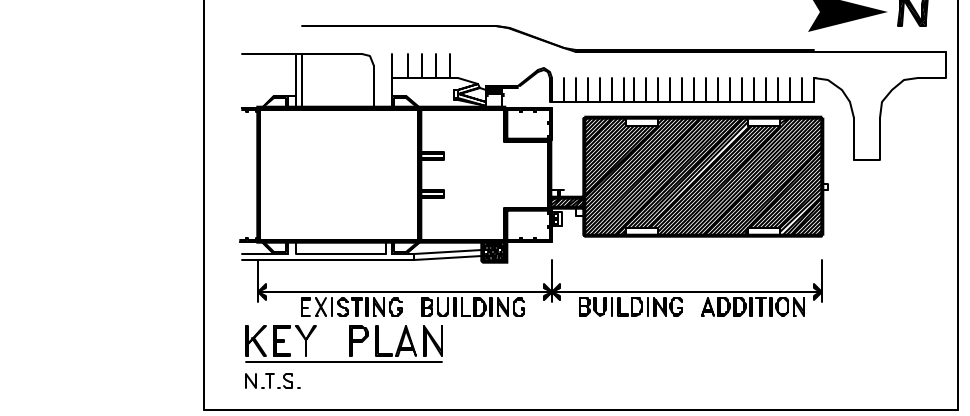


1 ADDITION GROUND FLOOR PLAN
SCALE 1:100

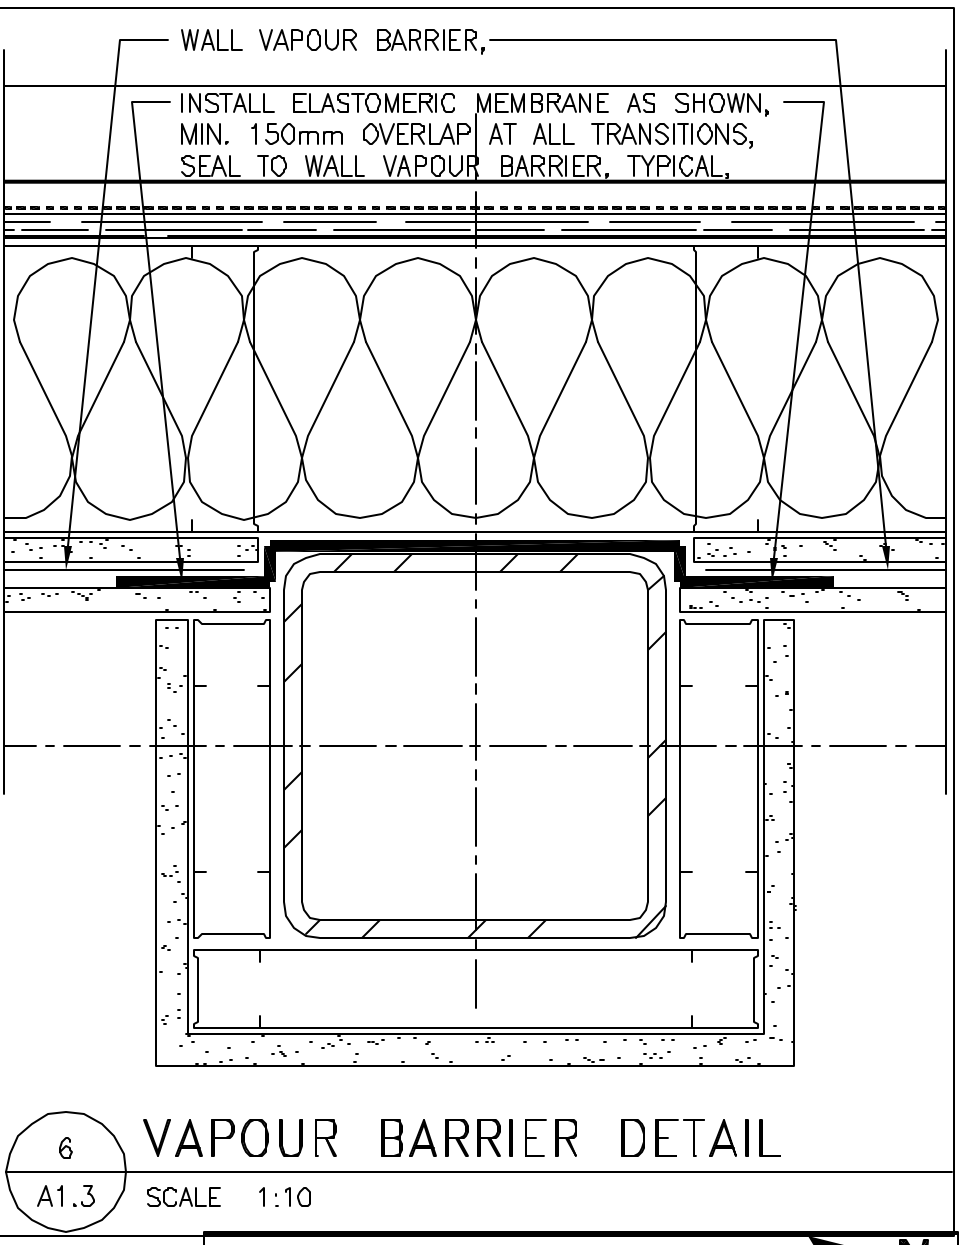

THIS DRAWING MUST NOT BE SEALED.
THE GENERAL CONTRACTOR SHALL VERIFY ALL DIMENSIONS, DATUMS, AND LEVELS PRIOR TO COMMENCEMENT OF WORK. ALL ERRORS AND OMISSIONS TO BE REPORTED TO NUMBER TEN ARCHITECTURAL GROUP BEFORE PROCEEDING.
VARIATIONS AND MODIFICATIONS TO WORK SHOWN ON THESE DRAWINGS SHALL NOT BE CARRIED OUT WITHOUT WRITTEN PERMISSION OF NUMBER TEN ARCHITECTURAL GROUP.
THIS DRAWING IS THE EXCLUSIVE PROPERTY OF NUMBER TEN ARCHITECTURAL GROUP AND THE COPYRIGHT IN THE SAME BEING RESERVED TO THEM. IT MAY BE REPRODUCED ONLY WITH THE PERMISSION OF NUMBER TEN ARCHITECTURAL GROUP, IN WHICH CASE THE REPRODUCTION MUST BEAR THEIR NAME.

ISSUED FOR TENDER	7 MAY 2003
95% REVIEW DRAWING	4 APR 2003
REVISIONS	DATE

Number TEN Architectural Group
 310-115 Barnaby Ave. Phone (204) 942-0881
 Winnipeg, Manitoba Fax (204) 947-9828
 Canada R3B 0R3 E-mail: 10@numberten.com

ST. JAMES-ASSINIBOIA CENTENNIAL POOL
 FITNESS FACILITY ADDITION

644 PARKDALE ST. WINNEPEG, MB

GROUND FLOOR PLAN
 BUILDING ADDITION

SHEET TITLE	
CONSULTING ENGINEER	
ARCHITECTURAL SEAL	SCALE AS NOTED
DRAWN BY BR, CS	DATE MAY 2003
CHECKED BY DH	TENDER NO. 10/2003
TENDER NO. 10/2003	PROJECT NO. 02049

LEGEND

- SEE A1.2 FOR CONSTRUCTION NOTES
- WALL TYPE SEE A1.3 FOR WALL SCHEDULE
- EXISTING WALLS
- NEW FRAMED WALL CONSTRUCTION
- NEW CONCRETE WALL CONSTRUCTION
- NEW DOOR
- EXISTING DOOR

WALL TYPES:

- EXTEND G.W.B. TO UNDERSIDE OF FLOOR DECK ABOVE.
- INSTALL SELF-ADHERING VAPOUR BARRIER STRIPS AT ALL TRANSITIONS.
- GASKET TOP AND BOTTOM PLATES OF ALL RATED PARTITIONS.

W1 PRE FINISHED METAL CLADDING, HORIZONTAL MOISTURE BARRIER, BUILDING WRAP 13mm OSB SHEATHING, 35x152 STEEL STUDS @ 600 O.C. 150mm FIBERGLASS BATT INSULATION, R-22 13mm EXTERIOR G.W.B., TAPED 6m2 POLY VAPOUR BARRIER 13mm G.W.B., SEE FINISH SCHEDULES * INDICATES FWP IN LU OF 13mm GWB (INTERIOR SIDE)

W2 PRE FINISHED METAL CLADDING, HORIZONTAL MOISTURE BARRIER, BUILDING WRAP 13mm OSB SHEATHING, 35x152 STEEL STUDS @ 600 O.C. 150mm FIBERGLASS BATT INSULATION, R-22 13mm EXTERIOR G.W.B., TAPED 6m2 POLY VAPOUR BARRIER 35x41 STEEL STUDS @ 400mm O.C. 13mm G.W.B., SEE FINISH SCHEDULES

W3 PRE FINISHED METAL CLADDING, HORIZONTAL MOISTURE BARRIER, BUILDING WRAP 13mm OSB SHEATHING, 35x152 STEEL STUDS @ 600 O.C. 150mm FIBERGLASS BATT INSULATION, R-22 13mm EXTERIOR G.W.B., TAPED 6m2 POLY VAPOUR BARRIER, 13mm EXTERIOR G.W.B., TAPED PRE FINISHED METAL CLADDING, HORIZONTAL

W4 PUBLIC SIDE: 13mm FWP PANELING, FULL HEIGHT 16mm G.W.B. 35x42 STEEL STUDS @ 400mm O.C. 78 SOUND ATTENUATION BLANKET, CREAMED 16mm G.W.B. * INDICATES TO DELETE SOUND ATTENUATION BLANKET

W5 16mm G.W.B. 35x42 STEEL STUDS @ 400mm O.C. 78 SOUND ATTENUATION BLANKET, CREAMED 16mm G.W.B.

W6 16mm G.W.B. 35x42 STEEL STUDS @ 400mm O.C. 16mm G.W.B.


W7 PUBLIC SIDE: 16mm U.L. RATED G.W.B. 16mm U.L. RATED G.W.B. 35x42 STEEL STUDS @ 400mm O.C. 16mm U.L. RATED G.W.B.

W8 190mm CONCRETE BLOCK


W9 140mm CONCRETE BLOCK

W10 16mm G.W.B. AFFIXED TO EXISTING WALL


W11 PRE FINISHED METAL CLADDING, HORIZONTAL AFFIXED TO EXISTING WALL

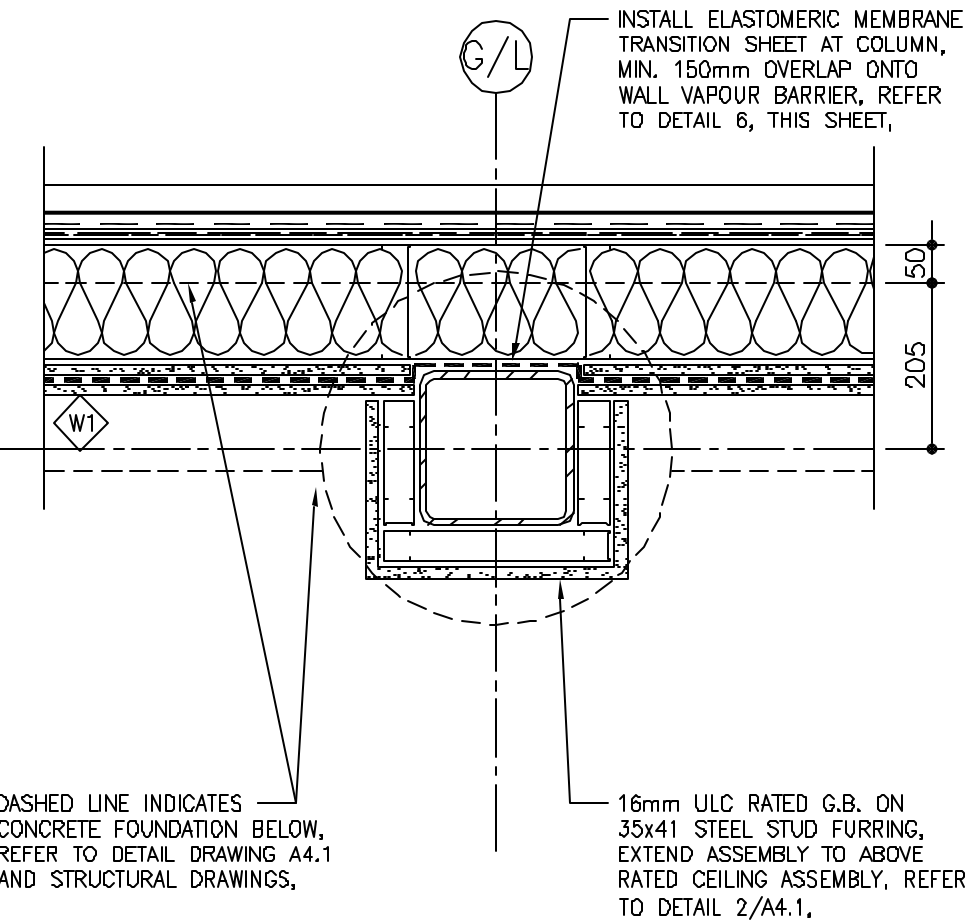


2 COLUMN AT EXTERIOR WALL DETAIL
SCALE 1:10

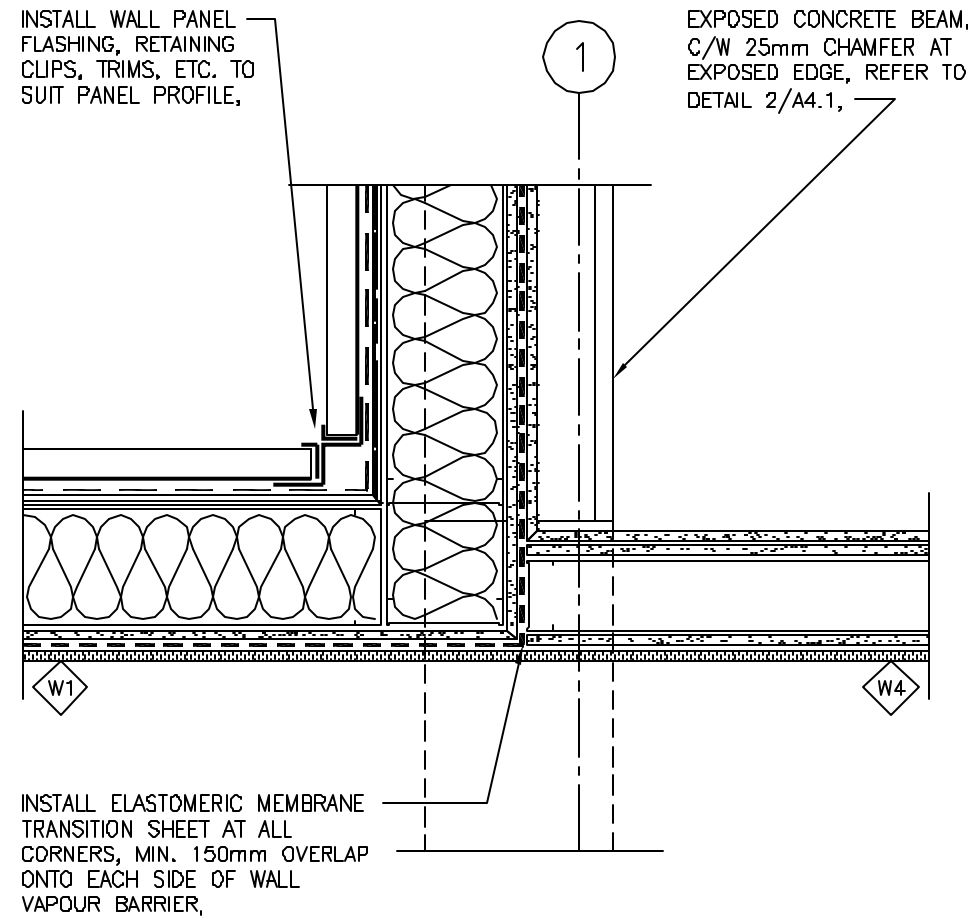

3 EXTERIOR WALLS AT RAMP DETAIL
SCALE 1:10

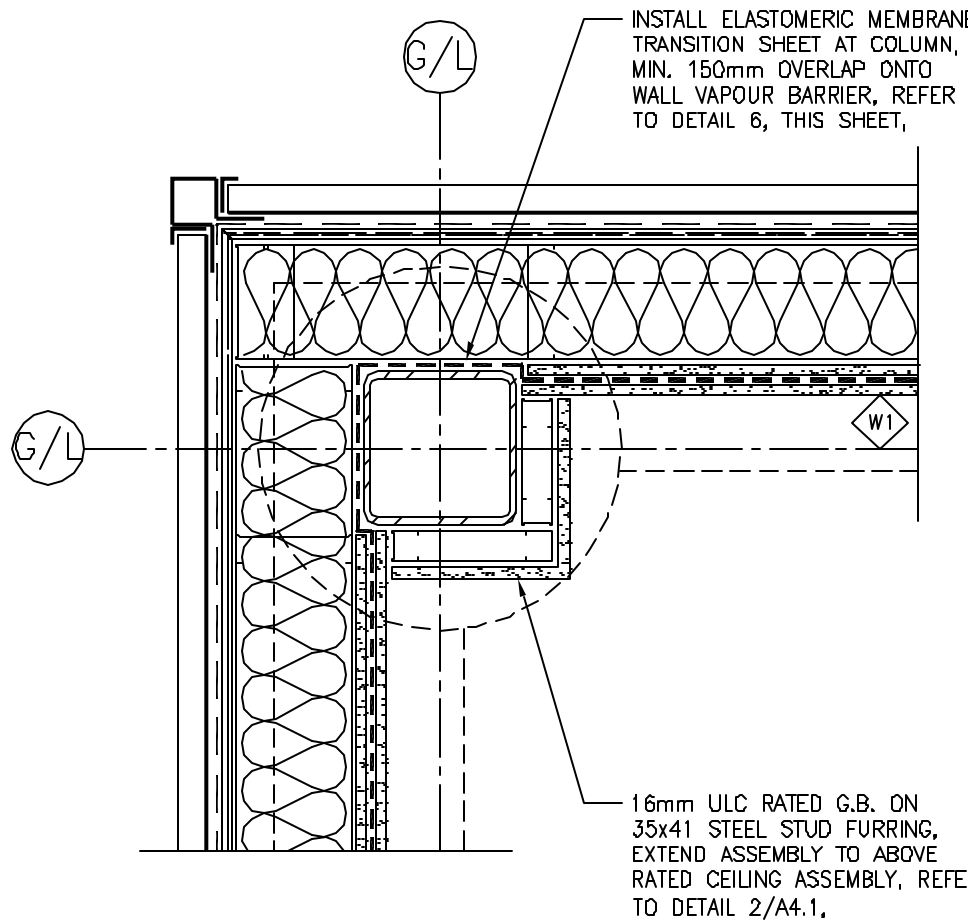

4 TYPICAL EXTERIOR CORNER DETAIL
SCALE 1:10

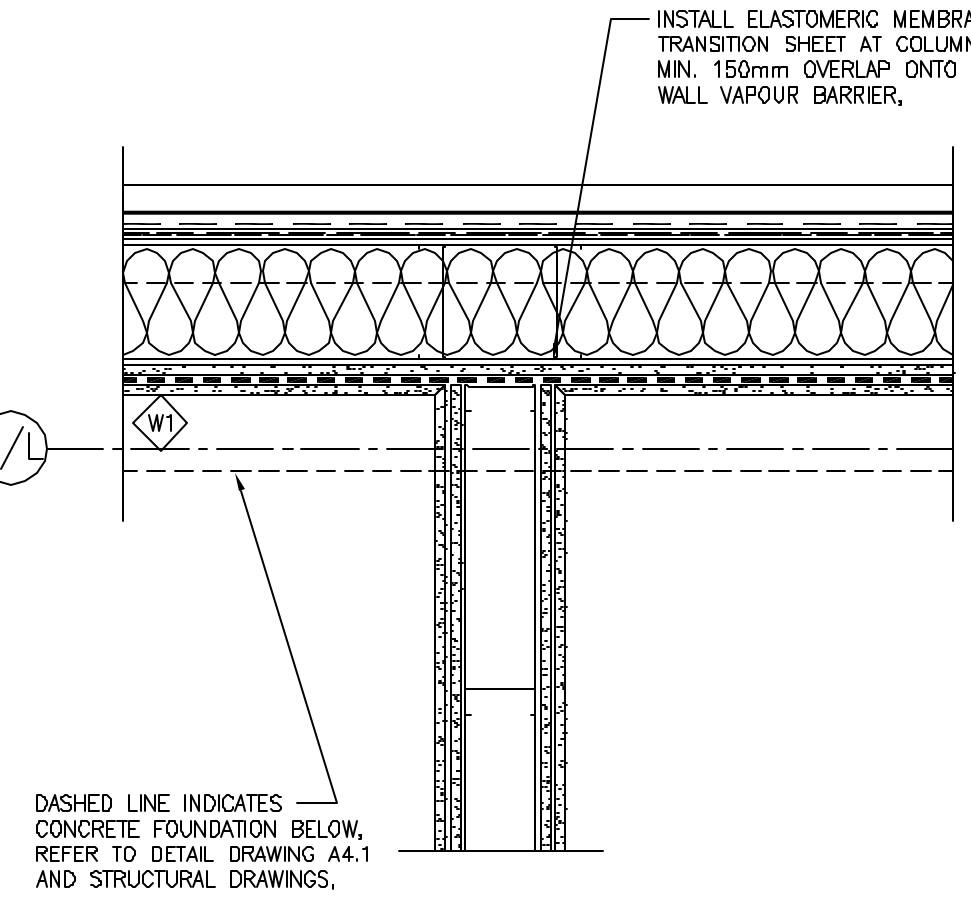

5 INTERIOR AT EXTERIOR WALL DETAIL
SCALE 1:10