




- NOTES:
- 1 PUMP REFRIGERANT FROM CHILLERS AND DISPOSE ACCORDING TO LOCAL REGULATIONS. DISASSEMBLE EXISTING CHILLERS. REMOVE CH-2. MOVE CH-1 TO NEW LOCATION IN SUB-BASEMENT AS SPECIFIED BY CITY OF WINNIPEG
 - 2 TURN OVER ALL VALVES FROM PIPES Ø 200 OR LARGER TO CITY.
 - 3 EXISTING Ø 50 REFRIGERANT RELIEF PIPING TO BE REMOVED, INCLUDING EXTERIOR PIPING.
 - 4 REMOVE PORTION OF Ø 250 PIPE.
 - 5 EXISTING CHEMICAL TREATMENT SYSTEM TO BE REMOVED.

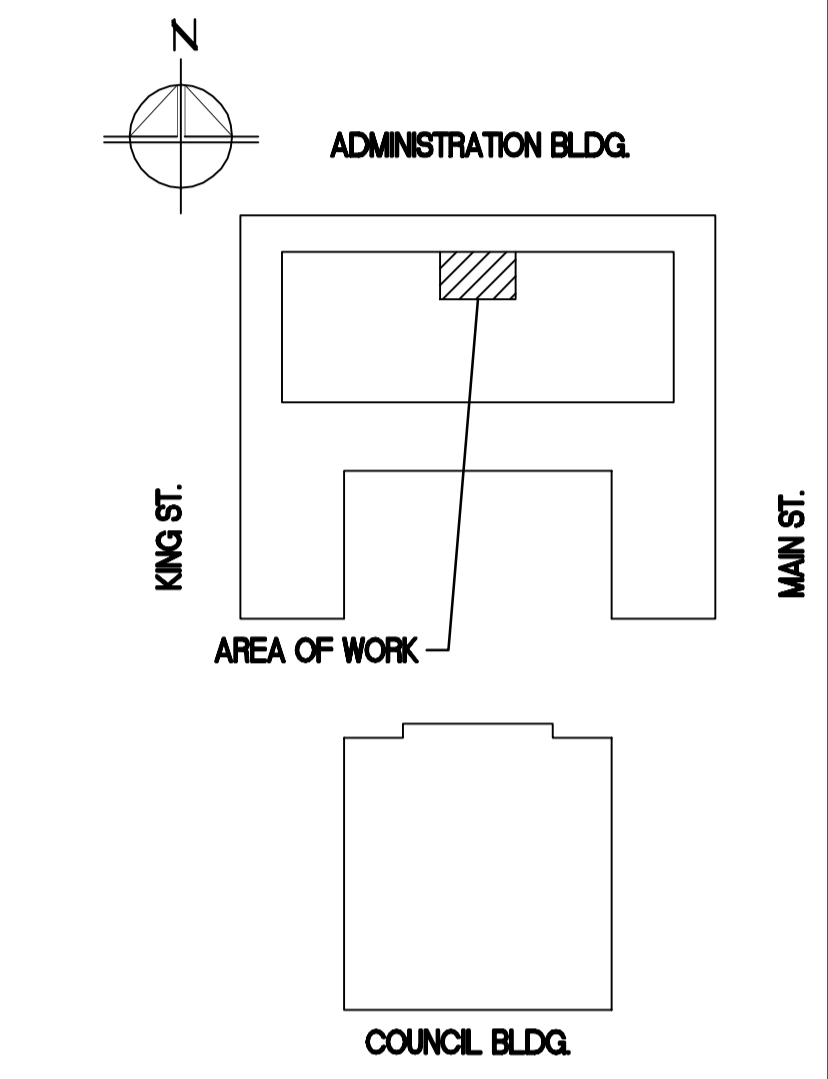

AECOM

This drawing has been prepared for the use of AECOM's client and may not be used, reproduced or relied upon by third parties, except as agreed by AECOM and its client, as required by law or for use by governmental reviewing agencies. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that modifies this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from stated dimensions.

1	ISSUED FOR ADDENDUM 1	DL	2011.11.16
0	ISSUED FOR TENDER	GT	2011.11.03
No.	REVISION/DESCRIPTION	BY	DATE

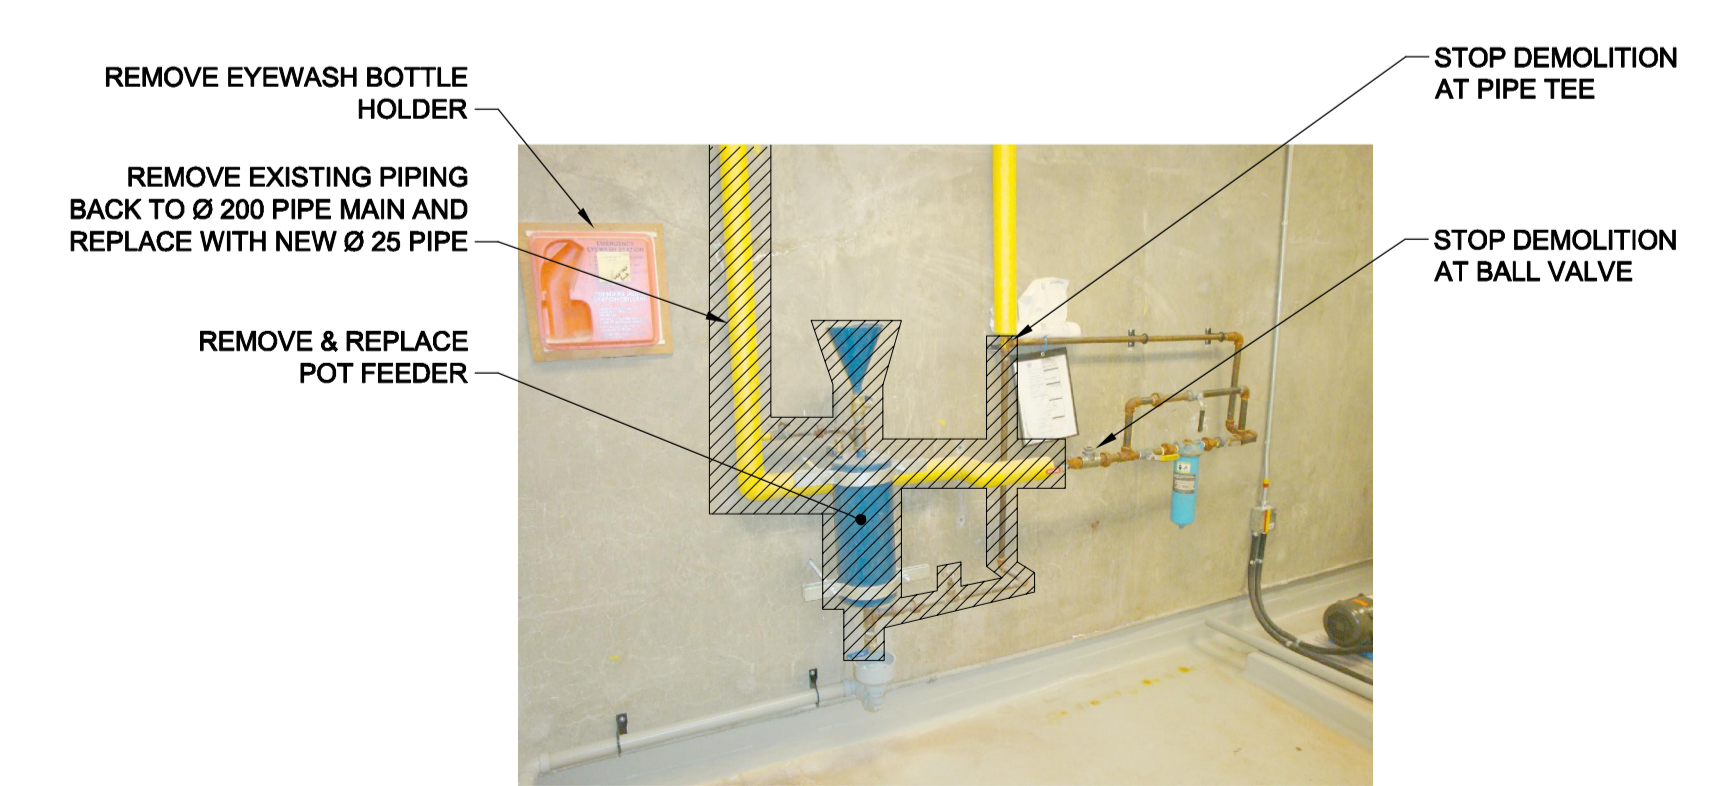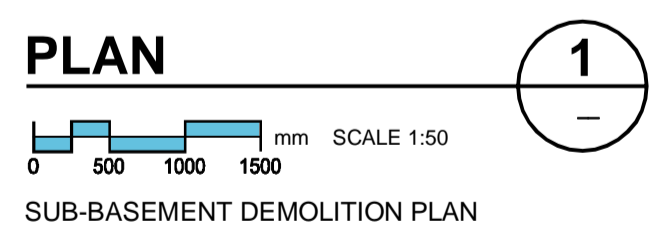

NOTE:
ALL NEW AND EXISTING PIPING ON SIDE STREAM SYSTEM TO BE INSULATED AND PAINTED.

PHOTO
SCALE: NTS
SIDE STREAM FILTER



NOTE:
PHOTO TAKEN OUTDOORS AT STREET LEVEL.

PHOTO
SCALE: NTS
EXTERIOR RELIEF VENT

APEGM
Certificate of Authorization
AECOM Canada Ltd.
No. 4671 Date: _____

DRN	CHK	DES	ENG	IDR
AECOM REVIEW				

DRAWN	GT	CHECKED	DC	DESIGNED	DC	APPROVED	PVL
DATE	2011.09.02	USER	APPROVAL				

THE CITY OF WINNIPEG
PLANNING, PROPERTY AND
DEVELOPMENT DEPARTMENT
MUNICIPAL ACCOMMODATIONS DIVISION
3-65 GARRY STREET, R3C 4K4

PROJECT
ADMINISTRATION & COUNCIL BUILDING
REPLACEMENT OF COOLING PLANT - 510 MAIN STREET
BID OPPORTUNITY NO. 673-2011
510 MAIN STREET, WINNIPEG, MANITOBA

SHEET TITLE
**MECHANICAL
SUB-BASEMENT MECHANICAL ROOM
DEMOLITION PLAN**

SCALE	PROJECT No:	SHEET No:
NTS	60220937	M-002