


NEWTON AVE
RIVER CROSSING

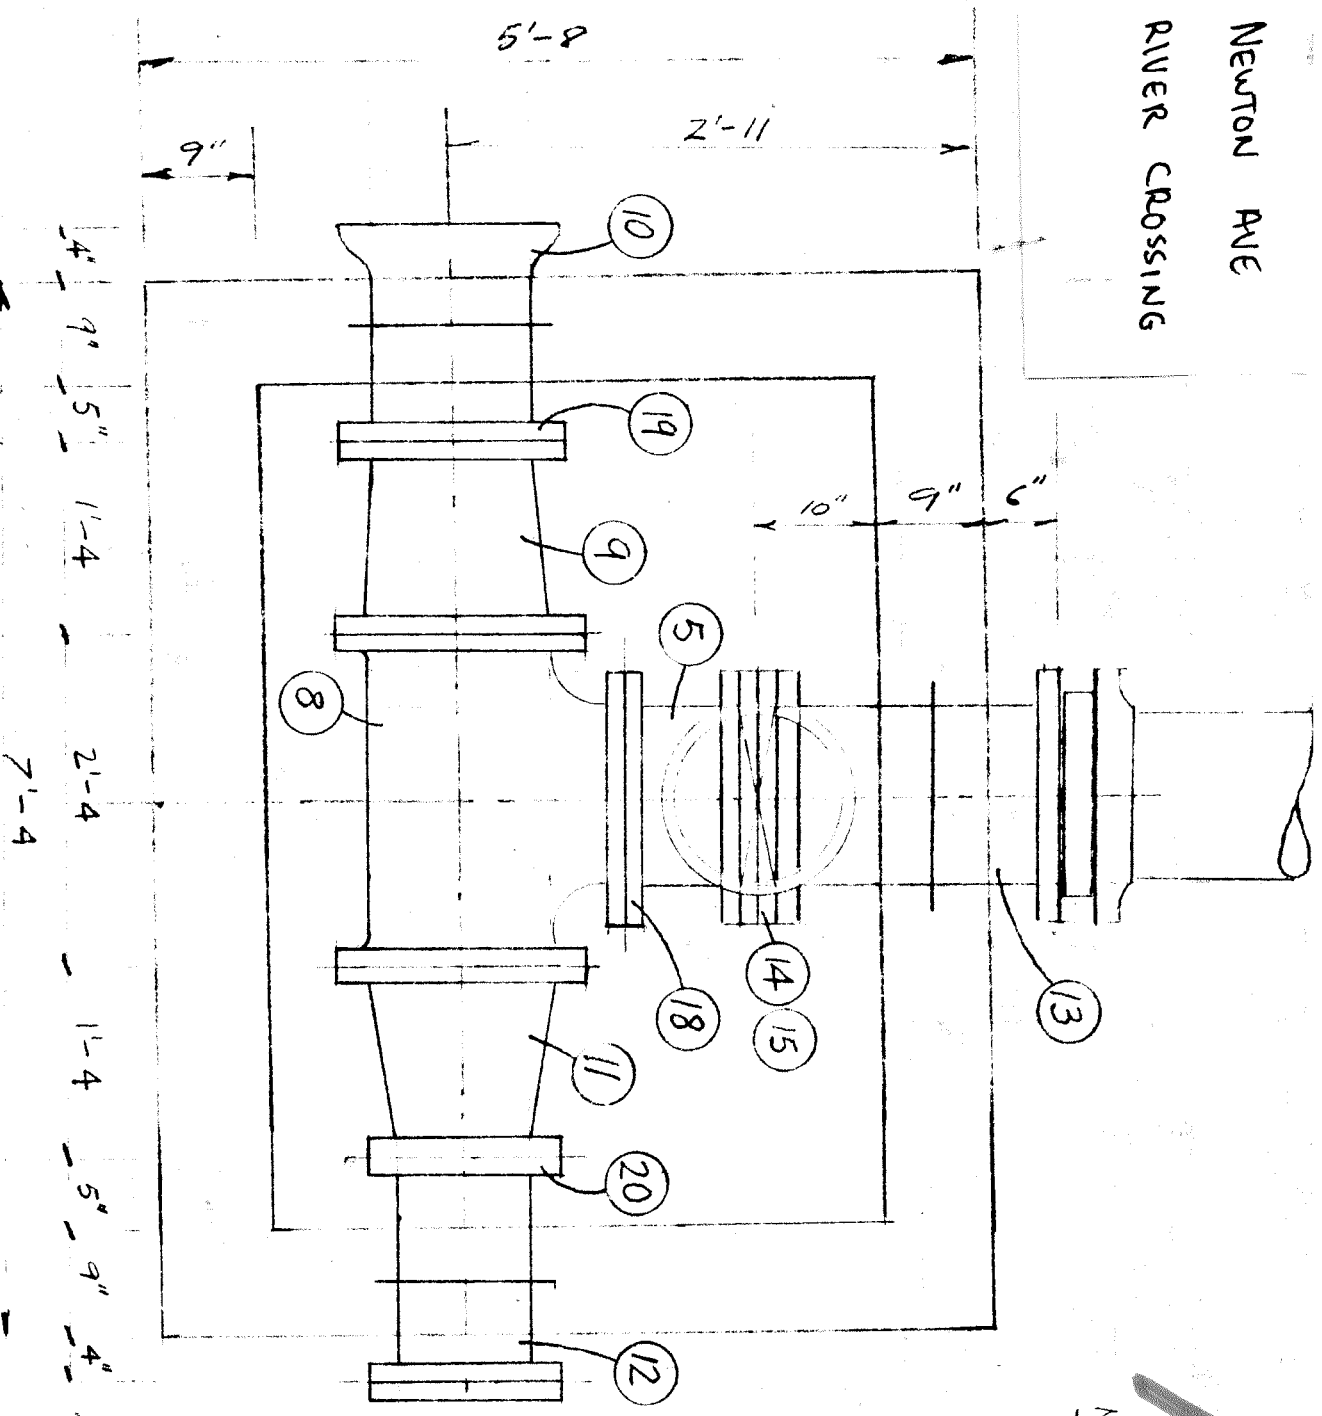

PROPOSED CHAMBER

MICROFILMED

1647

NOTE
SEE BILL OF MATERIALS
FOR MARK UPS ETC.

PD. 77-169
S-257

THE CITY OF WINNIPEG
WATERWORKS, WASTE & DISPOSAL DIVISION
APPROVED FOR CONSTRUCTION
Dan Wucher DATE *Nov. 9/77*
Approval of this drawing covers only the general design and arrangement of material or equipment and does not in any way relieve the Contractor of any liability or responsibility for the satisfactory operation of this installation.

BENBEE ENGINEERING & MARINE LTD.

PROPOSED DETAILS

20-112 25 NOV 27 77 CV-7

BENBEE
Diving & Marine Ltd.

BILL OF MATERIAL

PROPOSED CHAMBER

Mark	Quantity	Size	Description
5	1	14"	Pipe, flange x vic groove, 9½" long
8	1	14x14x14	flanged tee
9	1	14x12	flanged reducer
10	1	12"	thimble, bell x vic groove 1"-6 long
11	1	14x10	flanged reducer
12	1	10"	thimble, flange x vic groove 1"-6 long
13	1	14"	thimble, flange x flange, 1'-11'2 long
14	1	14"	knife gate valve
15	1		valve box
18	1	14"	victaulic adapter flange style 341
19	1	12"	victaulic adapter flange style 341
20	1	10"	victaulic adapter flange style 341

THE CITY OF WINNIPEG
 WATERWORKS, WASTE & DISPOSAL DIVISION
APPROVED FOR CONSTRUCTION

D. Wucher DATE *Mar 9/77*

Approval of this drawing covers only the general design and arrangement of material or equipment and does not in any way relieve the contractor of any liability or responsibility for the safe and proper operation of this installation.

MICROFILMED APR 10 1978