


1 BASEMENT POWER & SYSTEMS RENOVATION LAYOUT  
EP2.0 SCALE: 1:100

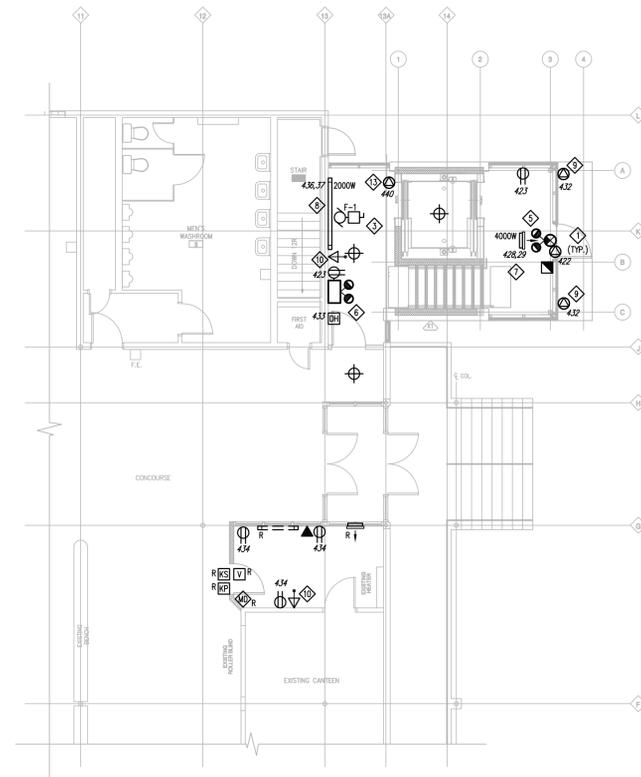

2 MAIN FLOOR POWER & SYSTEMS RENOVATION LAYOUT  
EP2.0 SCALE: 1:100

**NOTES:**

1. WIRE AND CONNECT AUTO DOOR OPENER C/W ASSOCIATED CONTROLS.
2. WIRE AND CONNECT WITH 3 #8 MI TO EXISTING 60A/3P CIRCUIT BREAKER IN PANEL B. PROVIDE SEPARATE PRICE TO REPLACE EXISTING BREAKER SHOULD SAME BE DEFECTIVE. CONFIRM ROUTING/LOCATION(S)/BREAKER REQUIREMENTS ON SITE PRIOR TO BID.
3. WIRE AND CONNECT HIGH LEVEL ALARM & CONTROLLER AND FLOATS AS SUPPLIED BY MECHANICAL. CONFIRM LOCATION(S) WITH MECHANICAL.
4. PROVIDE DEDICATED TELEPHONE LINE TO MAIN BUILDING MTS BACKBOARD. CONFIRM ROUTING/LOCATION(S) ON SITE PRIOR TO BID.
5. PROVIDE SELF CONTAINED EXIT/EMERGENCY LIGHT WIRED AND CONNECTED TO AREA LIGHTING CIRCUIT.
6. PROVIDE SELF CONTAINED EMERGENCY LIGHT WIRED AND CONNECTED TO AREA LIGHTING CIRCUIT.
7. PROVIDE 4KW, 208V, 1Ø FLUSH CEILING MOUNTED FORCE FLOW HEATER C/W B.I.T.
8. PROVIDE 2KW, 208V, 1Ø BASEBOARD HEATER C/W B.I.T.
9. WIRE AND CONNECT BACK LIT ENTRANCE SIGN (INDIVIDUAL LETTERS) AND UNIVERSAL ELEVATOR SYMBOL SIGN. PROVIDE PHOTOCCELL ON/OFF CONTROL.
10. PROVIDE TWO-WAY VOICE COMMUNICATION BETWEEN THREE LOCATIONS.
11. COORDINATE TRANSFORMER LOCATION ON SITE WITH EXISTING CONDITIONS.
12. PROVIDE 2KW, 208V, 1Ø UNIT HEATER C/W B.I.T. MOUNTED AS HIGH AS POSSIBLE.
13. WIRE & CONNECT SMOKE DAMPER SUCH THAT LOSS OF POWER OR GENERAL FIRE ALARM SIGNAL DAMPER SHALL CLOSE. PROVIDE REQUIRED CONTACT IN FACP MODIFIED AS REQUIRED.

|          |                        |            |
|----------|------------------------|------------|
| 1.       | ISSUED FOR ADDENDUM #1 | 2012-11-27 |
| 0.       | ISSUED FOR BID         | 2012-11-09 |
| revision |                        |            |

This drawing must not be scaled.  
The general Contractor must verify all dimensions, datums and levels prior to commencement of work. All errors and omissions must be reported immediately to the Architect.

Variations and modifications to work shown on this drawing shall not be carried out without written permission from the Architect.

This drawing is the exclusive property of the Architect and cannot be reproduced without written permission of the Architect. Reproduction must bear the name of the Architect. Copyright © 2012.

**MCW / AGE**  
Consulting Professional Engineers  
210-1821 Wellington Avenue  
Winnipeg, Manitoba, R3M 0G4  
Phone: (204) 779-7900 Fax: (204) 779-1119  
E-Mail: mcw\_age@mcw.com

8107

**harold funk architect**  
Architecture and Urban Design  
401-25 Donald Street, Winnipeg, Manitoba, R3C 1L8  
T (204) 943-9087 info@funkarchitect.com  
F (204) 943-9231 funkarchitect.com

project  
**ELEVATOR ADDITION AND ACCESSIBILITY UPGRADES OF CENTURY ARENA**  
Winnipeg, Manitoba Bid Opportunity No. 579-2012

sheet title  
**POWER & SYSTEMS RENOVATION**

project number: 12-003 drawing number:  
scale: 1:100 **EP2.0**  
drawn by: MJB / LB  
approved by: KEI  
date: NOV. 27, 2012