



This is a print of a document that has been electronically authenticated with technology authorized by the APEGM. The original is in electronic form.



This drawing must not be scaled. The contractor shall verify all dimensions and other data on site prior to commencement of work. Discrepancies, errors, and omissions are to be reported to Public City Architecture Inc. prior to proceeding with the Work.

Drawings and specifications as instruments of service are the property of Public City Architecture Inc. and when made, must bear their name. All prints to be returned to Public City Architecture Inc. upon request.


Project
ST. JAMES CIVIC CENTRE

Drawing
LEVEL 1 RENOVATION - FIRE PROTECTION PLAN

Drawn By: GC Review By: JS
 Scale: 3/32" = 1'-0" Tender No: 1176-2019
 Date: 11/06/19
 Sheet:

KEY NOTES

- 1 FIRE PROTECTION MAINS UP FROM BELOW WITHIN SHAFT.
- 2 ROUTE FIRE PROTECTION MAINS AT HIGH LEVEL WITHIN CEILING SPACE.
- 3 OFFSET PIPE UP WITHIN AUDITORIUM TO ACCOMMODATE HIGHER ROOF LEVEL.
- 4 PROVIDE UPRIGHT SPRINKLER HEADS TO SERVE THE STORAGE AREA BELOW THE STAGE.
- 5 PROVIDE STORZ FIRE DEPARTMENT CONNECTION.
- 6 FIRE PROTECTION PIPING DOWN FROM HIGH LEVEL.
- 7 PROVIDE SPRINKLER COVERAGE BENEATH STAGE. HEADS SHALL BE UPRIGHT STYLE BENEATH STAGE.
- 8 COORDINATE SPRINKLER HEAD PLACEMENT WITH LIGHTING PLAN. COORDINATE WITH ELECTRICAL AND ARCHITECTURAL. TYPICAL FOR ALL HEADS IN LOBBY AREA.
- 9 CONCEALED HEADS IN GWB BULKHEADS. TYPICAL IN LOBBY AREA. COORDINATE WITH ARCHITECTURAL FOR BULKHEADS AND ELECTRICAL FOR LIGHTING LAYOUT.
- 10 PROVIDE COVERAGE AROUND STRUCTURAL COMPONENTS. TYPICAL.
- 11 CONCEALED HEADS IN ALL ACT CEILINGS. TYPICAL. COORDINATE WITH ARCHITECTURAL RCP PLANS.
- 12 REFER TO SHEET MF2.3 FOR CONTINUATION.

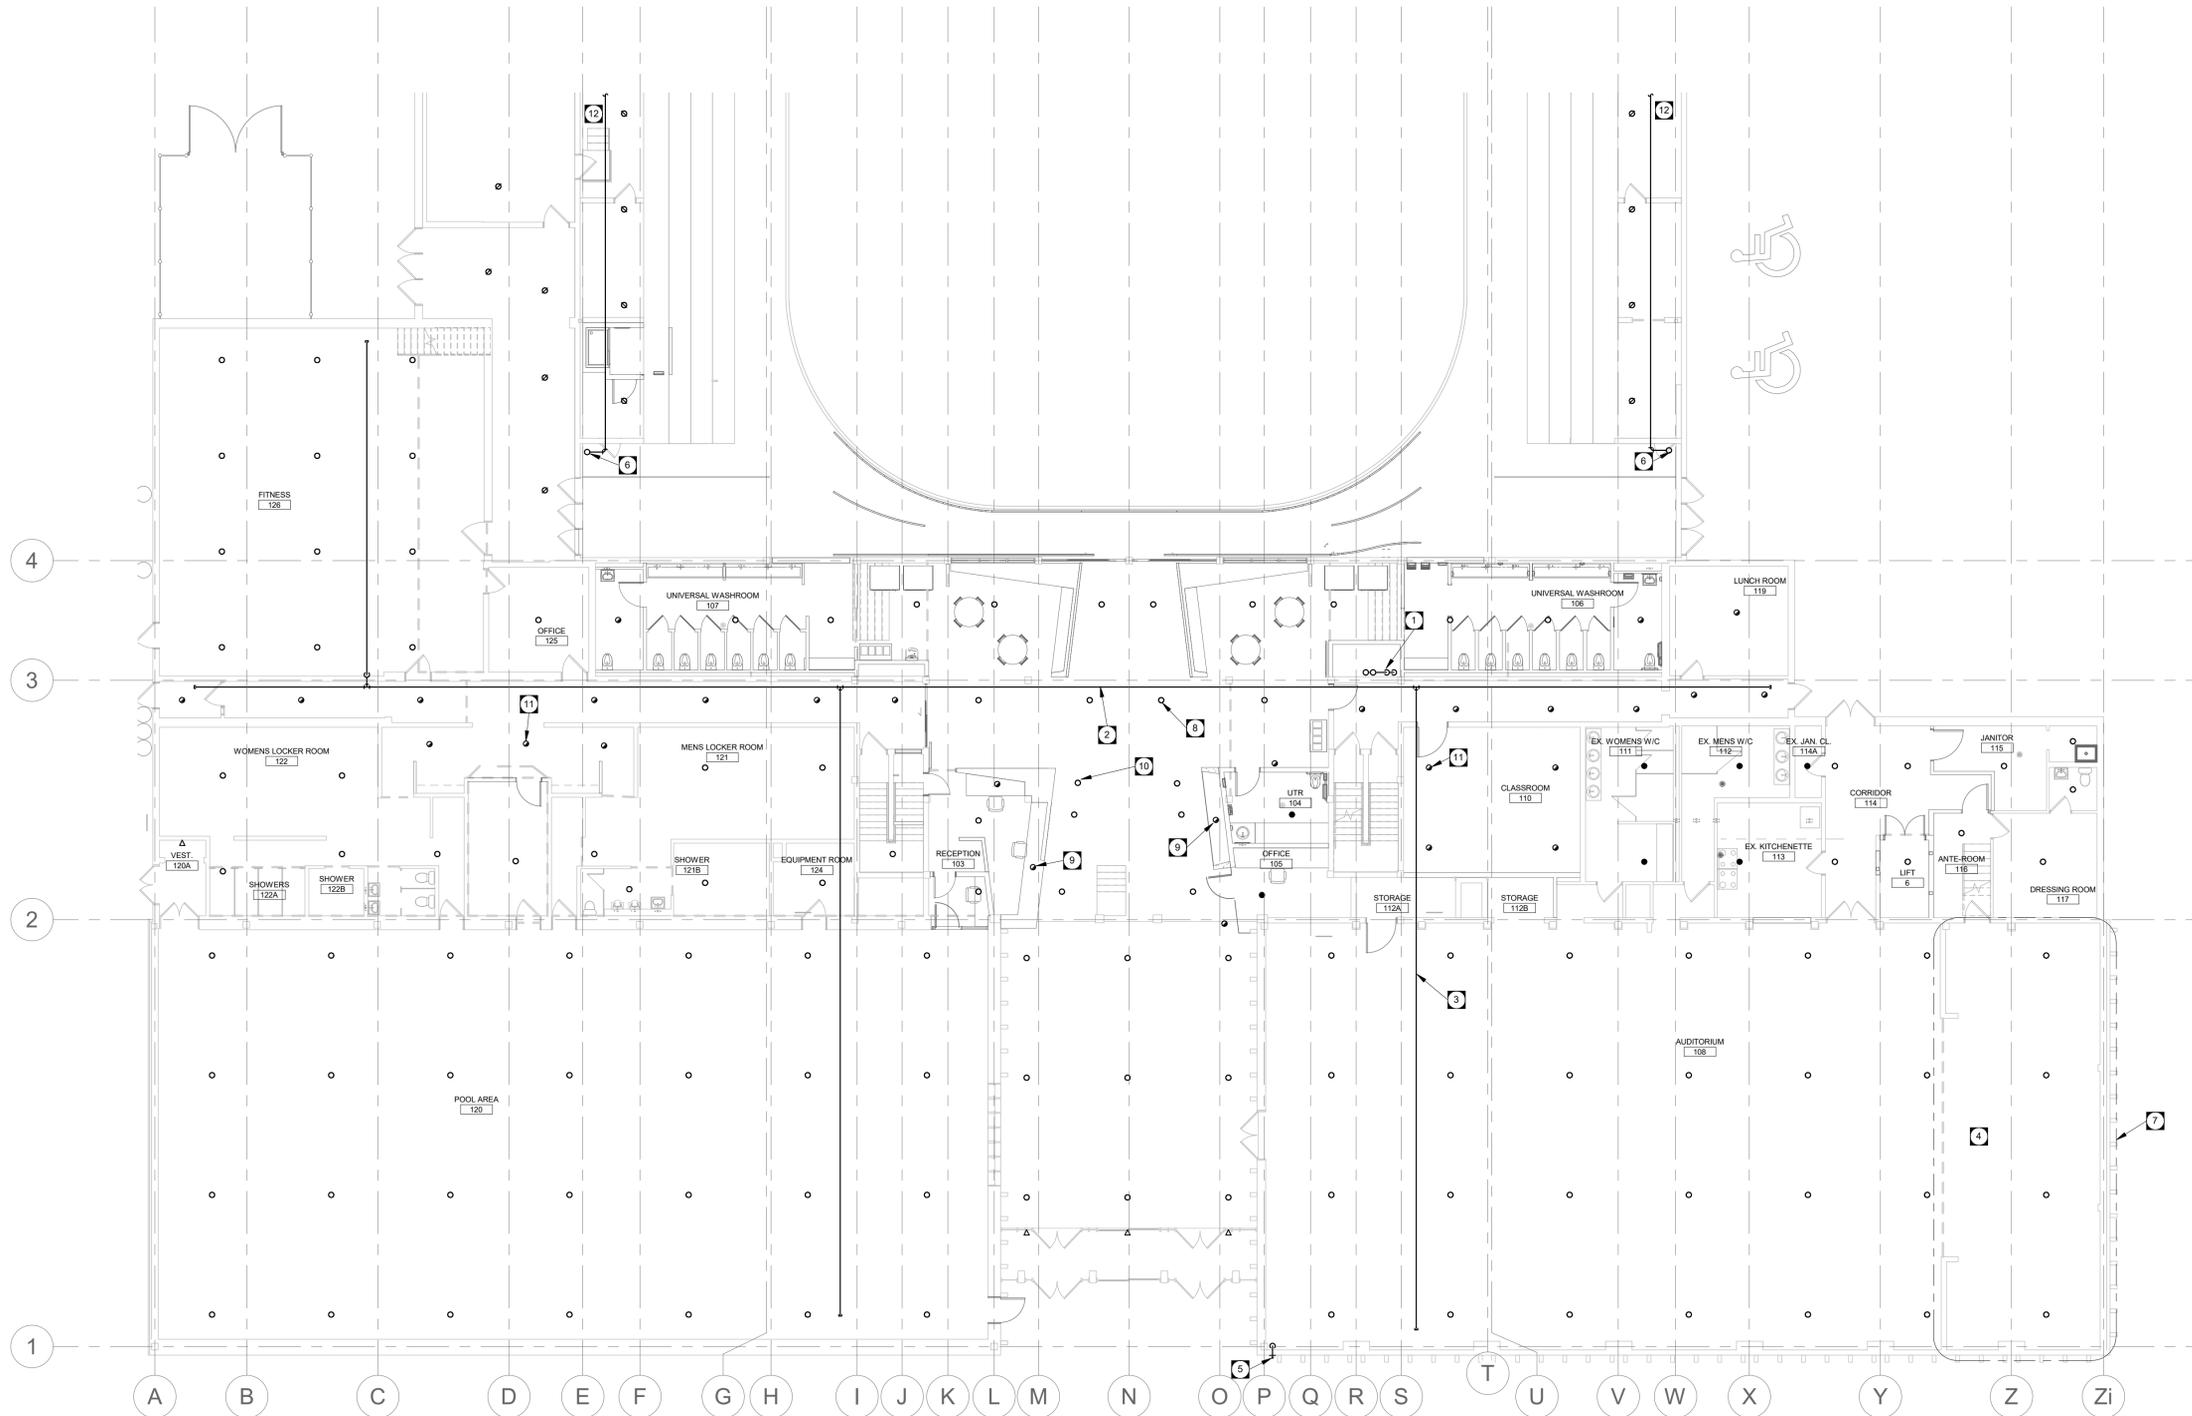

LEVEL 1- FIRE PROTECTION RENOVATION 1
 3/32" = 1'-0" MF2.1