


LAST SAVE: 2022/07/13 - 12:23pm
 PATH: \\192.168.0.226\1-r-data\Projects\2021\21-0107-015\Dwg\Elec\ADDENDUM\1-0101-AILD-F264-001.DWG
 B SIZE - 279mm x 432mm

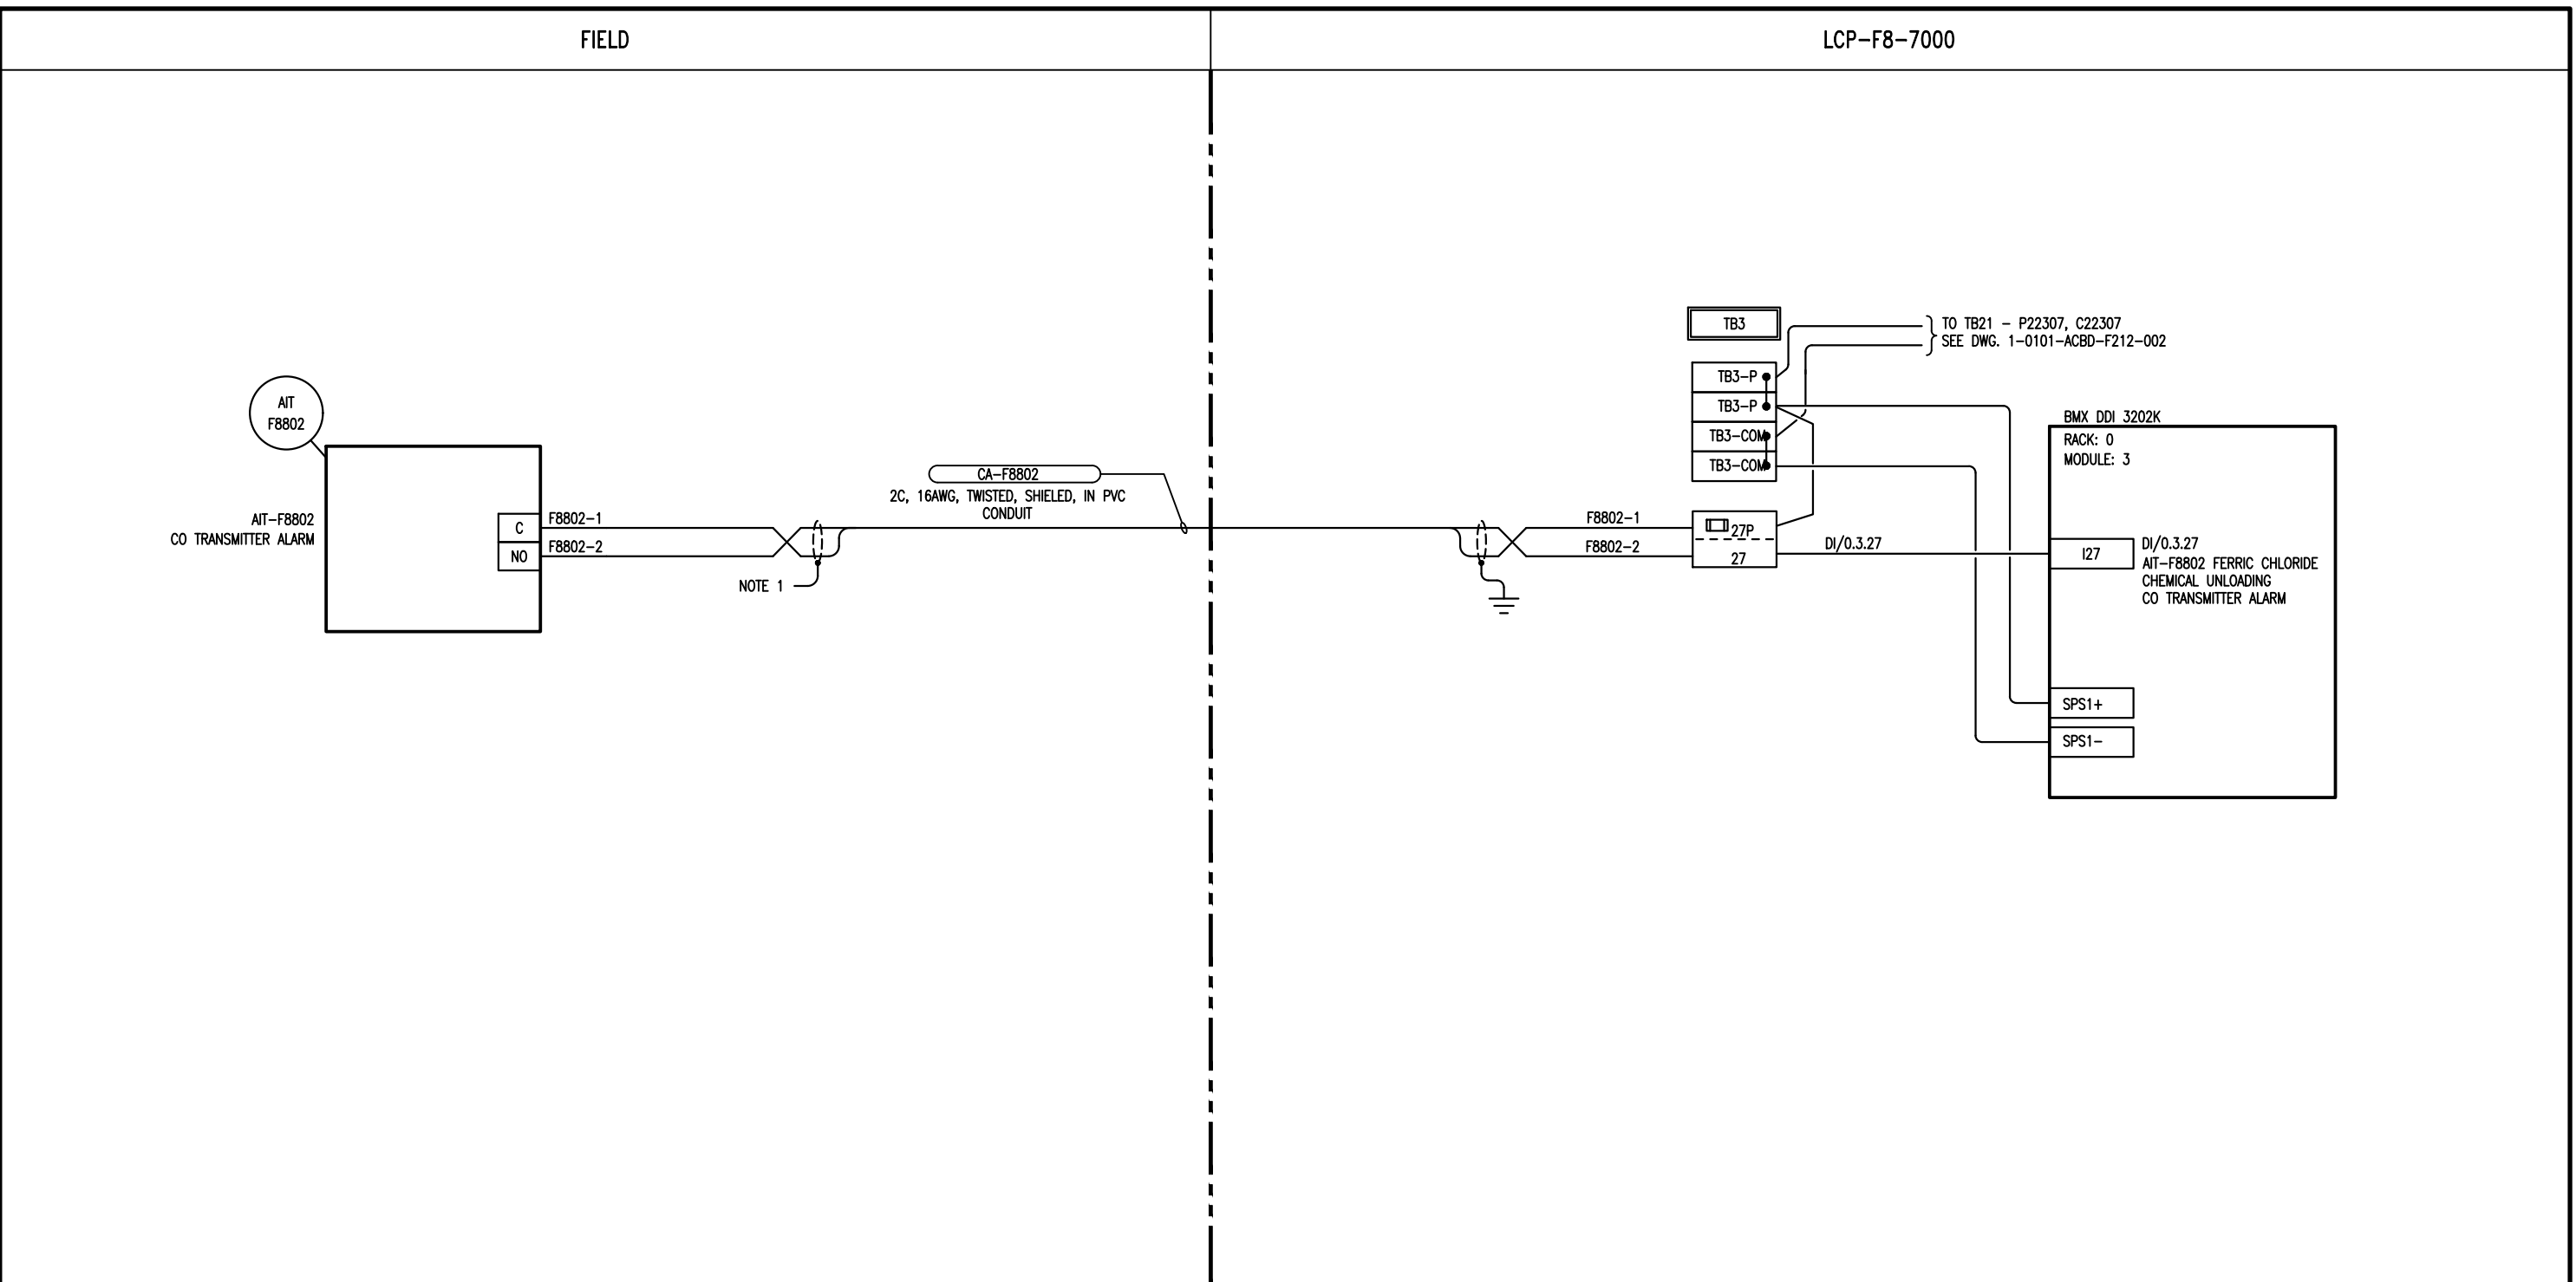

NOTES

1. ISOLATE AND TAPE BACK SHIELD AT THIS END ONLY.

**ENGINEERS
GEOSCIENTISTS
MANITOBA**

Certificate of Authorization

KGS Group

No. 245

NO.	REVISIONS	DATE	DESIGN	CHECK
0	ISSUED FOR CONSTRUCTION	2022 07 05	DRS	<i>JRS</i>

KGS GROUP

DESIGNED BY: DRS	CHECKED BY: <i>JRS</i>
DRAWN BY: RG	APPROVED BY: <i>JRS</i>
SCALE: NTS	DATE:
ISSUED FOR CONSTRUCTION	
BY:	DATE:
CONSULTANT NO.:	
21-0107-015_A6.223	

ENGINEER'S SEAL

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT
ENGINEERING DIVISION

NORTH END SEWAGE TREATMENT PLANT (NEWPC)
INTERIM PHOSPHOROUS REMOVAL
AUTOMATION - LOOP DRAWING
BUILDING 101 - AIT-F8802 ALARM INDICATING TRANSMITTER

CITY DRAWING NUMBER	SHEET	REV.	SIZE
1-0101-AILD-F264-001	001	A	B