
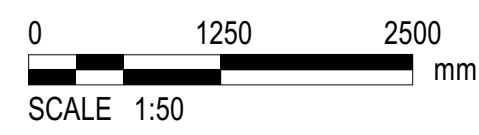


NOTES:

1. REFER TO THE INSTRUMENTATION LOOP DIAGRAMS (ILDs) FOR WIRING REQUIREMENTS.
2. ALL WIRING ASSOCIATED TO FIRE ALARM AND SECURITY SYSTEM SHALL BE RUN IN CONDUIT.
3. PROVIDE EXPANSION COUPLINGS AND FITTINGS FOR CONDUITS CROSSING EXPANSION JOINTS.
4. ALL WIRE CONNECTIONS SHALL BE MADE IN TERMINAL BLOCKS; USE OF MARRETTES IS NOT ACCEPTABLE.

MAIN LEVEL - FIRE ALARM AND SECURITY PLAN
SCALE: 1:50



**ENGINEERS
GEOLOGISTS
MANITOBA**
Certificate of Authorization
AECOM Canada Ltd.
No. 4671 Date: 2023-08-17

DESIGNED BY: KG		CHECKED BY: SDS	
DRAWN BY: TW		APPROVED BY: NW	
SCALE: 1:50		RELEASED FOR CONSTRUCTION BY:	
DATE: 2021-06-07		DATE:	
CONSULTANT NO.: P3-E106			
01 ISSUED FOR ADDENDUM 3	2023-10-27	SS	SB
00 ISSUED FOR TENDER	2023-08-17	JEP	SB
NO. REVISIONS	DATE	DESIGN	CHECK

ENGINEER'S SEAL

TENDER NO. 463-2022

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

NORTH END SEWAGE TREATMENT PLANT
PRIMARY CLARIFICATION PROJECT
ELECTRICAL
SCUM DEWATERING BUILDING - MAIN LEVEL
FIRE PLAN AND SECURITY PLAN

CITY DRAWING NUMBER: 1-0101-EFAS-P002
SHEET: 001
REV: 01
SIZE: A1