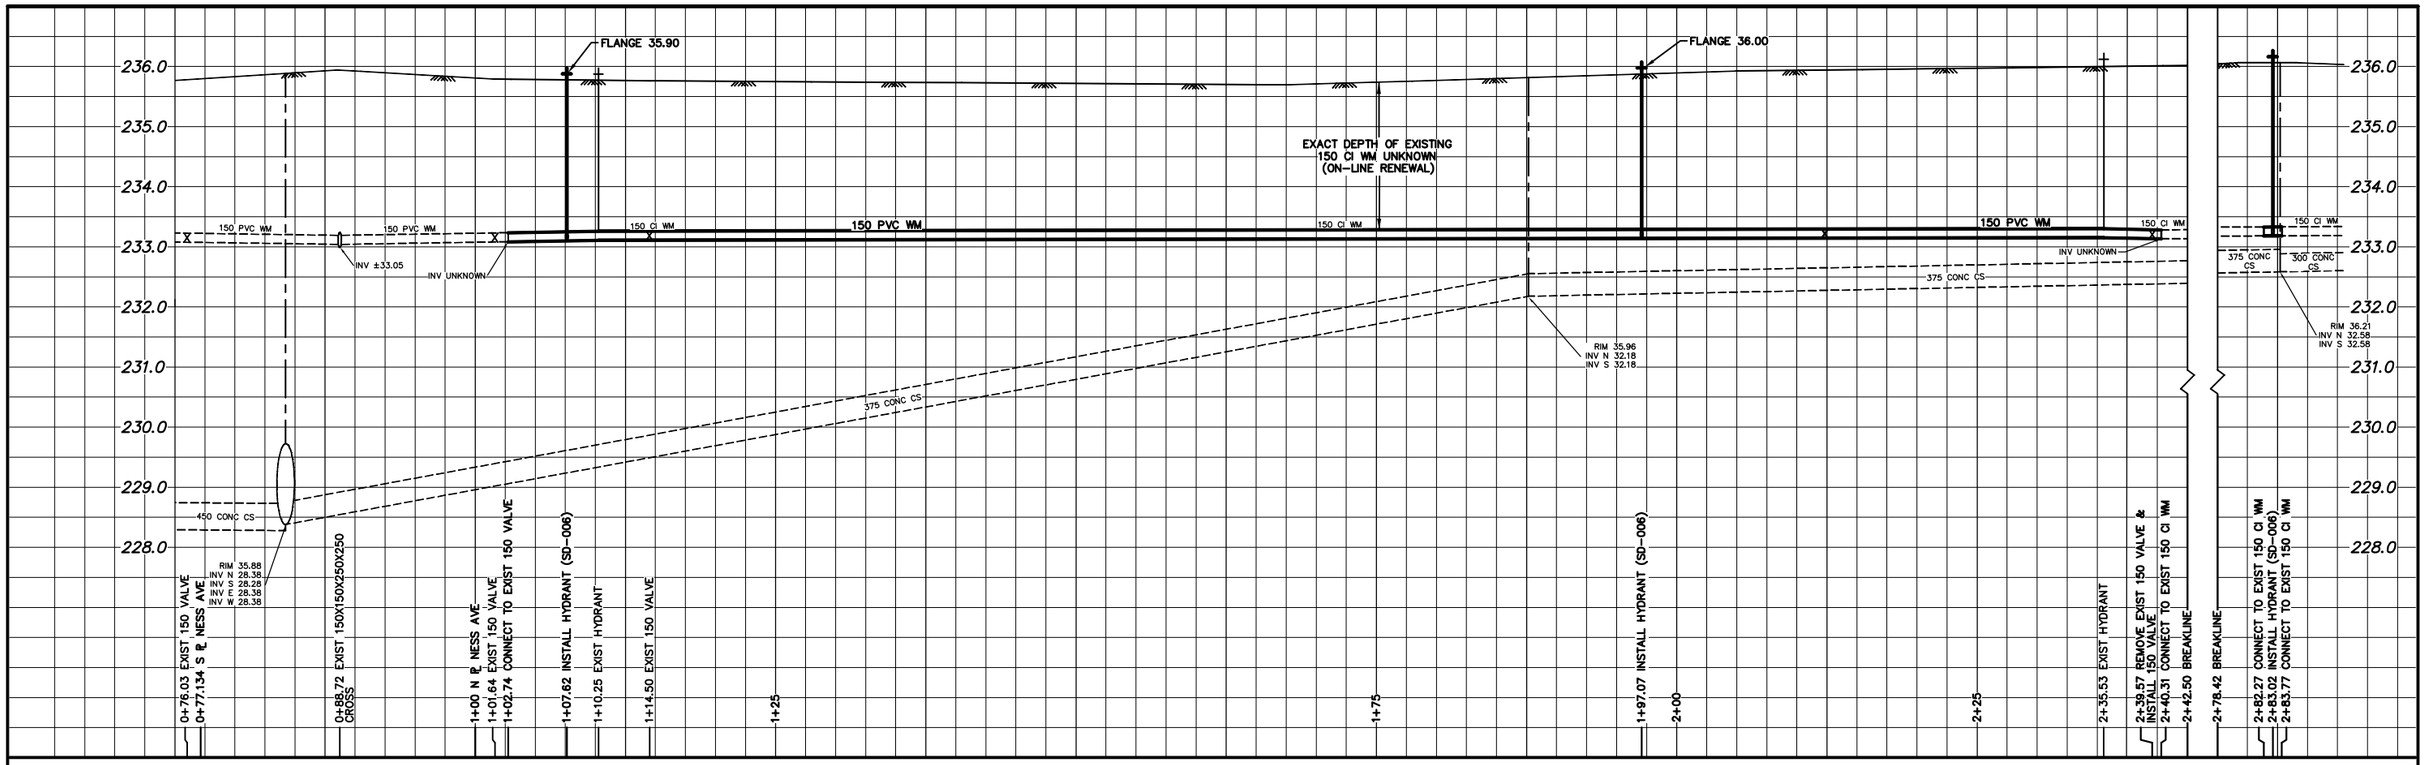

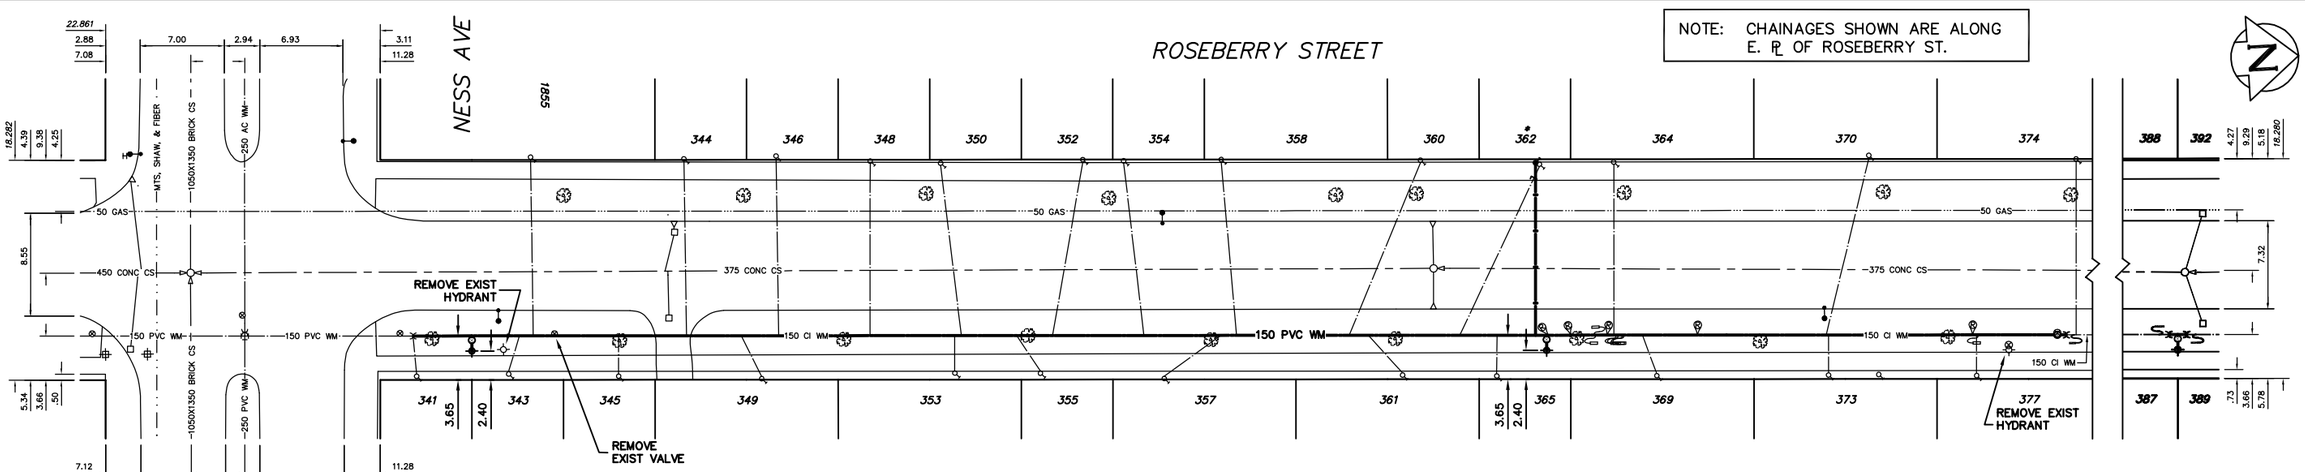

NOTE: CHAINAGES SHOWN ARE ALONG E. ℄ OF ROSEBERRY ST.

CONSTRUCTION NOTES

1. EXPOSE EXISTING WATERMAIN & CONFIRM INVERTS PRIOR TO CONSTRUCTION.
2. LOCATION OF ALL SERVICES TO BE CONFIRMED IN THE FIELD.
3. INSTALL WATERMAIN BY TRENCHLESS METHODS.
4. TRENCHES AND EXCAVATIONS WITHIN 1 METRE OF A PAVED AREA INCLUDING SIDEWALKS SHALL BE CLASS 3 BACKFILL.
5. ALL MATERIALS SHALL CONFORM TO THE CITY OF WINNIPEG STANDARD CONSTRUCTION SPECIFICATIONS.
6. MINIMUM COVER TO TOP OF WATERMAIN SHALL BE 2.4 m.
7. REPLACE ALL EXISTING LEAD SERVICES FROM PROPOSED WATERMAIN TO ℄.
8. NOTIFY ALL AFFECTED RESIDENTS AND BUSINESSES 24 HOURS IN ADVANCE OF ANY WATER SHUTDOWNS OR DISRUPTION OF SERVICE.

WATER SERVICE INFORMATION

ADDRESS	SIZE(mm) & TYPE (STREET)	SIZE(mm) & TYPE (PROP)	SHORT & LONG MEASUREMENT	CORP. LOCATION	REMARKS
341 ROSEBERRY ST RESIDENTIAL	– –	19 COPPER	1.52 NSL BLDG 7.32 S 1ST HYD N NESS	0.3 S OF S/C	– –
343 ROSEBERRY ST RESIDENTIAL	19 COPPER	13 LEAD	2.44 N OF SHL –	0.91 N OF S/C	– –
344 ROSEBERRY ST RESIDENTIAL	19 COPPER	– –	1.98 N OF S SIDE –	15.24 FROM HYD	– –
345 ROSEBERRY ST RESIDENTIAL	– –	– –	2.6 SNL BLDG –	–	– –
346 ROSEBERRY ST RESIDENTIAL	– –	– –	0.91 N OF S SIDE –	22.9 FROM HYD	– –
348 ROSEBERRY ST RESIDENTIAL	– –	– –	1.83 NSL BLDG –	30.5 FROM HYD	– –
349 ROSEBERRY ST RESIDENTIAL	19 COPPER	19 COPPER	2.93 S OF N SIDE 0.3 OFF ℄	19.8 FROM HYD	– –
350 ROSEBERRY ST RESIDENTIAL	19 –	16 LEAD	0.91 N OF S –	38.1 FROM HYD	– –

WATER SERVICE INFORMATION

ADDRESS	SIZE(mm) & TYPE (STREET)	SIZE(mm) & TYPE (PROP)	SHORT & LONG MEASUREMENT	CORP. LOCATION	REMARKS
352 ROSEBERRY ST RESIDENTIAL	– –	– –	2.13 N OF S SIDE –	45.7 FROM HYD	– –
353 ROSEBERRY ST RESIDENTIAL	19 COPPER	19 COPPER	1.22 NSL HSE –	OPP S/C	– –
354 ROSEBERRY ST RESIDENTIAL	– –	– –	0.6 N OF S –	53.3 FROM HYD	– –
355 ROSEBERRY ST RESIDENTIAL	– –	– –	0.6 N OF S –	42.7 FROM HYD	– –
357 ROSEBERRY ST RESIDENTIAL	19 COPPER	19 COPPER	4.26 NSL BLDG –	59.7 N 1ST HYD	– –
358 ROSEBERRY ST RESIDENTIAL	– –	19 COPPER	0.21 S OF S SIDE –	61.0 FROM HYD	– –
360 ROSEBERRY ST RESIDENTIAL	– –	19 COPPER	1.82 NSL BLDG –	54.9 FROM HYD	– –
361 ROSEBERRY ST RESIDENTIAL	– –	19 COPPER	2.13 S OF N SIDE –	53.3 FROM HYD	– –

0.0 5.0 10.0 15.0 20.0 25.0

WATER SERVICE INFORMATION

ADDRESS	SIZE(mm) & TYPE (STREET)	SIZE(mm) & TYPE (PROP)	SHORT & LONG MEASUREMENT	CORP. LOCATION	REMARKS
• 362 ROSEBERRY ST RESIDENTIAL	13 LEAD	13 LEAD	2.3 SNL BLDG 37.6 S 2ND NYD N NESS	45.7 FROM HYD	– –
364 ROSEBERRY ST RESIDENTIAL	19 COPPER	13 LEAD	2.44 NSL BLDG –	OPP S/C	– –
365 ROSEBERRY ST RESIDENTIAL	– –	– –	0.91 NSL HSE –	33.5 FROM HYD	– –
369 ROSEBERRY ST RESIDENTIAL	– –	– –	3.66 S OF N SIDE –	30.5 FROM HYD	– –
370 ROSEBERRY ST RESIDENTIAL	19 COPPER	19 COPPER	1.83 S OF N SIDE –	15.2 FROM HYD	– –
373 ROSEBERRY ST RESIDENTIAL	19 COPPER	13 LEAD	2.13 SNL BLDG –	OPP S/C	– –
374 ROSEBERRY ST RESIDENTIAL	– –	– –	0.05 SNL BLDG –	OPP S/C	– –
377 ROSEBERRY ST RESIDENTIAL	19 COPPER	13 LEAD	1.22 N OF SHL –	OPP S/C	S/C REPAIR SEP/01/00
1855 NESS AVE COMMERCIAL	– –	– –	12.5 NNL ROSEBERRY	–	SERV. OFF ROSEBERRY

• SERVICES TO BE RENEWED TO ℄ ALL OTHERS TO BE RECONNECTED

METRIC

WHOLE NUMBERS INDICATE MILLIMETRES
DECIMALIZED NUMBERS INDICATE METRES

NOTE: ALL VALVES TO BE INSTALLED COUNTERCLOCKWISE TO CLOSE

WARNING

IF POWER EQUIPMENT OR EXPLOSIVES ARE TO BE USED FOR EXCAVATION ON THIS PROJECT THE CONTRACTOR MUST:
1) NOTIFY THE GAS COMPANY OF THE PROPOSED LOCATION OF EXCAVATION.
2) TAKE PRECAUTION TO AVOID DAMAGE TO GAS COMPANY INSTALLATIONS.

SEE PROVINCIAL REGULATION 210/72 FOR DETAILS

200 WM	WATERMAIN	200 WM		SL , HYDRO		150 WM	WATERMAIN	150 WM
⊹	HYDRANT	⊹		MTS		⊹	HYDRANT	⊹
⊗	VALVE	⊙		TRAFFIC SIGNALS		⊗	VALVE	⊗
525 LDS	LAND DRAINAGE SEWER	525 LDS	50 GAS	GAS	50 GAS	300 LDS	LAND DRAINAGE SEWER	300 LDS
375 WWS	WASTEWATER SEWER	375 WWS	⊕	SURVEY BAR		250 WWS	WASTEWATER SEWER	250 WWS
○	MANHOLE	●		FENCE			℄ PROFILE	
□	CATCH BASIN	■		POLE – HYDRO, MTS			GROUND ABOVE PIPE	
▽	CURB INLET	▼		CURB STOP				
◁	REDUCER	◀		GUY ANCHOR				
⊁	COUPLING	⊁		LIGHT STANDARD				
⇨	ANODE	⇨		TREE				
EXISTING	LEGEND–PLAN	PROPOSED	EXISTING	LEGEND–PLAN	PROPOSED	EXISTING	LEGEND–PROFILE	PROPOSED

LOCATION APPROVED
UNDERGROUND STRUCTURES

SUPV. U/G STRUCTURES COMMITTEE — DATE

NOTE:
LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.

B.M. ELEV.

FIELD BOOK ℄:

POSTED TO LBIS

NO.	REVISIONS	DATE	BY

CITY OF WINNIPEG
WATER AND WASTE
ENGINEERING DIVISION

DESIGNED BY	DS/CJH	CHECKED BY	TW
DRAWN BY	CJH	APPROVED BY	KZ
HOR. SCALE	1:250	RELEASED FOR CONSTRUCTION	
VERTICAL	1:50		
DATE	2004 05 19	DATE	

ENGINEER'S SEAL

ORIGINAL SIGNED BY K.R. ZUREK 04/05/19

BID OPPORTUNITY: 152–2004
FILENAME: D–8500.dwg
PLOT DATE: 2004 05 19

Winnipeg

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

2004 WATERMAIN RENEWALS

ROSEBERRY STREET
NESS AVENUE TO
150 m N OF NESS AVENUE

SHEET 13 OF 13

CITY DRAWING NUMBER

D–8500