





EXISTING CONDENSING UNIT TO REMAIN

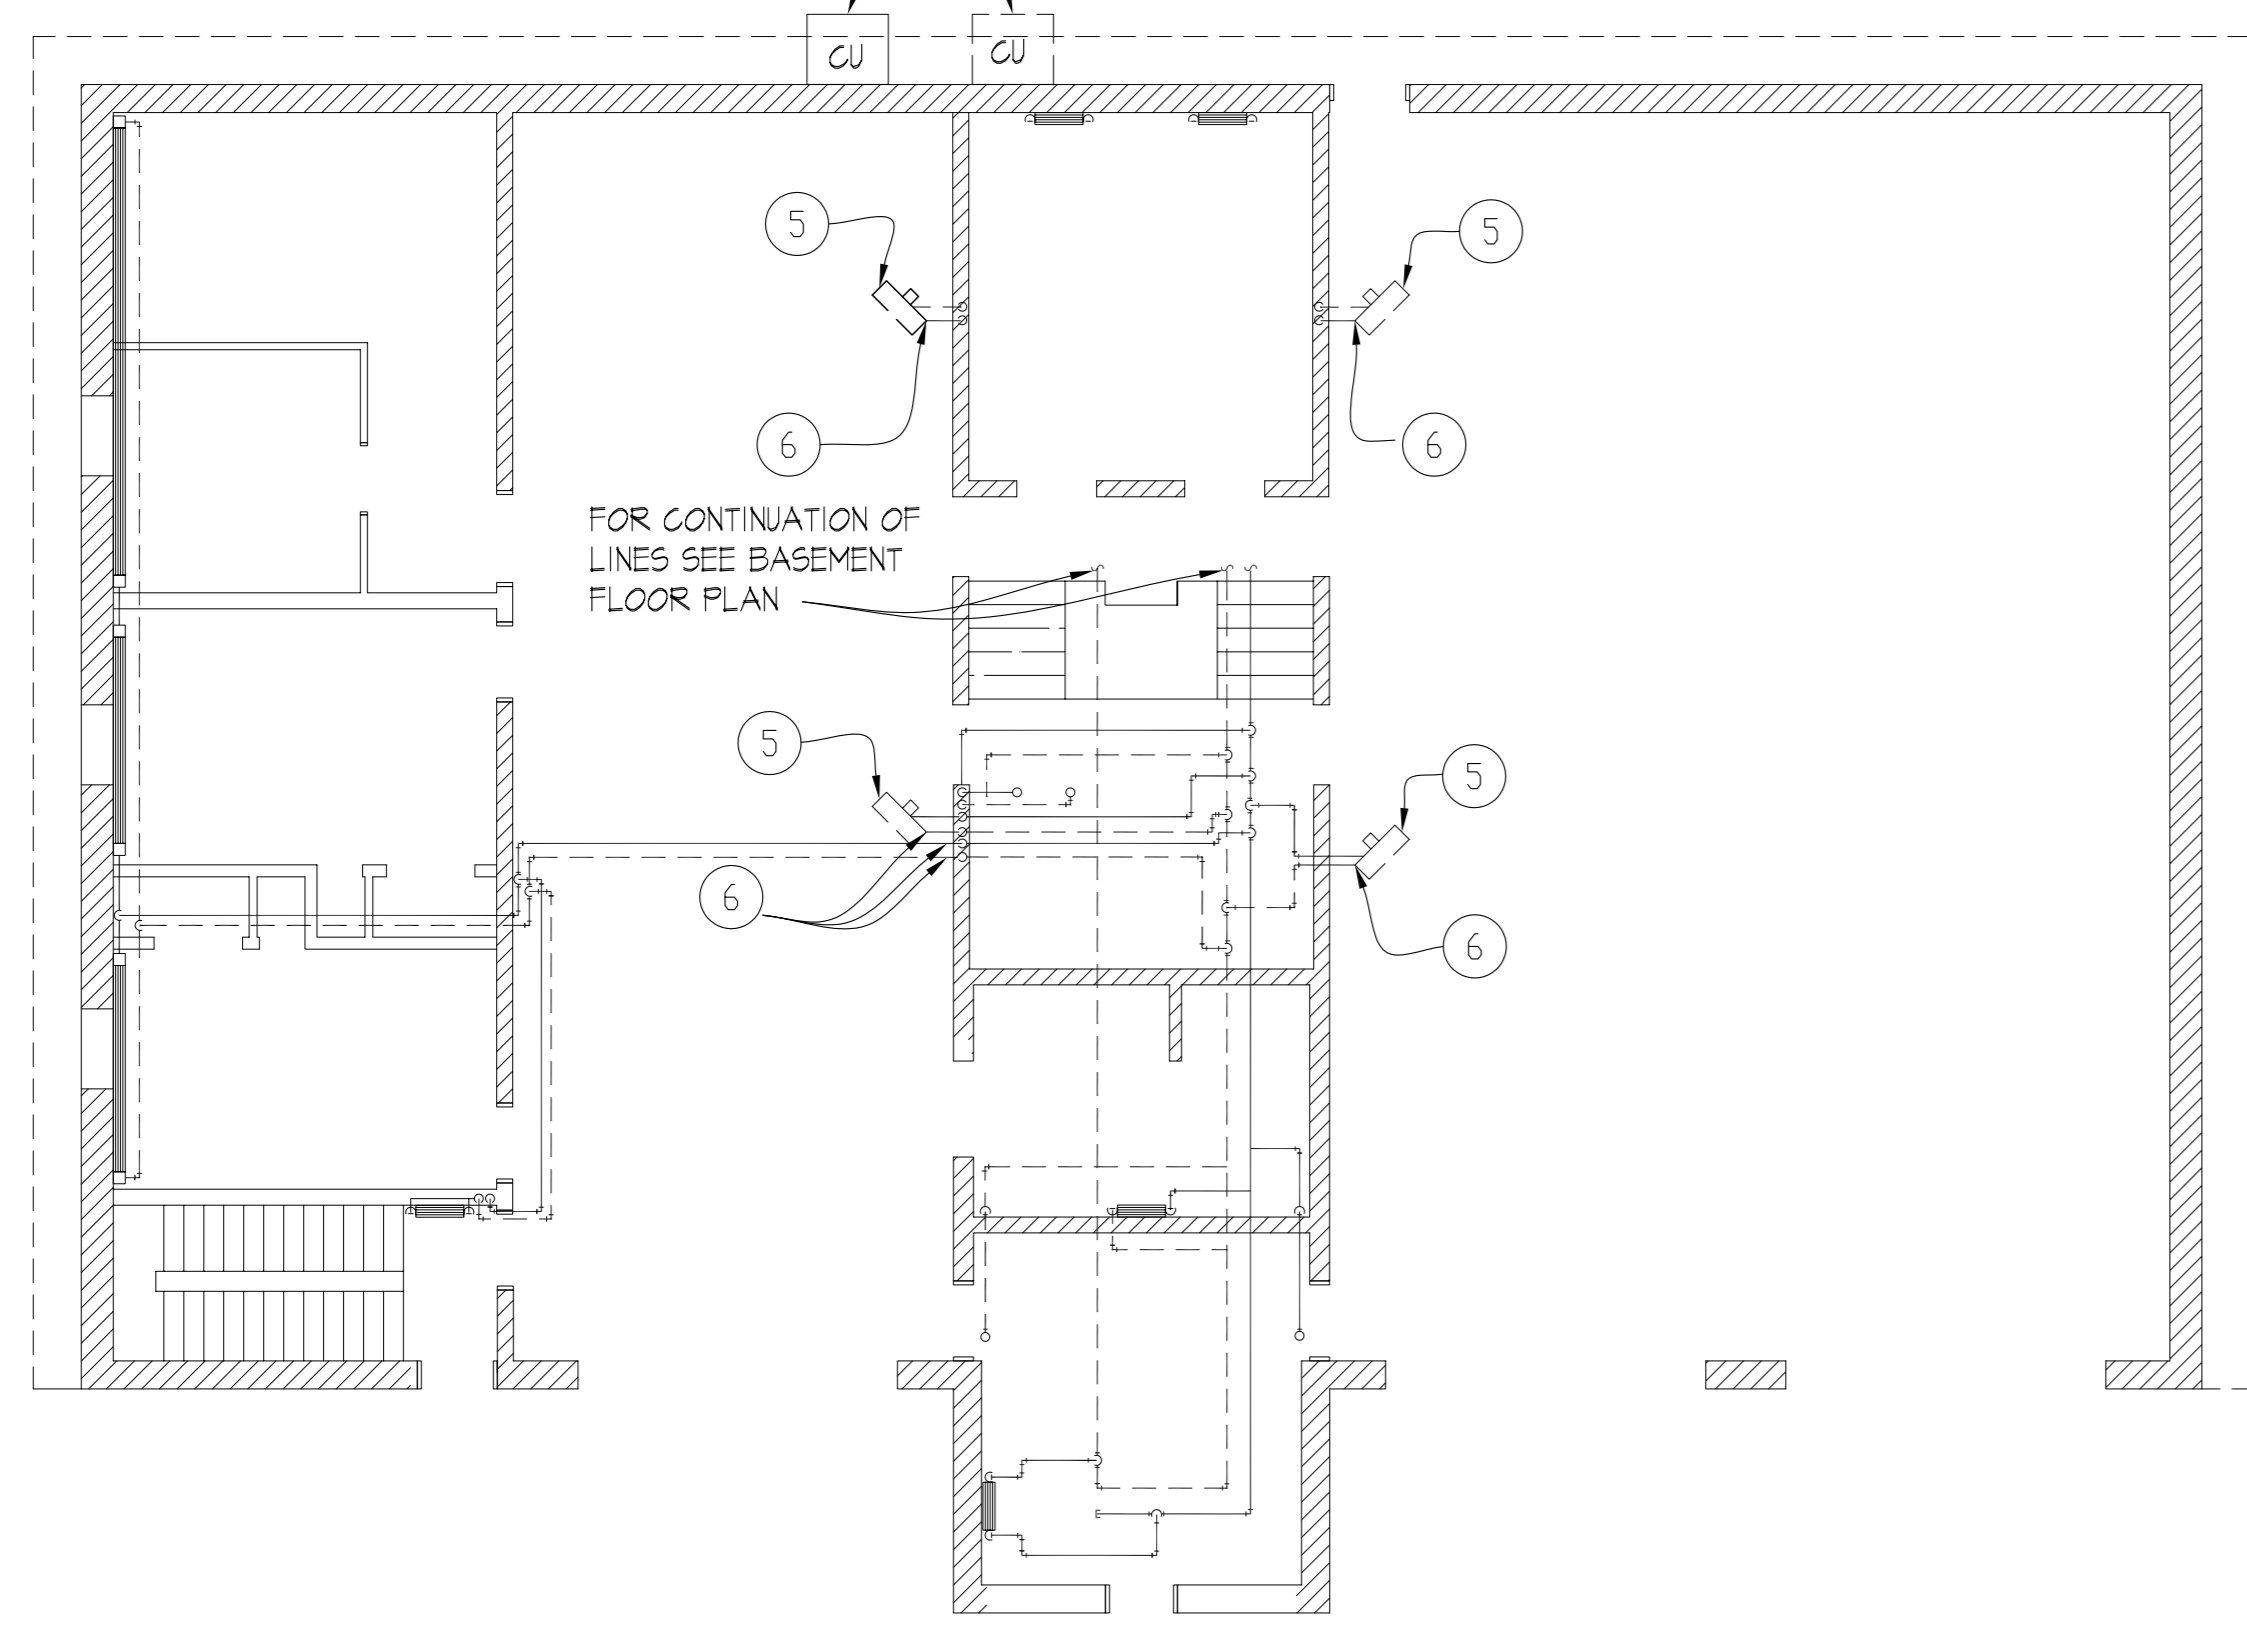

GROUND FLOOR PLAN - MECHANICAL DEMOLITION  
SCALE: 1/8"=1'-0"

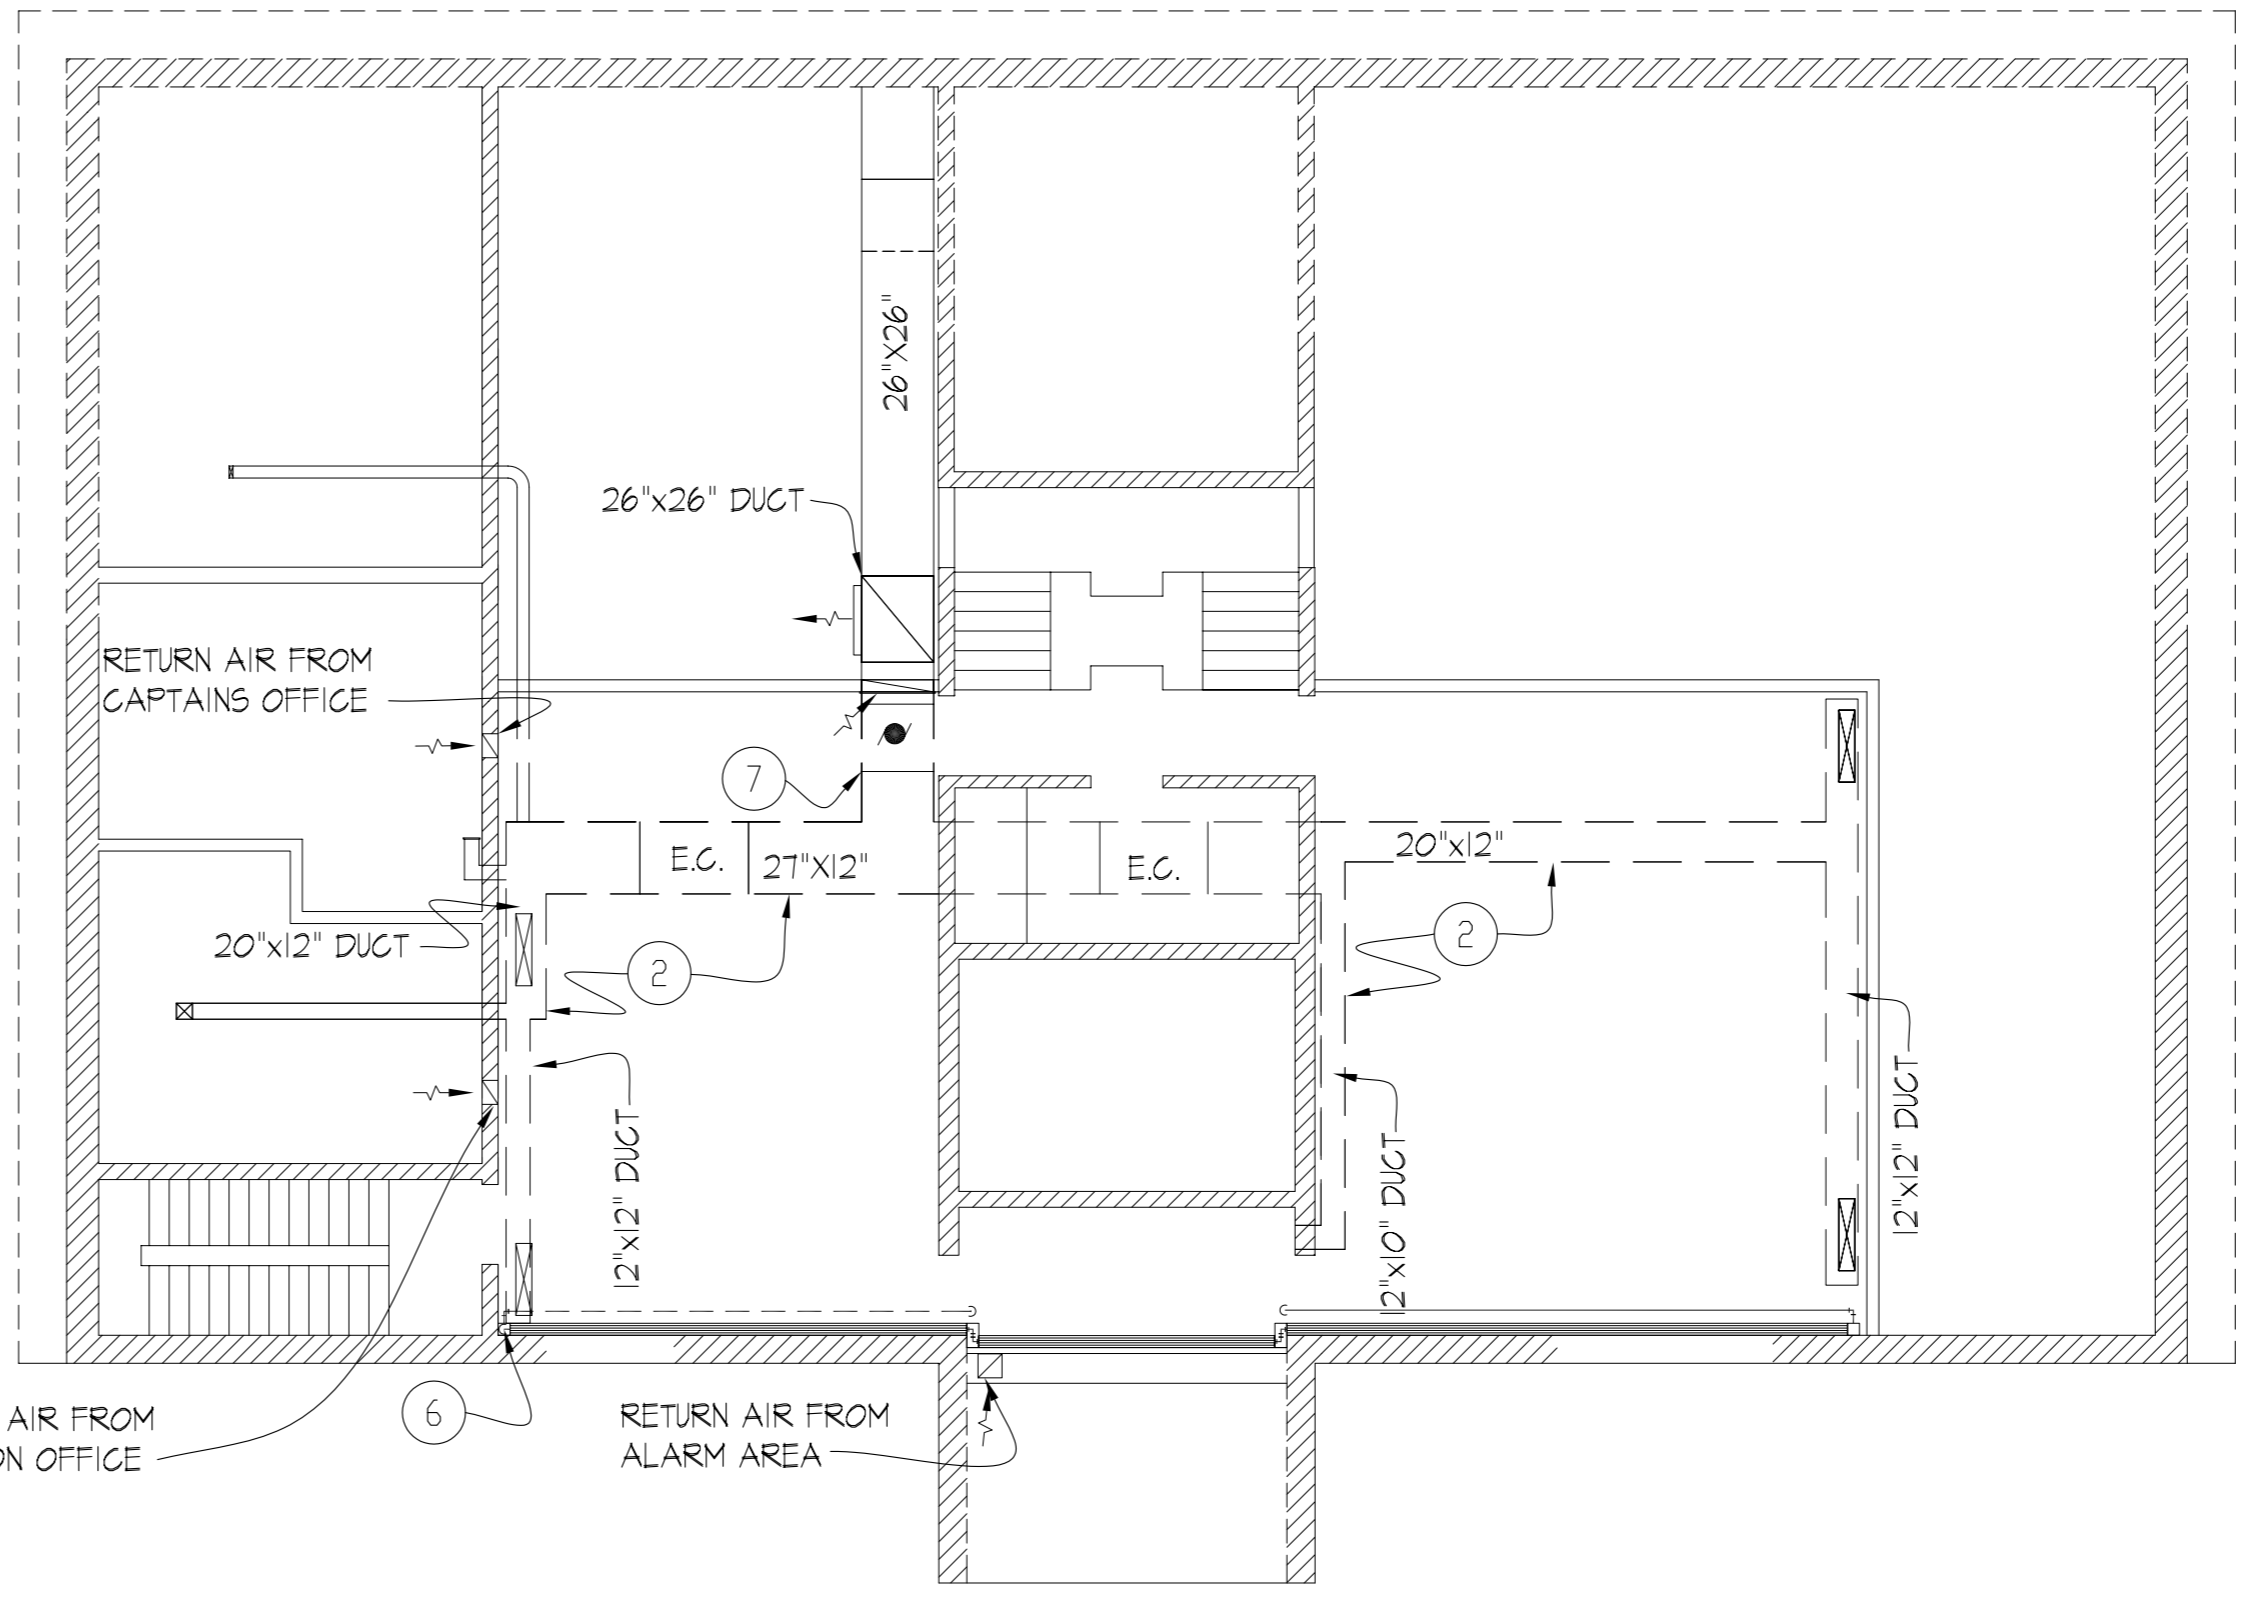


UPPER FLOOR PLAN - MECHANICAL DEMOLITION  
SCALE: 1/8"=1'-0"

**LEGEND**

	EXISTING HVAC SYSTEM
	HOT WATER RETURN
	HOT WATER SUPPLY
	AIR HANDLER & HOUSING
	UNIT HEATER
	CONDENSING UNIT
	EVAPORATION COIL
	FIRE DAMPER (SUPPLY & INSTALL)
	BASEBOARD RADIANT HEATER
	EXISTING NATURAL GAS WATER HEATER
	CIRCULATOR PUMP
	BASEBOARD RADIANT HEATER
	EXPANSION TANK
	EXISTING NATURAL GAS HOT WATER BOILER

- DEMOLITION NOTES**
- 1 REMOVE AND DISPOSE OF EXISTING EXPANSION TANK
  - 2 REMOVE & SALVAGE DUCT SYSTEM AND ALL RELATED COMPONENTS UNDER THE UPPER FLOOR
  - 3 REMOVE & DISPOSE OF CIRCULATOR PUMP.
  - 4 REMOVE & DISPOSE OF CONDENSING UNIT
  - 5 REMOVE & DISPOSE OF HOT WATER UNIT HEATER
  - 6 REMOVE & DISPOSE OF AIR RELEASEERS
  - 7 REMOVE & DISPOSE OF ISOLATION CEILING MOUNTS FOR CEILING HUNG AIR HANDLER.

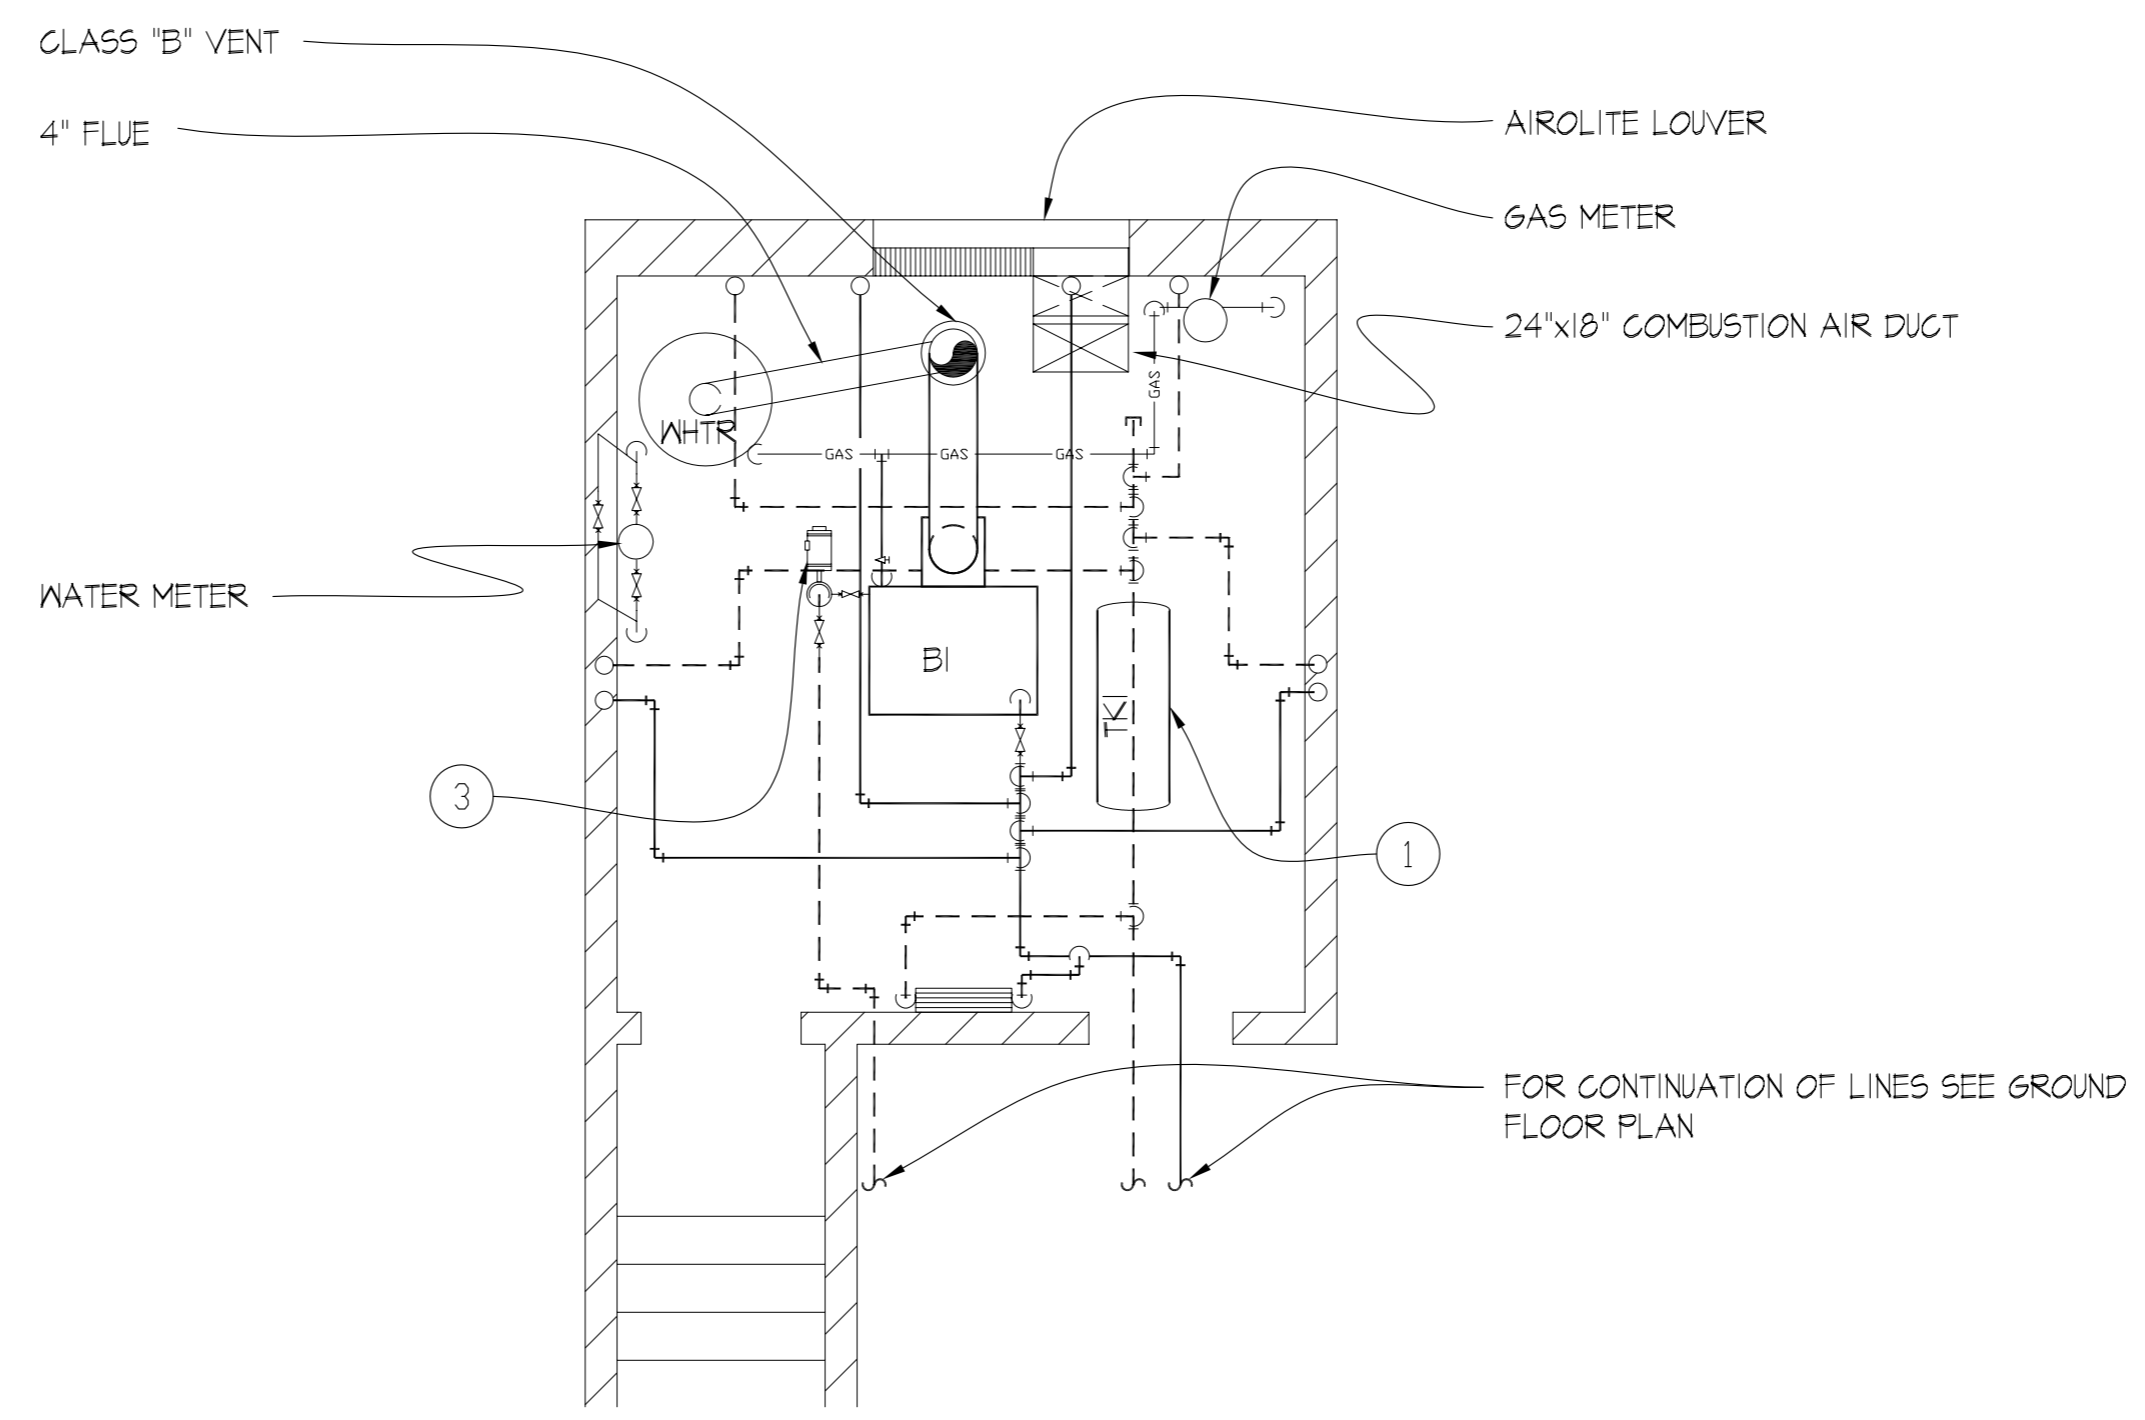

BASEMENT FLOOR PLAN - MECHANICAL DEMOLITION  
SCALE: 1/4"=1'-0"

- NOTES :**
1. THESE DRAWINGS SHALL NOT BE SCALED.
  2. THE CONTRACTOR SHALL VISIT THE SITE AND SATISFY ONESELF ALL DIMENSIONS, DATUM, AND DETAILED INFORMATION SHOWN ARE CORRECT.
  3. THE CONTRACTOR IS TO REPORT ANY DISCREPANCIES PRIOR TO COMMENCEMENT OF WORK.
  4. THE CONTRACTOR IS TO REVIEW AND COORDINATE ALL ARCHITECTURAL, MECHANICAL, ELECTRICAL AND STRUCTURAL DRAWINGS FOR ADDITIONAL OPENINGS THROUGH FLOORS, WALLS, AND CEILINGS FOR DUCT, PIPE & ELECTRICAL RISERS AND ALL OPENINGS NOT SHOWN ON DRAWINGS.
  5. ALL OPENINGS THROUGH FIRE ASSEMBLIES ARE TO BE FIRE STOPPED AND SEALED WITH ULC APPROVED FIRE STOPPING TO MAINTAIN THE INTEGRITY OF THE FIRE SEPARATION, AND PROVIDE A SMOKE-TIGHT BARRIER.
  6. ALL PRODUCTS AND MATERIALS TO BE USED AND INSTALLED SHALL CONFORM WITH MANUFACTURER'S SPECIFICATIONS & APPLICABLE CODES.
  7. THE CONTRACTOR SHALL BE RESPONSIBLE TO PATCH AND MAKE GOOD ALL EXISTING CONSTRUCTION AFFECTED BY THE REMOVAL OF ALL ITEMS FORMING THE PART OF THE RENOVATION WORK.
  8. WHERE NEW FLOORING AND BASE IS TO BE INSTALLED IN EXISTING AREAS (REFER TO FLOOR PLAN AND ROOM SCHEDULE) THE EXISTING FLOORING SURFACE AND BASE MUST BE REMOVED UNLESS OTHERWISE NOTED. ALL FLOOR SURFACES SHALL BE PREPARED IN ACCORDANCE TO MANUFACTURER'S RECOMMENDATIONS FOR INSTALLATION OF NEW FLOOR.
  9. WHERE PAINTING OF EXISTING WALLS IS INDICATED ON THE ROOM SCHEDULE, THESE WALLS MUST BE CLEANED OF ANY EXISTING WALL COVERING, PATCHED & PREPARED TO ACCEPT NEW MATERIAL, UNLESS OTHERWISE NOTED.

ORIGINAL STAMPED BY: PALEY, DOUG  
DATE: 2005.01.19

NO.	REVISION/DESCRIPTION	BY	DATE
SEALS			

DRAWN BY: DNJ CHECKED BY: APPROVED  
DATE: 2005.01.19 USER APPROVAL

CITY OF WINNIPEG  
PLANNING, PROPERTY & DEVELOPMENT DEPARTMENT  
CIVIC ACCOMMODATIONS DIVISION  
300 - 65 GARRY ST. R3C 4K4

PROJECT  
BUILDING CODE UPGRADE  
FIRE STATION #3  
337 DES MEURONS

SHEET TITLE  
DEMOLITION  
MECHANICAL

SCALE	PROJECT NO.	SHEET NO.
AS NOTED	2003-200	M-1