


HOUSE No.	SIZE & TYPE	DISTANCE TO FL.	STOP COCK LOCATION		CORPORATION COCK LOC.	COMMENTS
			SHORT	LONG		
232	15 COP	UNK	3.0 E OF WHL	UNKNOWN	46.0 E OF HYD	
236	20 COP	0.5	2.7 E OF WHL	UNKNOWN	56.7 W OF HYD	
240	20 COP	UNK	1.2 W OF WHL	UNKNOWN	38.6 W OF HYD	
242	15 COP	UNK	1.2 E OF EHL	UNKNOWN	26.2 W OF HYD	
255	15 COP	0.5	0.7 W OF E-HSE COR	UNKNOWN	32.1 W OF HYD	
259	15 COP	UNK	2.2 W OF EHL	UNKNOWN	0.5 W OF SC	PLUG 1.2 FROM CORN
262	15 COP	UNK	1.5 W OF EHL	UNKNOWN	24.4 W OF HYD	
263	15 COP	0.5	2.7 W OF E-HSE COR	UNKNOWN	32.1 W OF HYD	
267	15 COP	0.5	2.0 W OF E-HSE COR	UNKNOWN	18.1 W OF HYD	
271	20 COP	0.5	1.6 W OF E-HSE COR	UNKNOWN	5.2 W OF HYD	
272	20 COP	UNK	1.5 W OF EHL	UNKNOWN	9.8 E OF HYD	
275	15 COP	0.5	0.9 E OF E COR HSE	UNKNOWN	14.6 E OF HYD	
276	15 COP	0.5	0.4 W OF E-HSE COR	UNKNOWN	26.8 E OF HYD	
279	15 COP	0.5	0.7 E OF E-HSE COR	UNKNOWN	29.9 E OF HYD	
280	15 COP	0.5	1.8 W OF E-HSE COR	UNKNOWN	36.6 E OF HYD	
283	15 COP	0.5	0.5 E OF E-HSE COR	UNKNOWN	43.9 E OF HYD	
284	15 COP	0.5	1.0 W OF E-HSE COR	UNKNOWN	61.9 E OF HYD	
287	20 COP	0.5	0.6 E OF EHL	UNKNOWN	43.2 E OF HYD	

1+25 MATCH LINE  
 1+39.22 HYDRANT TEE  
 1+40.90 HYDRANT (SD-007)  
 1+50  
 1+56.14 150 GV  
 2+87.14 GRADE CHANGE  
 2+00  
 2+24.72 HYDRANT (SD-007)  
 2+26.40 HYDRANT TEE  
 2+35.07 GRADE CHANGE  
 2+50 MATCH LINE

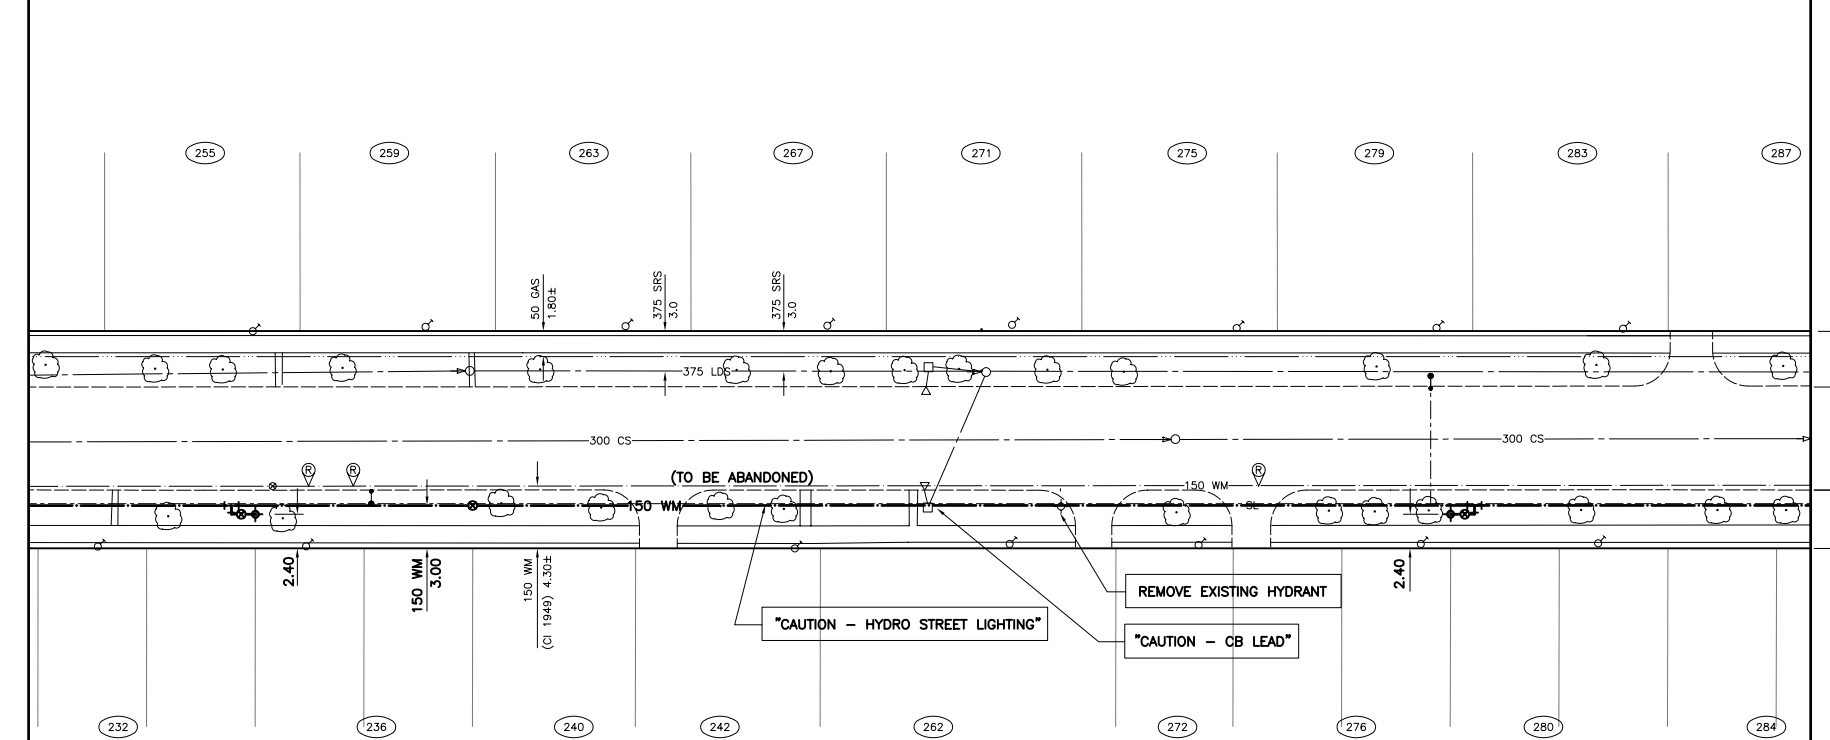

SEE DRAWING D-8799

SEE DRAWING D-8801

- GENERAL NOTES:**
- CHAINAGE IS ALONG SOUTH PROPERTY LINE OF HAZEL DELL AVENUE.
- CONSTRUCTION NOTES:**
- EXPOSE EXISTING WATERMAIN AT TIE-IN LOCATIONS AND CONFIRM INVERT PRIOR TO CONSTRUCTION.
  - INSTALL WATERMAIN BY TRENCHLESS METHODS.
  - ALL MATERIALS SHALL CONFORM TO THE CITY OF WINNIPEG STANDARD CONSTRUCTION SPECIFICATIONS.
  - MINIMUM COVER TO TOP OF WATERMAIN SHALL BE 2.4m.
  - NOTIFY ALL AFFECTED RESIDENTS AND BUSINESSES 24 HOURS IN ADVANCE OF ANY WATER SHUTDOWNS OR DISRUPTION OF SERVICE.

## HAZEL DELL AVENUE

  
 Certificate of Authorization  
 Wardrop Engineering Inc.  
 No. 195 Expiry: April 30, 2006

EXISTING	LEGEND-PLAN	PROPOSED	EXISTING	LEGEND-PLAN	PROPOSED	EXISTING	LEGEND-PLAN	PROPOSED
150 WM	WATERMAIN	150 WM	BEND	ANCHOR		400 FM	FEEDERMAIN	400 FM
300 LDS	LAND DRAINAGE SEWER	300 LDS	TEE	TREE		250 WWS	WASTEWATER SEWER	250 WWS
300 CS	COMBINED SEWER	300 CS	CURB STOP	LEGAL DIMENSION		300 FCM	FORCEMAIN	300 FCM
200 FCM	FORCEMAIN	200 FCM	PLUG	SURVEY BAR			JUNCTIONS	
	HYDRANT		MANHOLE	TRAFFIC SIGNAL			VALVE	
	REDUCER		CATCHBASIN	GAS			REDUCER	
			CURB INLET	HYDRO				
			ADDRESS	MTS				
			HYDRO POLE	SIDEWALK				
			LIGHT STANDARD	CURB				

**LOCATION APPROVED UNDERGROUND STRUCTURES**

SUPV. U/G STRUCTURES DATE COMMITTEE

**NOTE:**  
 LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE. BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.

B.M. CITY OF WINNIPEG 12-057  
 ELEV. 230.475m F.B. 2091

**WARDROP** Engineering Inc.


DESIGNED BY: GWC  
 CHECKED BY:  
 DRAWN BY: GMD  
 APPROVED BY:

HOR. SCALE: 1 : 250  
 VERTICAL: 1 : 50

DATE: 05.05.20

ORIGINAL DRAWING REVISION \* SEALED BY H.A.K. KATZ 05.06.30

CONSULTANT DRAWING NO. 0500120400-DWG-C4009

  
**THE CITY OF WINNIPEG**  
 WATER AND WASTE DEPARTMENT

2005 WATERMAIN RENEWALS CONTRACT No. 9

HAZEL DELL AVENUE  
 134m EAST OF HENDERSON HIGHWAY TO 50m WEST OF BRAZIER STREET

CITY DRAWING NUMBER D-8800  
 SHEET 9 OF 14  
**C4009**