



SHEET: CMR-A1-WWD (1/2005)

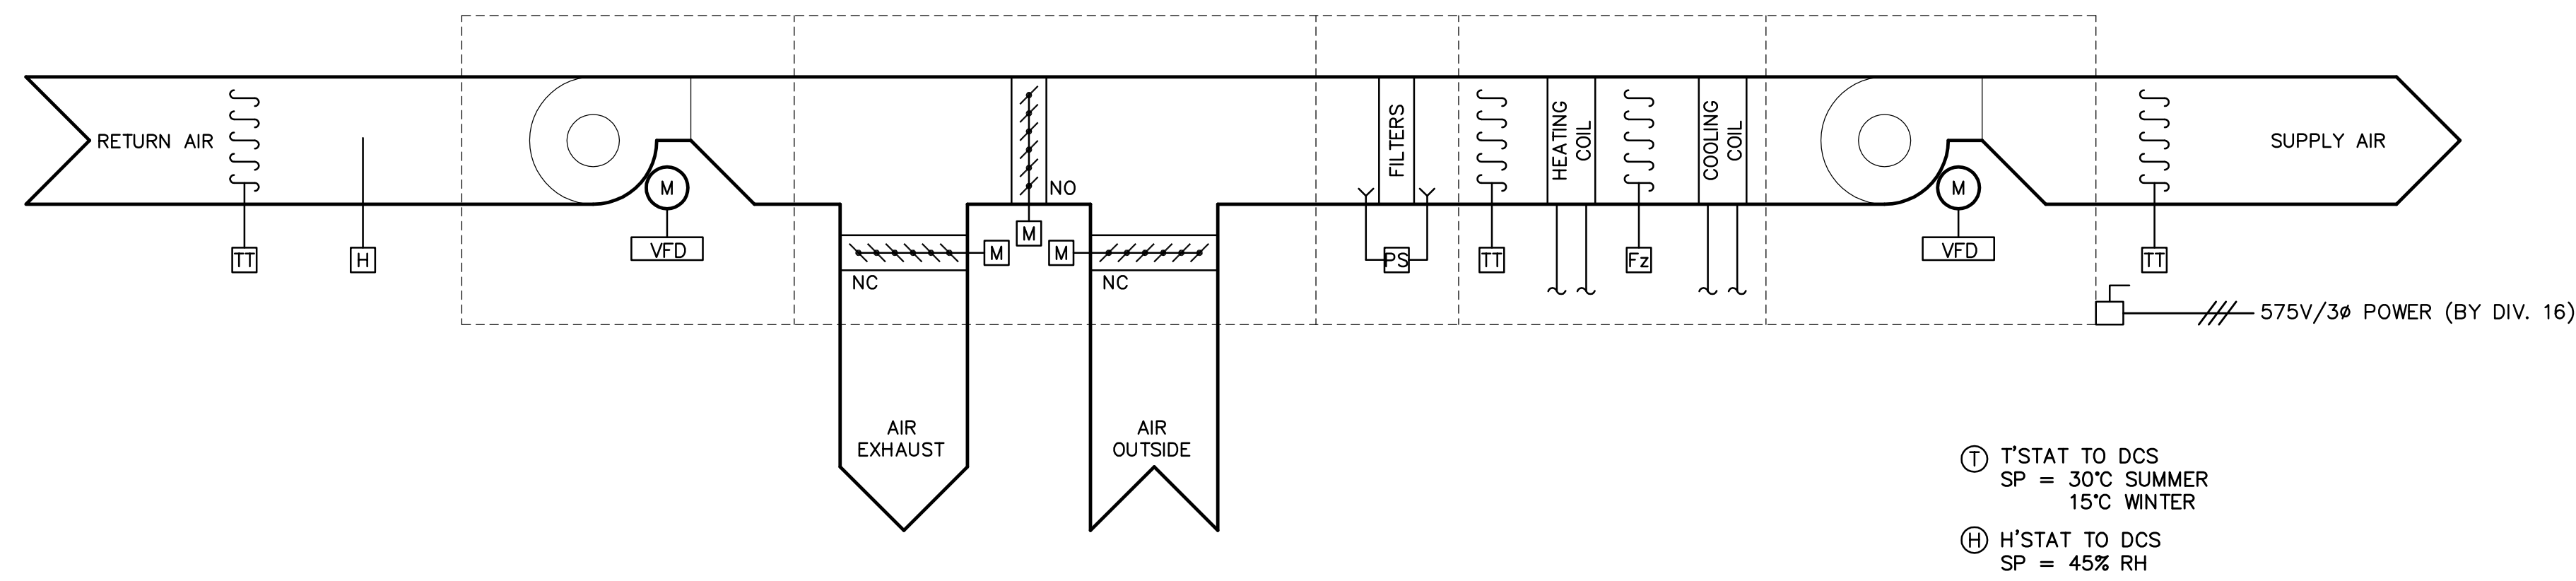


T T'STAT TO DCS
SP = 30°C SUMMER
15°C WINTER

H H'STAT TO DCS
SP = 45% RH

1 U-420-AHU-1 UV PROCESS ROOM
MB.03 SCALE: N.T.S.

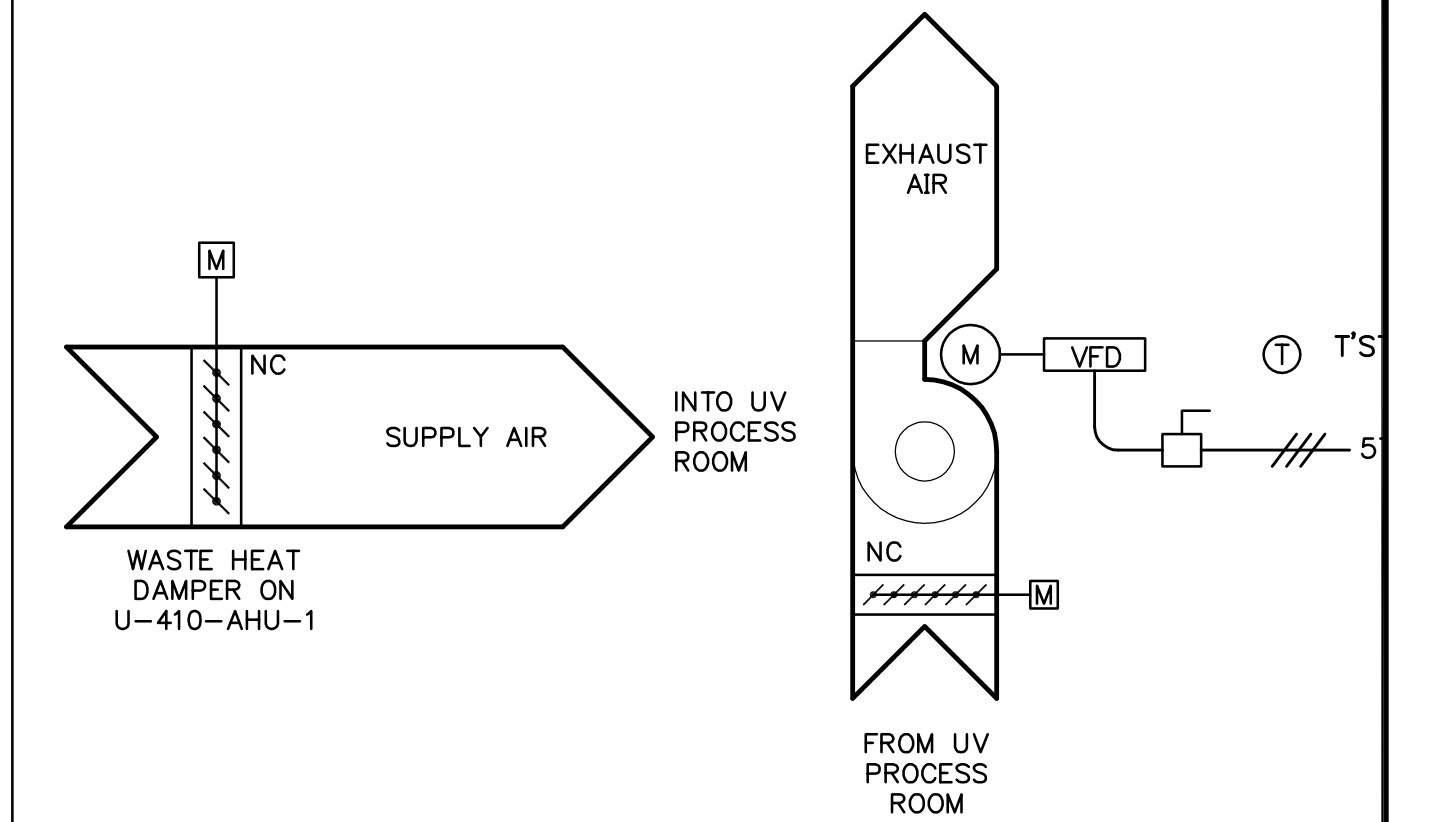


2 U-426-EF WASTE HEAT EXHAUST SYSTEM
MB.03 SCALE: N.T.S.

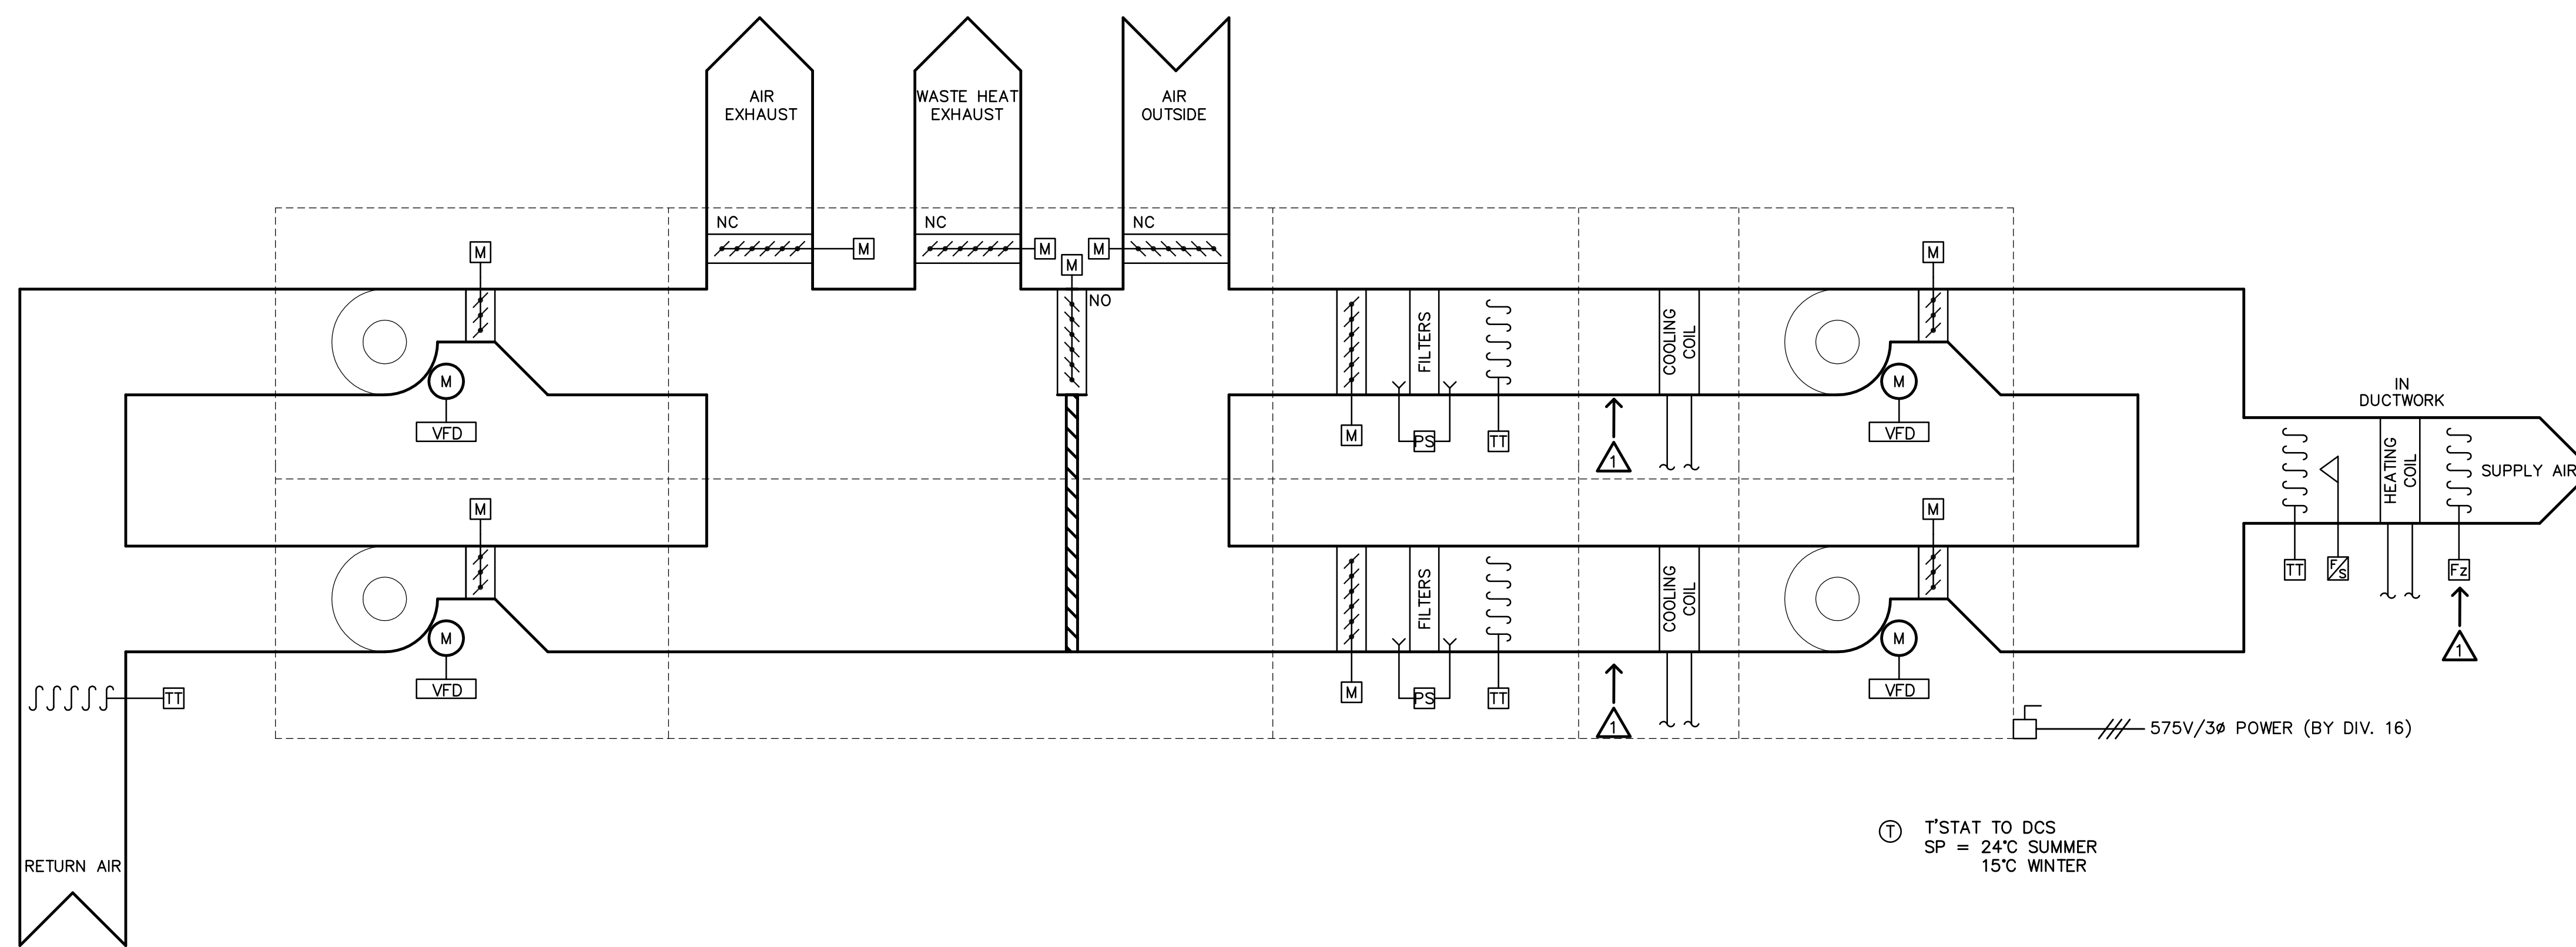

T T'STAT TO DCS
SP = 24°C SUMMER
15°C WINTER

3 U-410-AHU-1 ELECTRICAL ROOM
MB.03 SCALE: N.T.S.

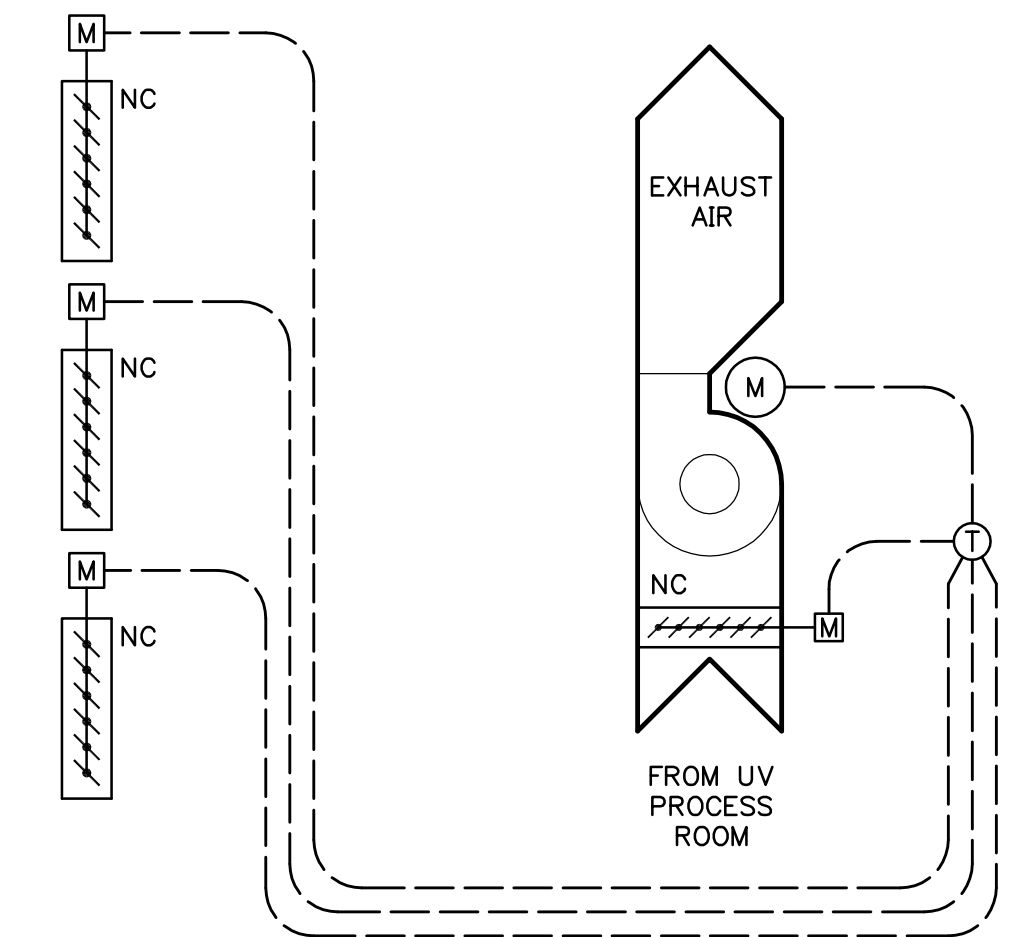

4 U-419-EF EMERGENCY COOLING SYSTEM
MB.03 SCALE: N.T.S.

| | | | | | |
|------------|-----------------------|----------|-----|------|------------|
| B.M. ELEV. | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| 1 | ISSUED FOR ADDENDUM 1 | 05/03/11 | DC | | |
| 0 | ISSUED FOR TENDER | 05/02/18 | JEH | | |
| NO. | REVISIONS | DATE | BY | DATE | 2004/12/06 |



EARTH TECH

Earth Tech (Canada) Inc. Winnipeg, Manitoba 204.477.5381

| | | | |
|---------------------|---------|---|-----|
| DESIGNED BY | PL | CHECKED BY | AMA |
| DRAWN BY | JDB, DL | APPROVED BY | DT |
| HOR. SCALE: NTS | | RELEASED FOR CONSTRUCTION BY: T. KJARTANSON | |
| VERTICAL SCALE: NTS | | DATE: 2005-02-18 | |

ENGINEER'S SEAL

ORIGINAL SIGNED BY

P.V. LAITINEN

FEB. 18/05

CONSULTANT DRAWING NO. 66303D-CM8.03

THE CITY OF WINNIPEG

Winnipeg WATER AND WASTE DEPARTMENT

NEWPCC - SECONDARY EFFLUENT UV DISINFECTION FACILITY

MECHANICAL VENTILATION SCHEMATICS SHEET 1 OF 2

| | |
|---------------------|--|
| CITY FILE NUMBER | |
| SHEET 17 OF 18 | |
| CITY DRAWING NUMBER | |