
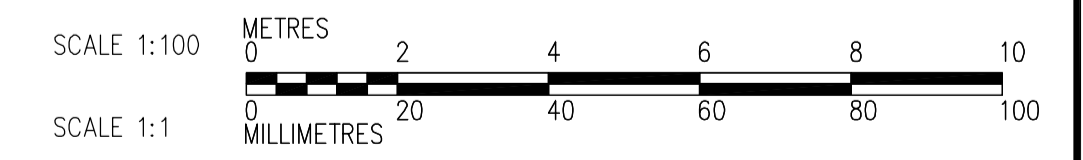


- NOTES:**
- SEE MCC #2A & #2B SINGLE LINE DIAGRAM AND DP-C11 & DP-C12 POWER DISTRIBUTION FOR 600V POWER DISTRIBUTION.
 - SEE LP-C11 FOR 120/208V POWER DISTRIBUTION.
 - PROVIDE STAIRWELL SMOKE DETECTORS AT EVERY THIRD FLOOR AND AT TOP.

CABLE TRAY TAGGING
SEE DETAIL

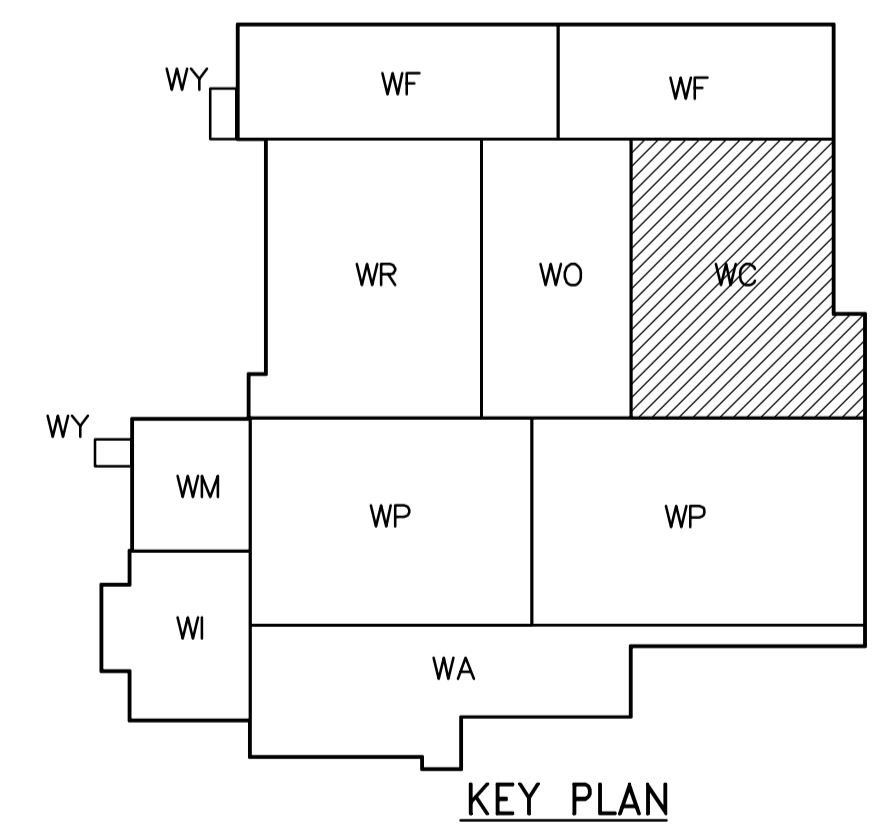

FIRST FLOOR FACILITY PLAN
1:100

<p>APEGN Certificate of Authorization CH2M HILL Canada Ltd. No. 1441 Expiry: April 30, 2006</p>	B.M. ELEV.	<p>Frederickson Cooper ARCHITECTS</p>	<p>EarthTech A Tyco International Ltd. Company</p>	ENGINEER'S SEAL	<p>THE CITY OF WINNIPEG WATER AND WASTE DEPARTMENT ENGINEERING DIVISION</p>	
	DESIGNED BY JT			CHECKED BY ND		ORIGINAL SIGNED BY L.D. LLEWELLYN
	DRAWN BY KJ			APPROVED BY AHL		2006/03/29
00 ISSUED FOR TENDER 06/03/29 LL	DATE BY DATE 2005/07/08	DATE 2006/03/29	RELEASED FOR CONSTRUCTION BY: R. SOROKOWSKI	CONSULTANT DRAWING NO. WC-E0111	<p>WATER TREATMENT PLANT CHEMICAL FEED SYSTEMS MECHANICAL AND ELECTRICAL</p> <p>ELECTRICAL CHEMICAL AREA FIRST FLOOR FACILITY PLAN</p>	
CITY FILE NUMBER		SHEET OF		CITY DRAWING NUMBER 1-0601C-A-E0111-001-000		