



- NOTES:**
1. PROVIDE STAIRWELL SMOKE DETECTORS AT EVERY THIRD FLOOR AND AT TOP.
  2. FOR CABLE TRAY TAGGING SEE DET. 3 WB-E0455

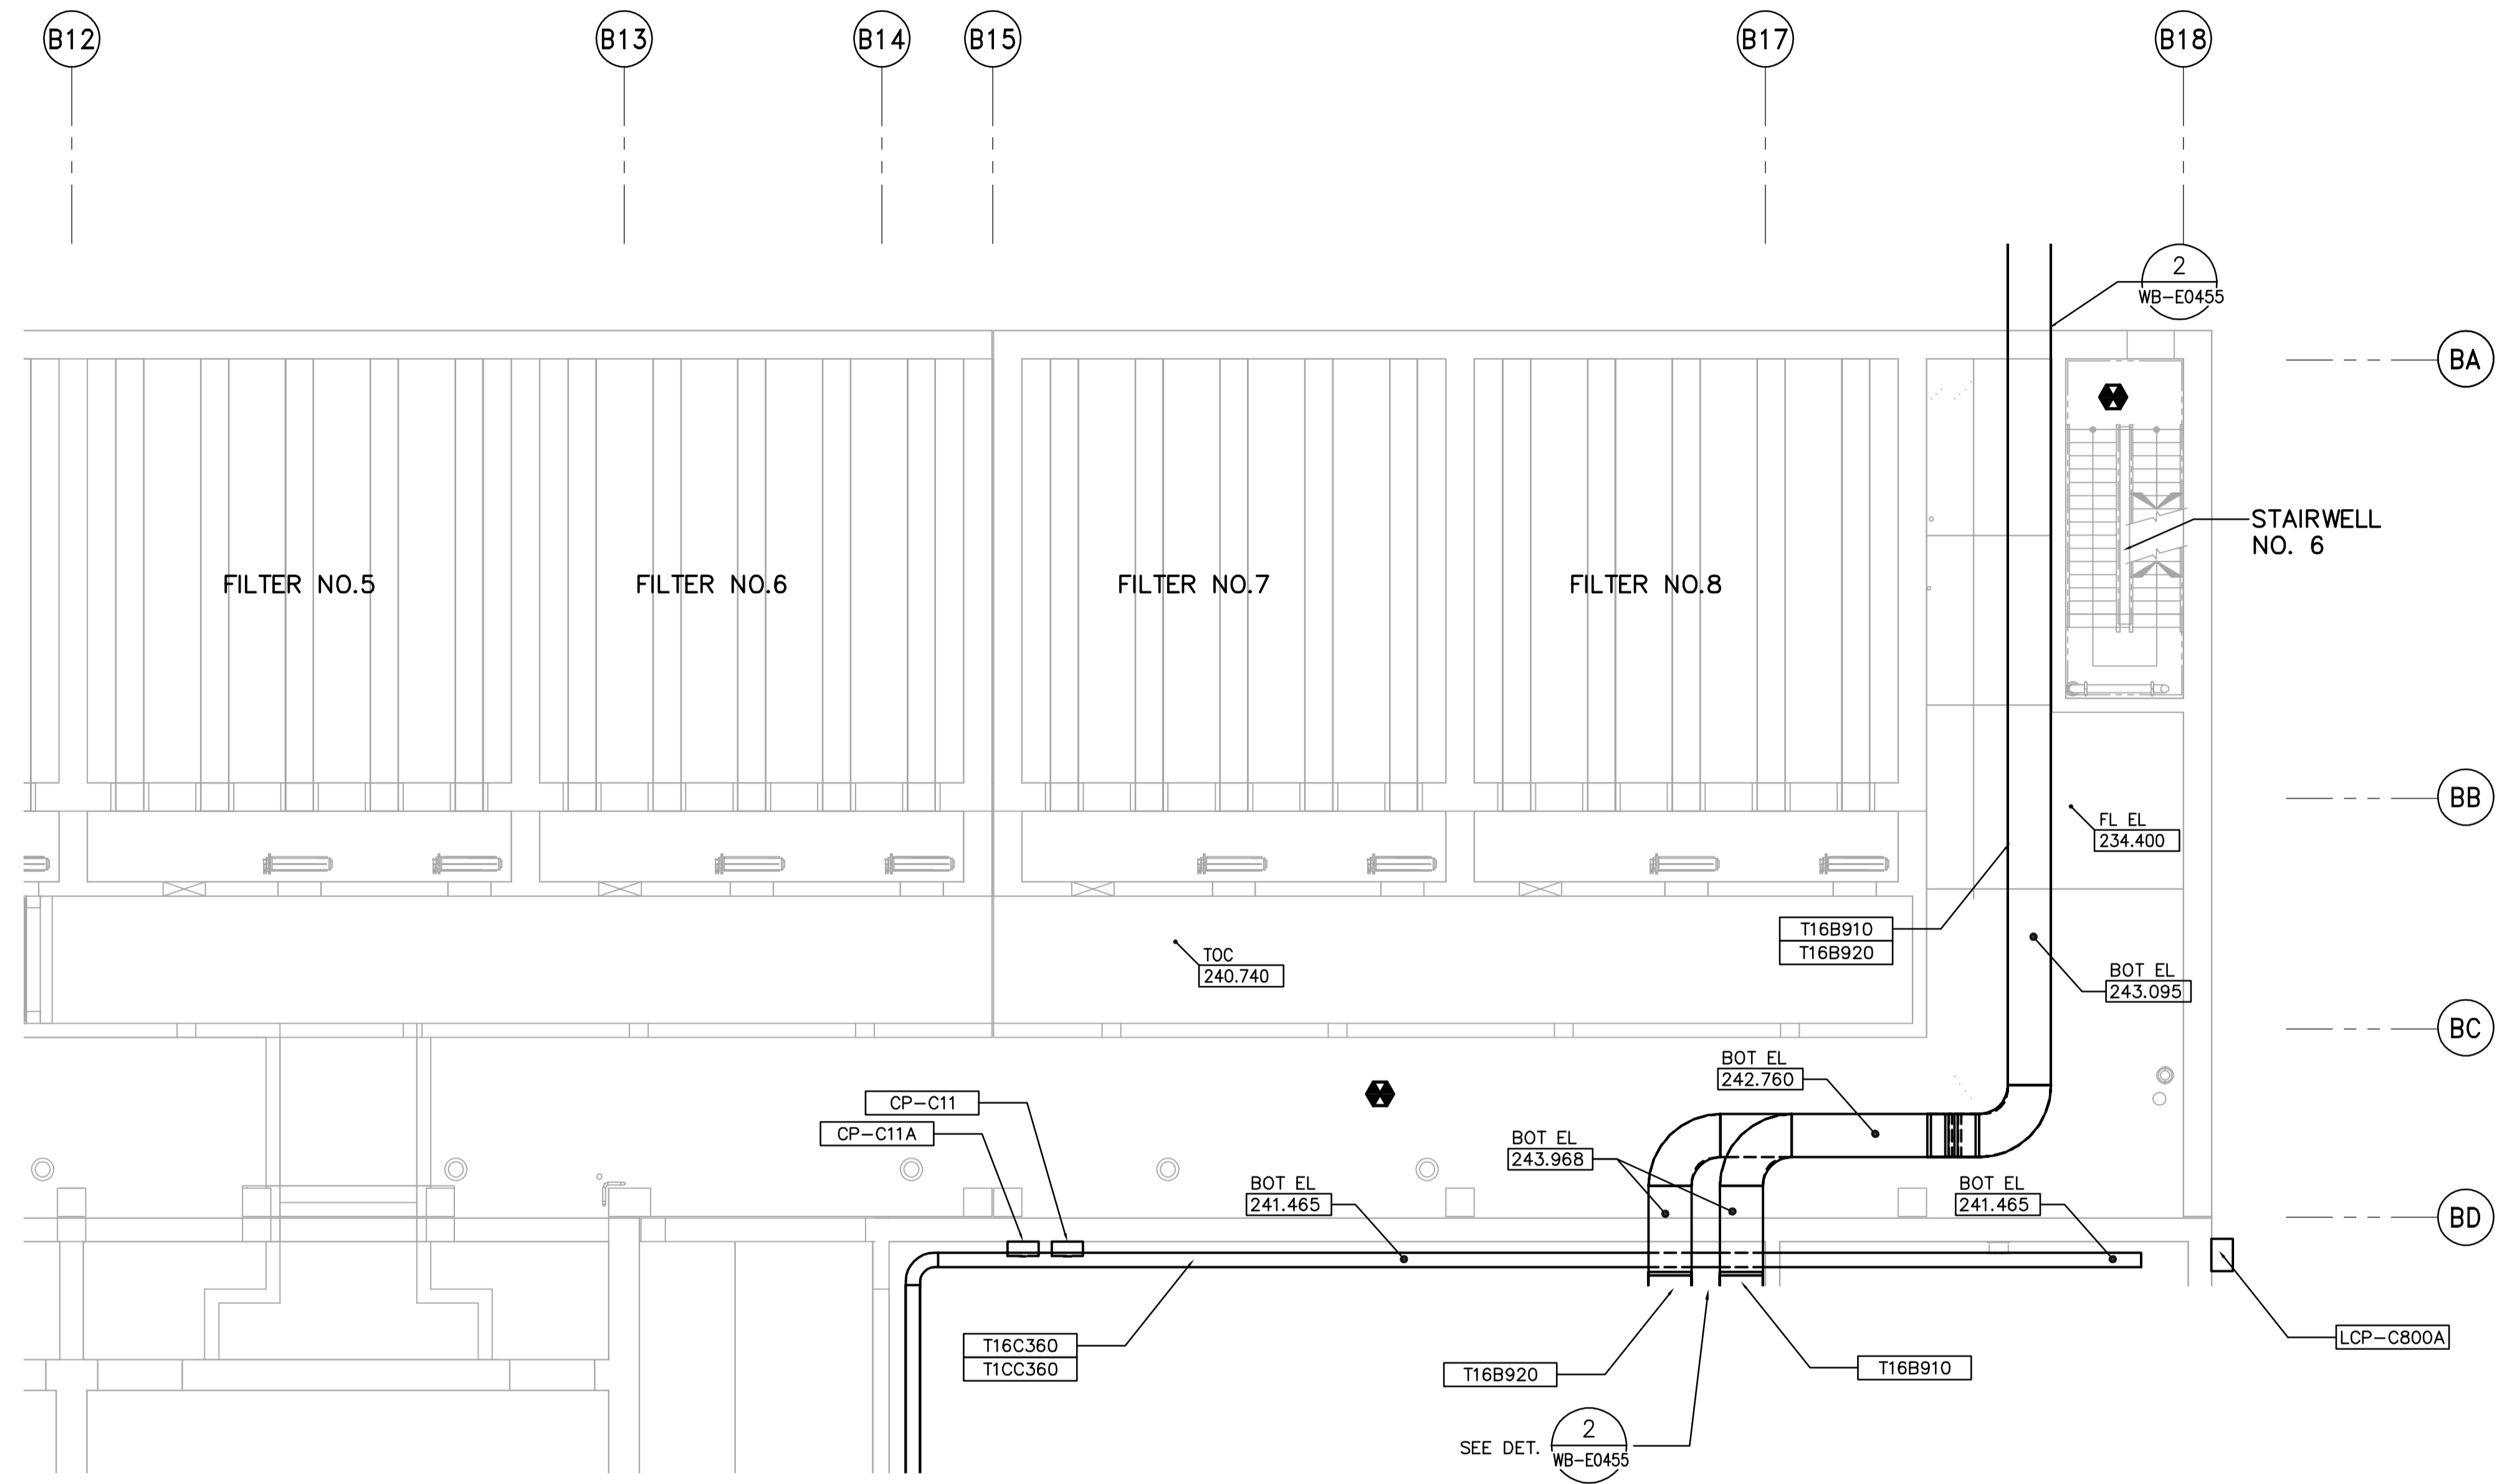

**UPPER CHANNEL PLAN 2**  
1:100

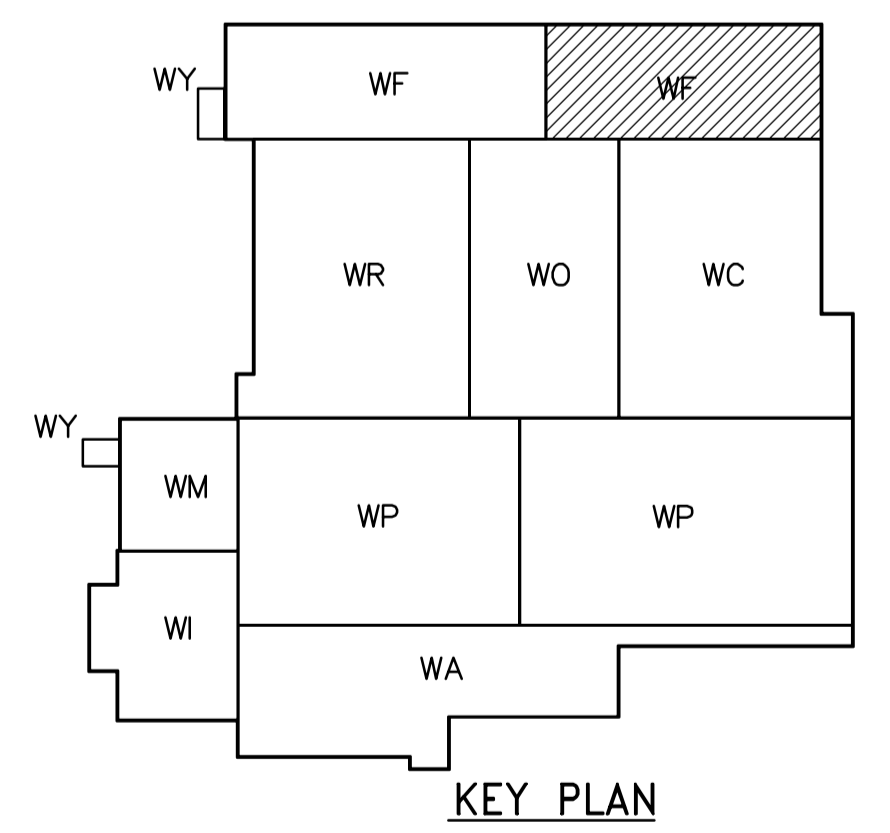

|  |   |  |  |   |
|--|---|--|--|---|
| <br><b>APEGN</b><br>Certificate of Authorization<br>CH2M HILL Canada Ltd.<br>No. 1441 Expiry: April 30, 2006 | <br>Frederickson Cooper<br>ARCHITECTS                                 | <br>A Tyco International Ltd. Company                          | ENGINEER'S SEAL<br><br>ORIGINAL<br>SIGNED BY<br>L.D. LLEWELLYN<br>2006/03/29 | <br><b>THE CITY OF WINNIPEG</b><br>WATER AND WASTE DEPARTMENT<br>ENGINEERING DIVISION<br><br>WATER TREATMENT PLANT<br>FILTRATION<br>MECHANICAL AND ELECTRICAL |
|  | DESIGNED BY: LL<br>CHECKED BY: ND<br>DRAWN BY: TL<br>APPROVED BY: AHL | SCALE: 1:100<br>RELEASED FOR CONSTRUCTION BY:<br>R. SOROKOWSKI | CONSULTANT DRAWING NO.<br>WF-E0122   | CITY FILE NUMBER<br>SHEET OF  |
|  | NO. REVISIONS<br>DATE BY  | DATE BY<br>2005/07/08  | DATE BY<br>2006/03/29  | CITY DRAWING NUMBER<br>1-0601F-A-E0122-001-000  |
|  | 00 ISSUED FOR TENDER<br>06/03/29 LL                                   |  |  | ELECTRICAL<br>FILTRATION AREA 2<br>UPPER CHANNEL FACILITY PLAN  |