



- NOTES:**
1. PROVIDE STAIRWELL SMOKE DETECTORS AT EVERY THIRD FLOOR AND AT TOP.
  2. SEE DRAWING WB-E0401 FOR CABLE TRAY MOUNTING DETAILS.
  3. ALL 120V LOADS ARE FED FROM LP-H31
  4. ALL 600V LOADS ARE FED FROM DP-H31
  5. FOR CABLE TRAY TAGGING SEE DET. 3  
WB-E0455

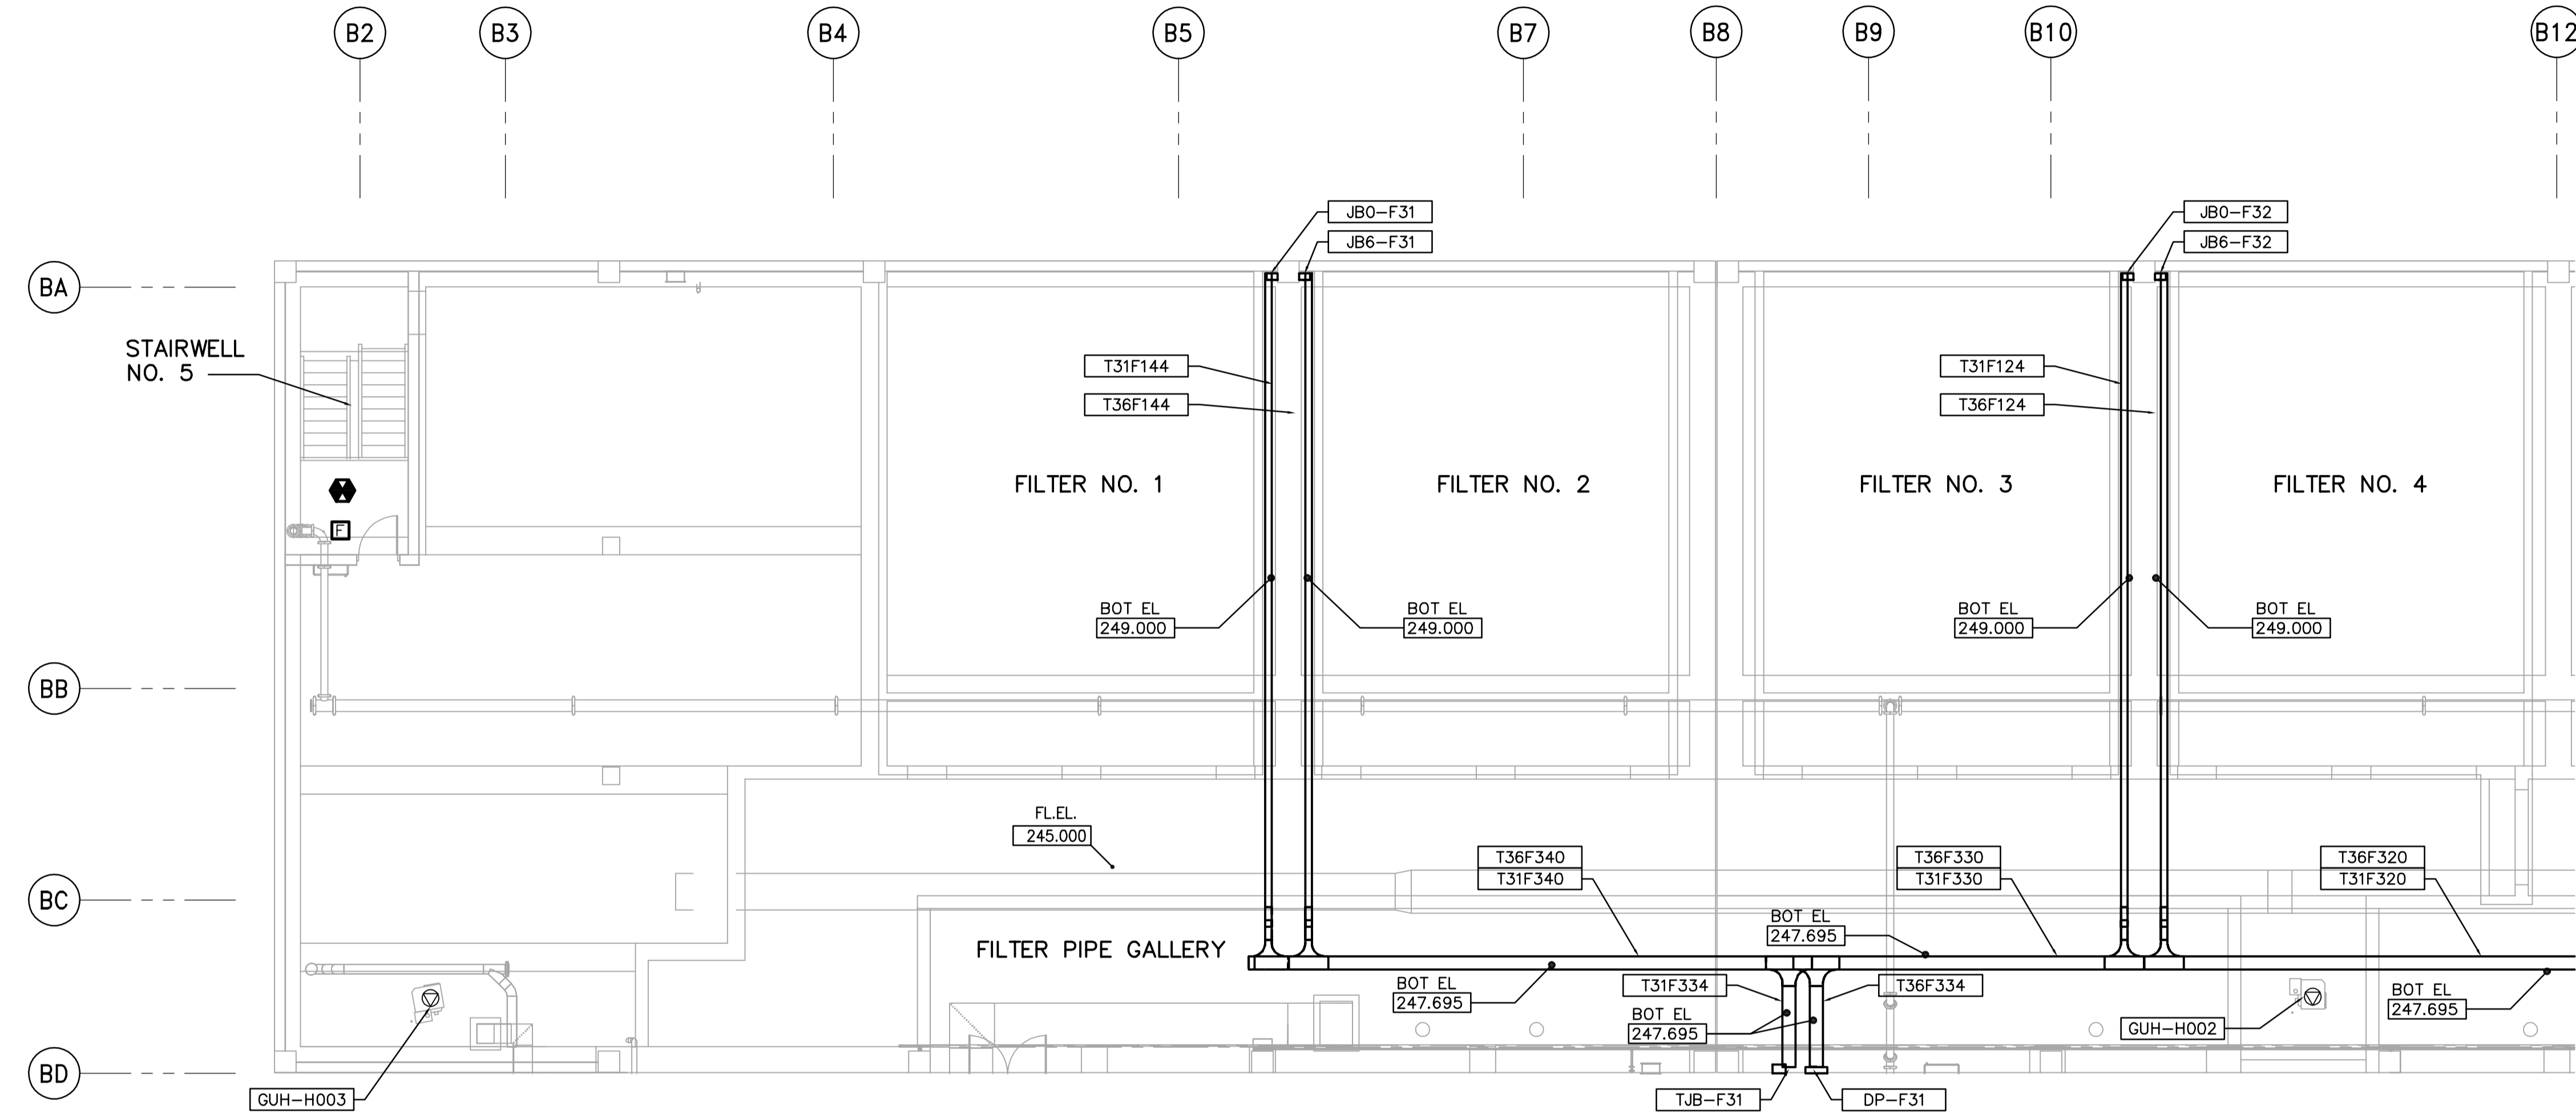

**THIRD FLOOR FACILITY PLAN (AREA 1)**  
1:100

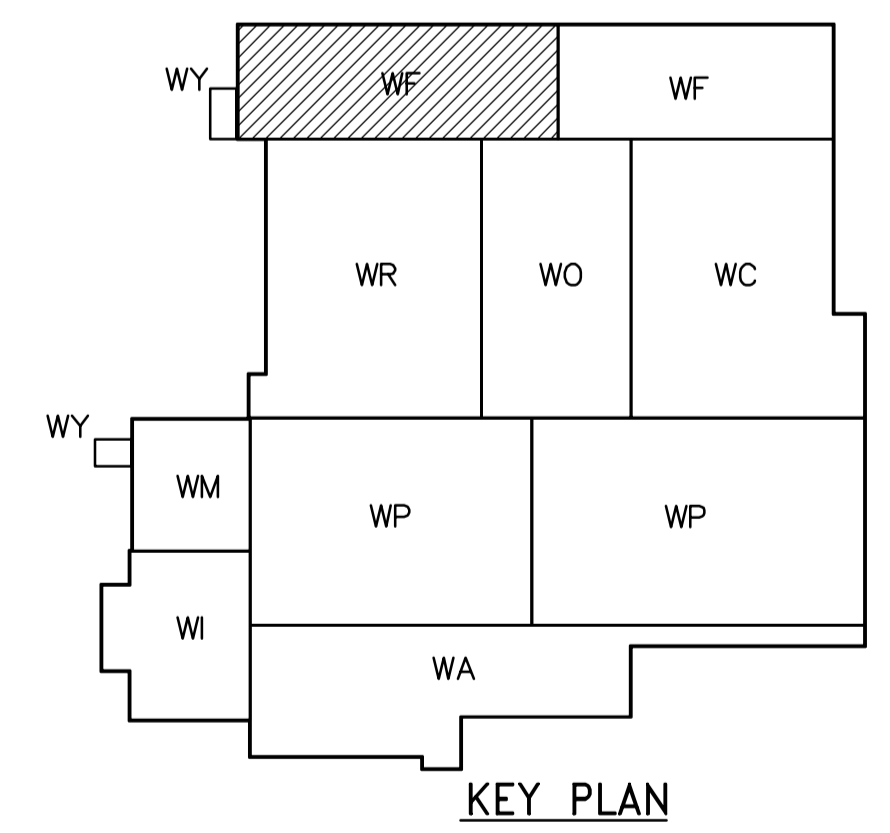

 <b>APEGN</b> Certificate of Authorization CH2M HILL Canada Ltd. No. 1441 Expiry: April 30, 2006	 Frederickson Cooper ARCHITECTS	 A You International Ltd. Company	ENGINEER'S SEAL  ORIGINAL SIGNED BY L.D. LLEWELLYN 2006/03/29	 <b>THE CITY OF WINNIPEG</b> WATER AND WASTE DEPARTMENT ENGINEERING DIVISION  WATER TREATMENT PLANT FILTRATION MECHANICAL AND ELECTRICAL  ELECTRICAL FILTRATION AREA 1 THIRD FLOOR FACILITY PLAN	CITY FILE NUMBER SHEET OF CITY DRAWING NUMBER 1-0601F-A-E0131-001-000
	DESIGNED BY: LL CHECKED BY: ND DRAWN BY: TL APPROVED BY: AHL SCALE: 1:100 RELEASED FOR CONSTRUCTION BY: R. SOROKOWSKI	CONSULTANT DRAWING NO. WF-E0131			
	B.M. ELEV. NO. REVISIONS DATE BY	00 ISSUED FOR TENDER 06/03/29 LL 2005/07/13 2006/03/29			