
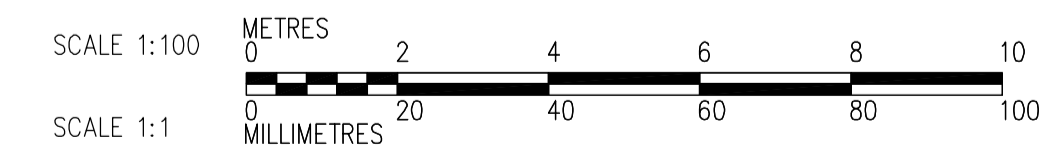


THIRD FLOOR FACILITY PLAN
1:100

- NOTES:
1. PROVIDE STAIRWELL SMOKE DETECTORS AT EVERY THIRD FLOOR AND AT TOP.
 2. SEE DRAWING WB-E0401 FOR CABLE TRAY MOUNTING DETAIL.

FOR CABLE TRAY TAGGING SEE DETAIL 3
WB-E0455

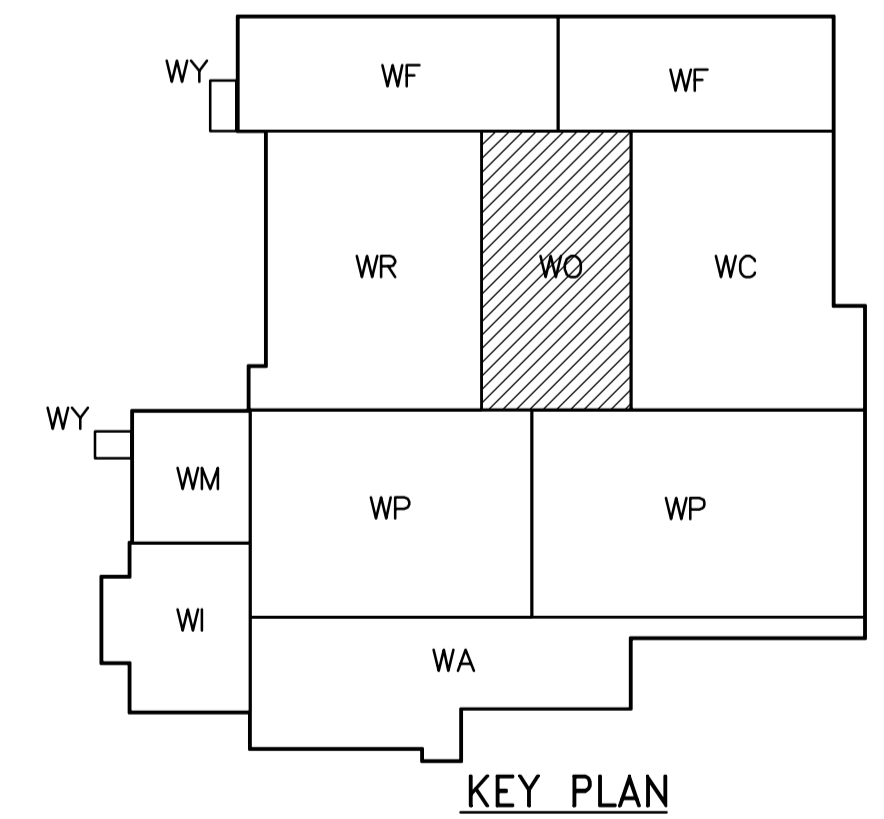

 Certificate of Authorization CH2M HILL Canada Ltd. No. 1441 Expiry: April 30, 2006	B.M. ELEV.	 Frederickson Cooper ARCHITECTS	 A Tyco International Ltd. Company	ENGINEER'S SEAL ORIGINAL SIGNED BY L.D. LLEWELLYN 2006/03/29	 THE CITY OF WINNIPEG WATER AND WASTE DEPARTMENT ENGINEERING DIVISION
	DESIGNED BY LL CHECKED BY ND	DRAWN BY TL APPROVED BY AHL	WATER TREATMENT PLANT OZONE MECHANICAL AND ELECTRICAL		CITY FILE NUMBER SHEET OF
	SCALE: 1:100 RELEASED FOR CONSTRUCTION BY: R. SOROKOWSKI	DATE 2005/07/13 DATE 2006/03/29	ELECTRICAL OZONATION AREA THIRD FLOOR FACILITY PLAN		CITY DRAWING NUMBER 1-06010-A-E0131-001-000
	00 ISSUED FOR TENDER 06/03/29 LL NO. REVISIONS DATE BY	DATE 2005/07/13 DATE 2006/03/29	CONSULTANT DRAWING NO. WO-E0131		