SHEET: COW-A1 (05/2005)

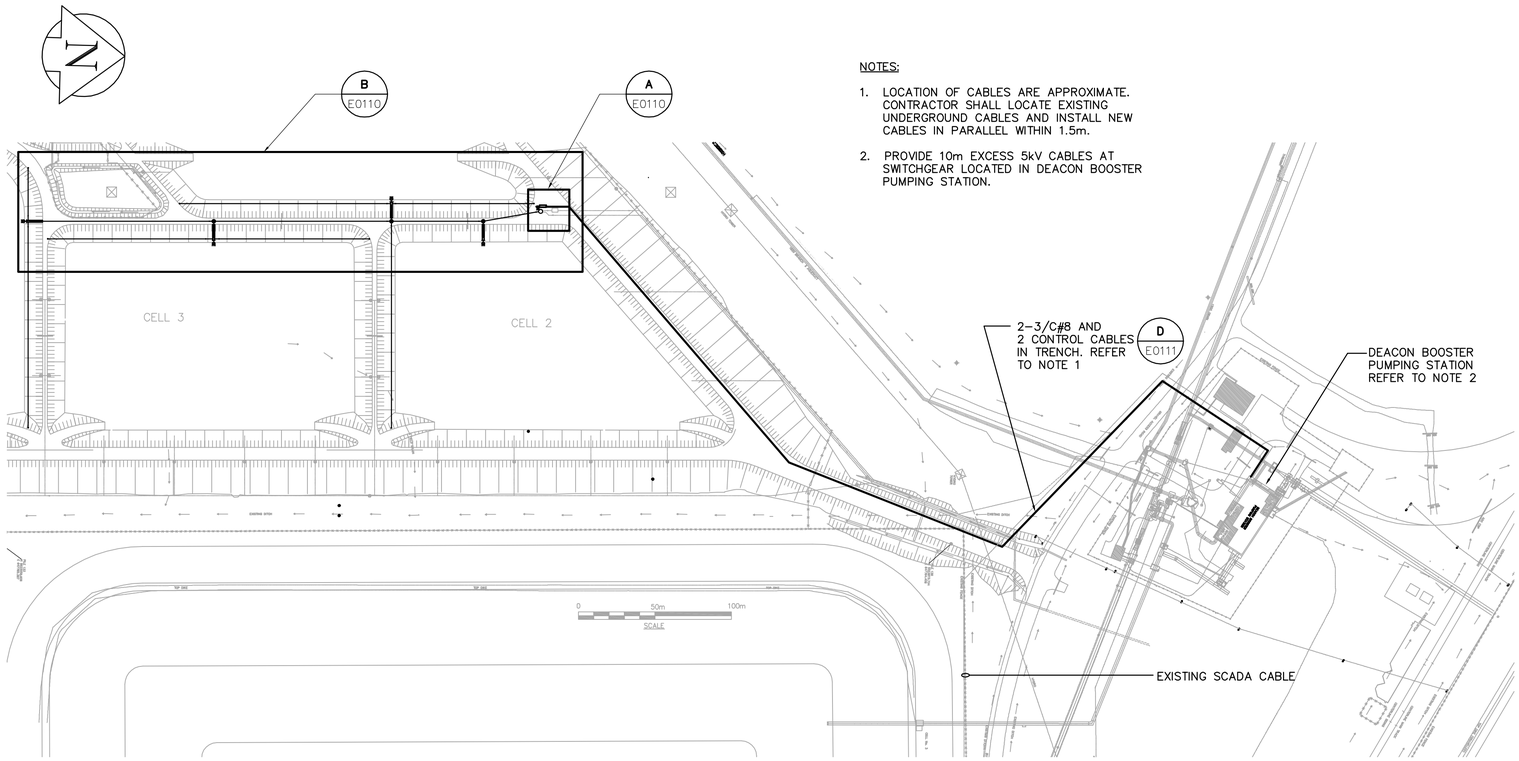

NOTES:

1. LOCATION OF CABLES ARE APPROXIMATE. CONTRACTOR SHALL LOCATE EXISTING UNDERGROUND CABLES AND INSTALL NEW CABLES IN PARALLEL WITHIN 1.5m.
2. PROVIDE 10m EXCESS 5kV CABLES AT SWITCHGEAR LOCATED IN DEACON BOOSTER PUMPING STATION.

PARTIAL SITE PLAN
1 : 2000

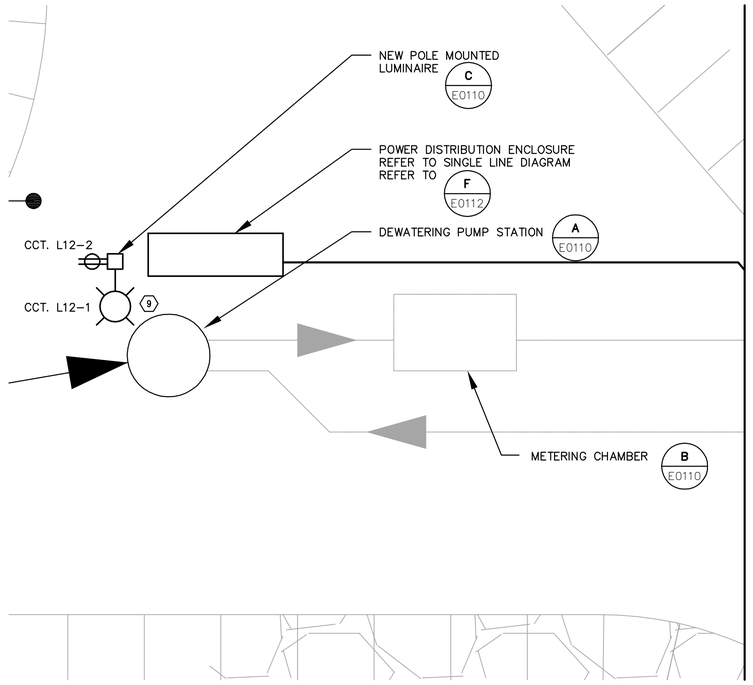

A DETAIL
1 : 100

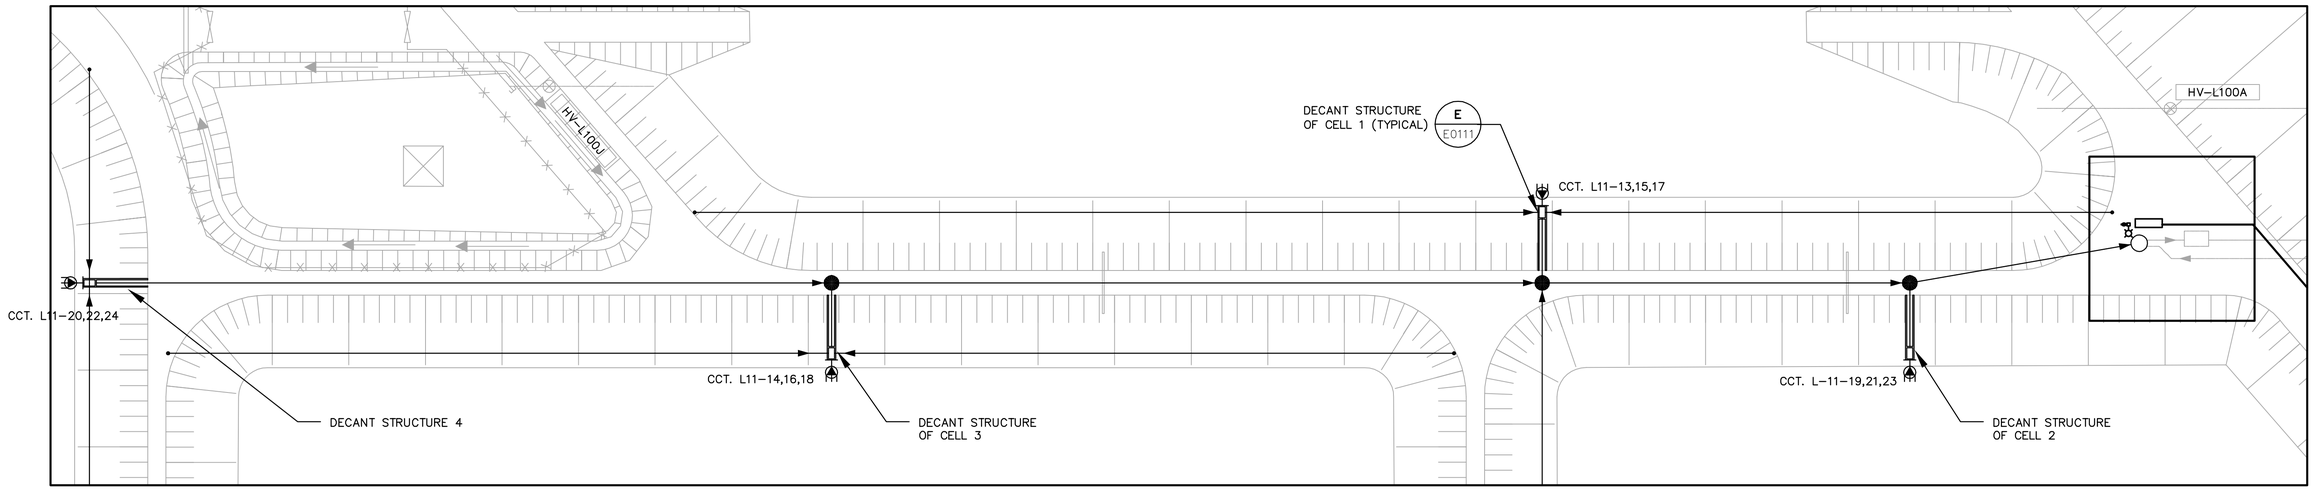

B DETAIL
1 : 500

APEGM
Certificate of Authorization
Earth Tech Canada Inc.
No. 730 Expiry: April 30, 2006

B.M.
ELEV.

NO.	REVISIONS	DATE	BY
00	ISSUED FOR TENDER	06/03/07	ERC

CH2MHILL
Fredericksson Cooper
ARCHITECTS

EarthTech
A Tyco International Ltd. Company

DESIGNED BY	BLM	CHECKED BY	PS
DRAWN BY	ERC	APPROVED BY	
SCALE:	AS SHOWN	RELEASED FOR CONSTRUCTION BY:	
DATE	2006/01/03	DATE	

ENGINEER'S SEAL
PROVINCE OF MANITOBA
BL MOORE
REGISTERED PROFESSIONAL ENGINEER

CONSULTANT DRAWING NO.
WL-E0110

Winnipeg

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT
ENGINEERING DIVISION

WATER TREATMENT PLANT
CONSTRUCTION OF DEWATERING CELLS

CITY FILE NUMBER

SHEET OF

ELECTRICAL
DECANT SYSTEMS
PLANS AND DETAILS

CITY DRAWING NUMBER
1-0601L-A-E0110-001-00D

Last Save: 2006-03-17 4:21 PM

L:\WORK\79000\79538\02A-CAD\ELE\CONTR\DN_WL-E0110_ET.DWG