
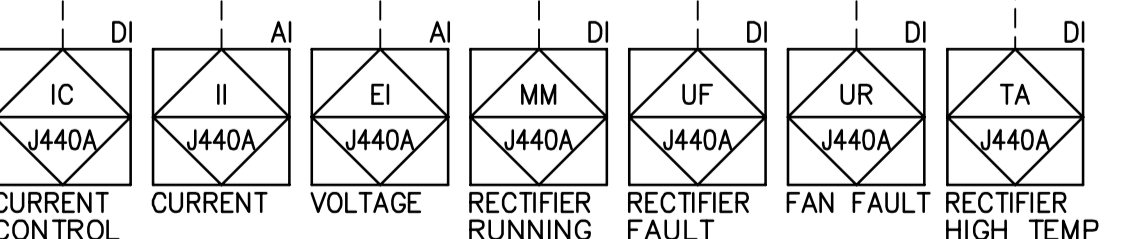
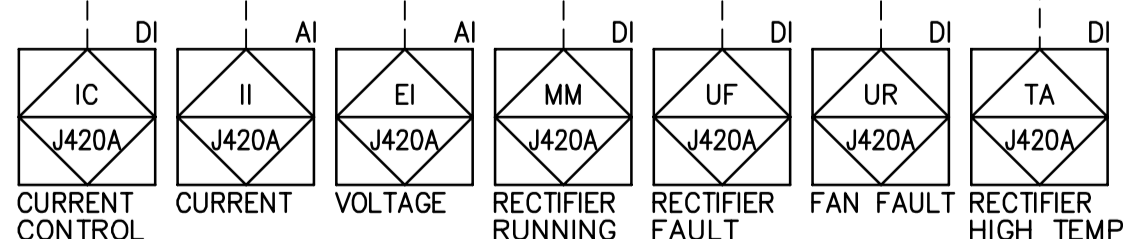


- NOTES:**
1. AN OPTIONAL HEAT EXCHANGER LOCATED ON THE ELECTROLYTIC CELL MAY BE USED TO PRE-HEAT PLANT SERVICE WATER.
  2. OPTIONAL HYDROGEN DILUTION BLOWERS MAY BE LOCATED ON ELECTROLYTIC CELL DISCHARGE.

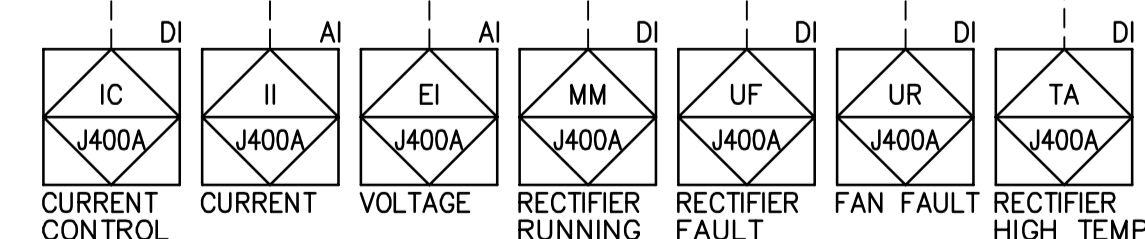

B.M. ELEV.				<b>THE CITY OF WINNIPEG</b> WATER AND WASTE DEPARTMENT ENGINEERING DIVISION	
DESIGNED BY: KS DRAWN BY: YFS SCALE: NONE 0 ISSUED FOR TENDER (49-2006) 06/03/14 JBC NO. REVISIONS DATE BY DATE 2005/05/31		CHECKED BY: APPROVED BY: RELEASED FOR CONSTRUCTION BY:		ENGINEER'S SEAL <b>PRELIMINARY</b> NOT FOR CONSTRUCTION CONSULTANT DRAWING NO. WJ-P0003	
WATER TREATMENT PLANT HYPOCHLORITE GENERATION AND FEED BUILDING SODIUM HYPO CHLORITE EQUIPMENT SUPPLY PROCESS & INSTRUMENTATION DIAGRAM ELECTROLYTIC CELLS 1 TO 3 SODIUM HYPOCHLORITE ONSITE GENERATION				CITY FILE NUMBER SHEET OF CITY DRAWING NUMBER 1-0601J-G-P0003-001-000	