


KEY NOTES

- 1 "B" VENT TO ROOF. SEE M2.2 FOR DETAILS. TYPICAL 3 LOCATIONS.
- 2 INSTALL HEATERS AS HIGH AS POSSIBLE WHILE MAINTAINING MANUFACTURER'S CLEARANCES TO THE LOWEST POINT OF THE CEILING.
- 3 FU-1 TO BE RELOCATED FROM ORIGINAL LOCATION. MODIFY DUCTWORK AS REQUIRED TO ACCOMMODATE NEW ARRANGEMENT.
- 4 FU-1 COMBUSTION VENTING UP TO ROOFTOP TERMINATION (NEW). TIE IN VENT FROM HOT WATER TANK.
- 5 SUPPLY AND RETURN DUCTING TO RISE TO HIGH LEVEL AND RUN ABOVE GWB CEILING.
- 6 CONNECT HRV TEMPERED SUPPLY AIR DUCT TO FU-1 RETURN AIR AT HIGH LEVEL.
- 7 CONNECT 20x8 O/A INTAKE AND EXHAUST TO HRV. FLEX CONNECTIONS REQUIRED AT ALL HRV CONNECTIONS.
- 8 CONTROL HRV-1 BY 7-DAY 24 HR TIMER. IN NON-HEATING SEASONS DISABLE HRV SUPPLY AIR FAN TO RUN UNIT AS EXHAUST-ONLY.
- 9 DIV. 15 TO PROVIDE ACCESS HATCHES FOR BALANCE DAMPERS. TYPICAL ALL LOCATIONS IN GWB CEILINGS.
- 10 6" Ø COMBUSTION AIR SUPPLY. INSULATED DUCT CW COLD TRAP.
- 11 CONTROLS WIRING TO BE RUN IN CONDUIT TO CEILING LEVEL. LOCATE AS INDICATED ON ARCHITECTURAL DRAWINGS.

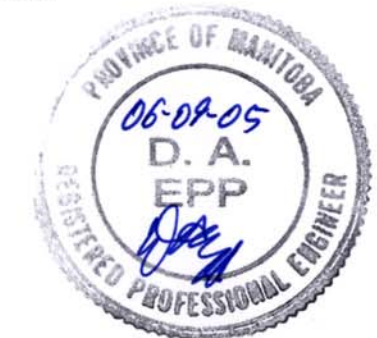

1 HVAC PLAN
M2.1 SCALE: 1/8" = 1'-0"

epp siepman engineering inc.
mechanical engineers
303-100 Osborne St. South p 204.453.1080
Winnipeg, MB f 204.453.1335
R3L 1Y5 ese@eppsiepman.com



Bid No:	499-2006
Date:	06-09-05
Revision:	FOR TENDER

Sheet No:	M2.1
This drawing is property of the Architect and cannot be reproduced or used without the consent of the Contract Administrator. The contractor is responsible for checking and verifying all levels and dimensions and shall report all discrepancies to the Contract Administrator and obtain clarification prior to commencing work.	