


WATER TREATMENT PLANT

CONTROL ROOM
(BULK CHEMICAL BLDG)

ELECTRICAL ROOM
(BULK CHEMICAL BLDG)

FIELD

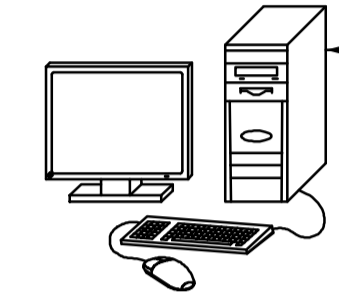



OPERATOR WORKSTATION
-DEDICATED PC-BMS
-MONITOR BULK CHEMICAL &
HYPOCHLORITE BLDGS.

LCP-S11A
SITE SCADA

LCP-S11
HARDWARE
POWER FAILURE
SIGNAL
YYH080A

CHEMICAL BUILDING
BAS CONTROLLER

WTP
BAS SYSTEM

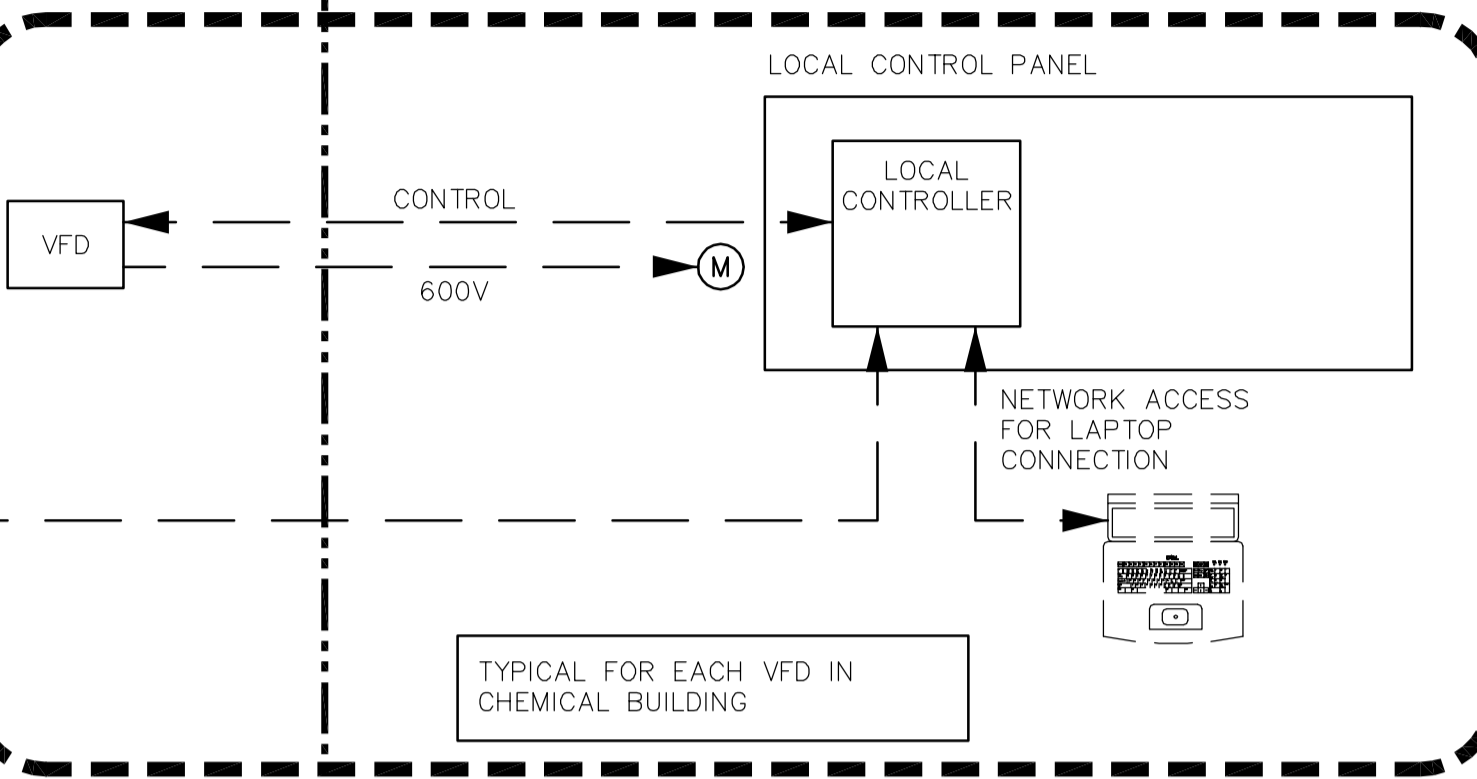



ELECTRICAL ROOM
(HYPOCHLORITE BLDG)

FIELD

CP-J12
SITE SCADA

CP-J12
HARDWARE
POWER FAILURE
SIGNAL
YYH080A

SODIUM HYPOCHLORITE
BUILDING
BAS CONTROLLER

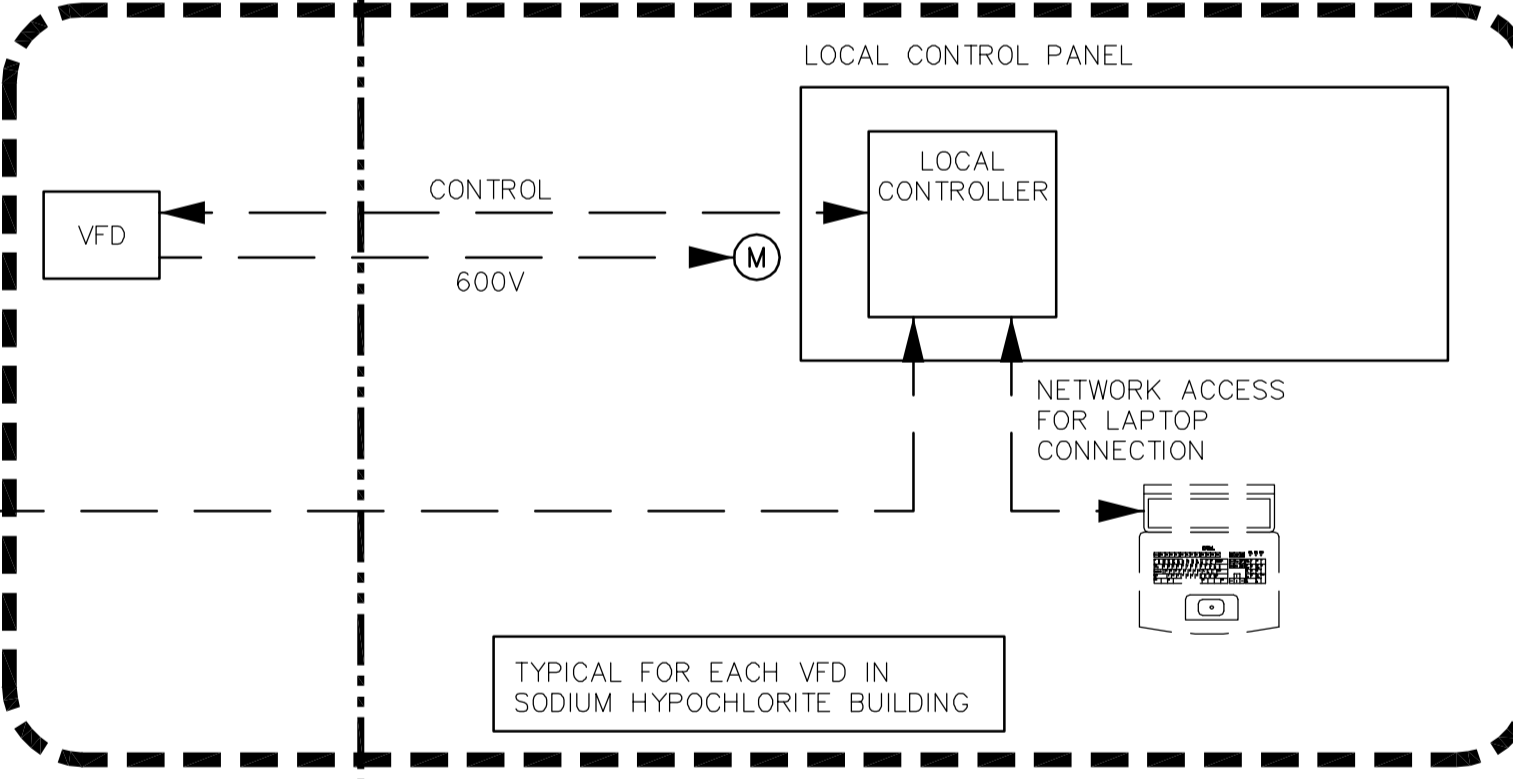

APECA
Certificate of Authorization
Earth Tech Canada Inc.
No. 730 Expiry: April 30, 2007

B.M. ELEV.			
DESIGNED BY	GD	CHECKED BY	PVL/AMA
DRAWN BY	DL	APPROVED BY	AHL
SCALE:	N.T.S.	RELEASED FOR CONSTRUCTION BY:	R. SOROKOWSKI
NO. REVISIONS		DATE	2007/01/26
		DATE	2007/03/20

CH2M HILL
Frederickson Cooper
ARCHITECTS

EarthTech
A Tyco International Ltd. Company

ENGINEER'S SEAL
ORIGINAL SIGNED BY
A. M. AFTANAS
2007/03/20

CONSULTANT DRAWING NO.
WS-H0522

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT
ENGINEERING DIVISION

Winnipeg

WATER TREATMENT PLANT
BULK CHEMICAL BUILDING
SODIUM HYPOCHLORITE AND CHEMICAL STORAGE BUILDING

MECHANICAL
BAS ARCHITECTURE LAYOUT

CITY FILE NUMBER
SHEET OF
CITY DRAWING NUMBER
1-06018-G-H0522-001-00D