


**A LIGHTNING GROUND ELECTRODE DETAIL**

SCALE: NTS

**NOTE:**

- GROUND RODS SHALL BE INSTALLED OUTSIDE THE EXTENTS OF THE EXCAVATION SHORING.

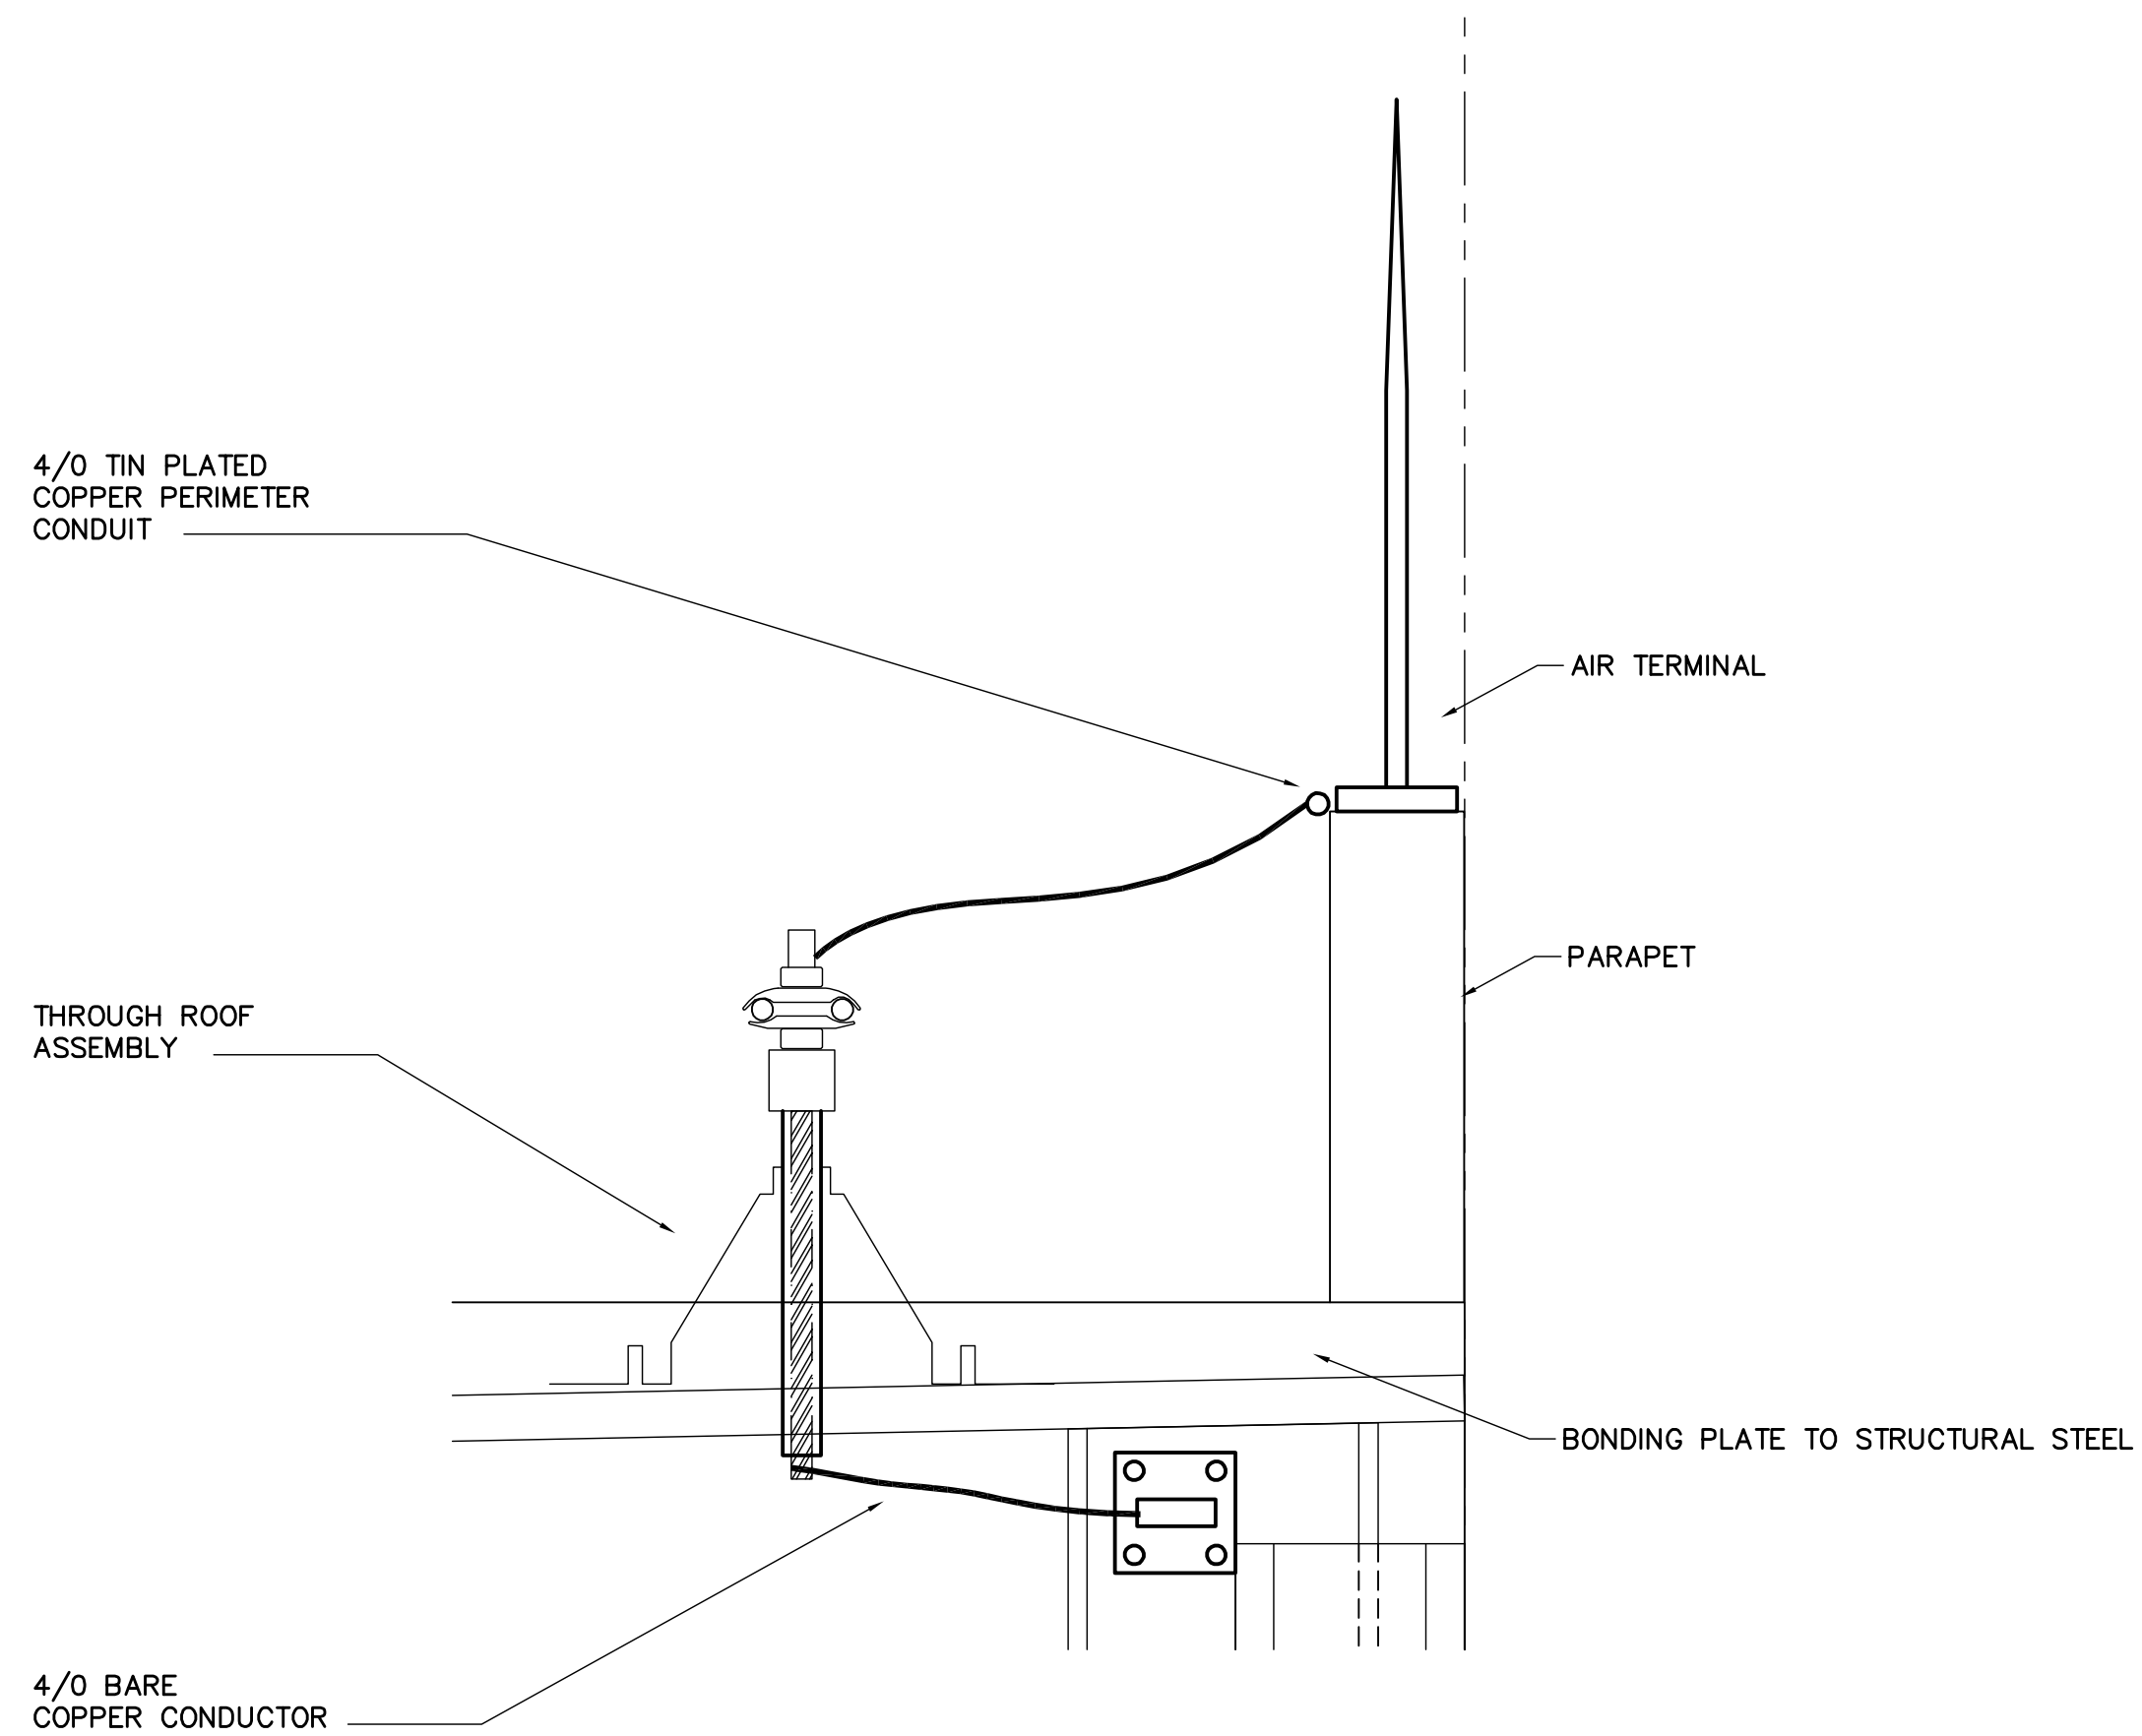

**7 LIGHTNING DETAIL**

N.T.S.

<p><b>APEGM</b> Certificate of Authorization Earth Tech Canada Inc. No. 730 Expiry: April 30, 2007</p>	B.M. ELEV.	<p>Frederickson Cooper ARCHITECTS</p>	<p>EarthTech A Tyco International Ltd. Company</p>	ENGINEER'S SEAL	<p><b>THE CITY OF WINNIPEG</b> WATER AND WASTE DEPARTMENT ENGINEERING DIVISION</p>		
				DESIGNED BY: BLM		CHECKED BY: ND	ORIGINAL SIGNED BY: P. STRYK
				DRAWN BY: ERC		APPROVED BY: AHL	2007/01/31
				SCALE: NTS		RELEASED FOR CONSTRUCTION BY: R. SOROKOWSKI	CONSULTANT DRAWING NO. WS-E0453
	00 ISSUED FOR TENDER 07/01/31 ERC	DATE 2006/10/10	DATE 2007/01/31		<p>WATER TREATMENT PLANT BULK CHEMICAL BUILDING SODIUM HYPOCHLORITE AND CHEMICAL STORAGE BUILDING</p> <p>ELECTRICAL STANDARD DETAILS</p>		
	NO. REVISIONS	DATE	BY		<p>CITY FILE NUMBER</p> <p>SHEET OF</p> <p>CITY DRAWING NUMBER 1-0601S-D-E0453-001-000</p>		