


1 - N.T.S. SULPHURIC ACID ROOM HEATING AND VENTILATION SCHEMATIC (MAU-H801A)

UY RELAY IN FIRE PANEL
 I HARDWIRED INTERLOCK
 TO SHUTDOWN ALL HVAC SYSTEMS IN EVENT OF FIRE ALARM

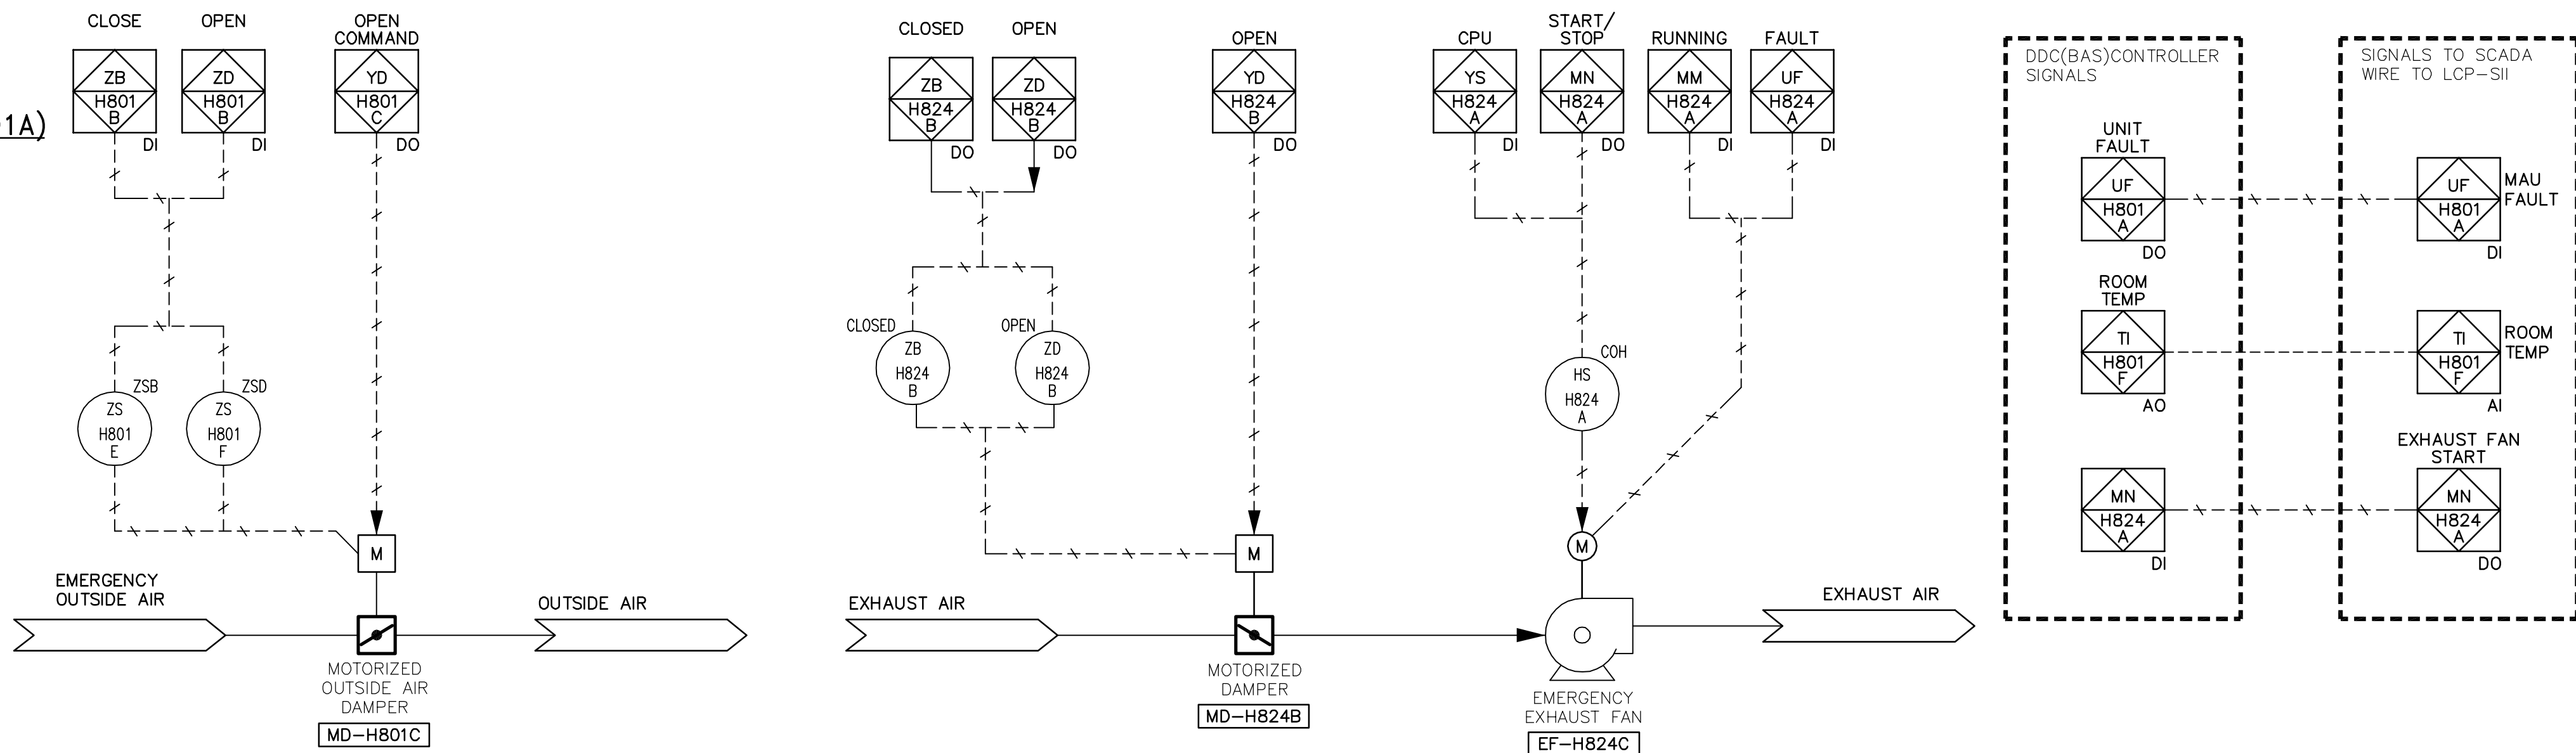

APECA
 Certificate of Authorization
 Earth Tech Canada Inc.
 No. 730 Expiry: April 30, 2007

B.M. ELEV.			
DESIGNED BY	PVL/LJW	CHECKED BY	PVL/AMA
DRAWN BY	LJW	APPROVED BY	AHL
SCALE:	N.T.S.	RELEASED FOR CONSTRUCTION BY:	R. SOROKOWSKI
DATE	2006/09/11	DATE	2007/01/31
NO. ISSUED FOR TENDER	07/01/31	DL	
NO. REVISIONS		DATE	

CH2M HILL
 Frederickson Cooper ARCHITECTS
EarthTech
 A Tyco International Ltd. Company
 DESIGNED BY PVL/LJW CHECKED BY PVL/AMA
 DRAWN BY LJW APPROVED BY AHL
 SCALE: N.T.S. RELEASED FOR CONSTRUCTION BY: R. SOROKOWSKI
 DATE 2006/09/11 DATE 2007/01/31

ENGINEER'S SEAL
 ORIGINAL SIGNED BY
 A. M. AFTANAS
 2007/01/31
 CONSULTANT DRAWING NO.
 WS-H0514

THE CITY OF WINNIPEG
 WATER AND WASTE DEPARTMENT
 ENGINEERING DIVISION
 WATER TREATMENT PLANT
 BULK CHEMICAL BUILDING
 SODIUM HYPOCHLORITE AND CHEMICAL STORAGE BUILDING
 MECHANICAL
 SULPHURIC ACID ROOM
 HEATING AND VENTILATION SYSTEM SCHEMATIC
 CITY FILE NUMBER
 SHEET OF
 CITY DRAWING NUMBER
1-06018-G-H0514-001-00D