SHEET: COW-A1 (05/2005)

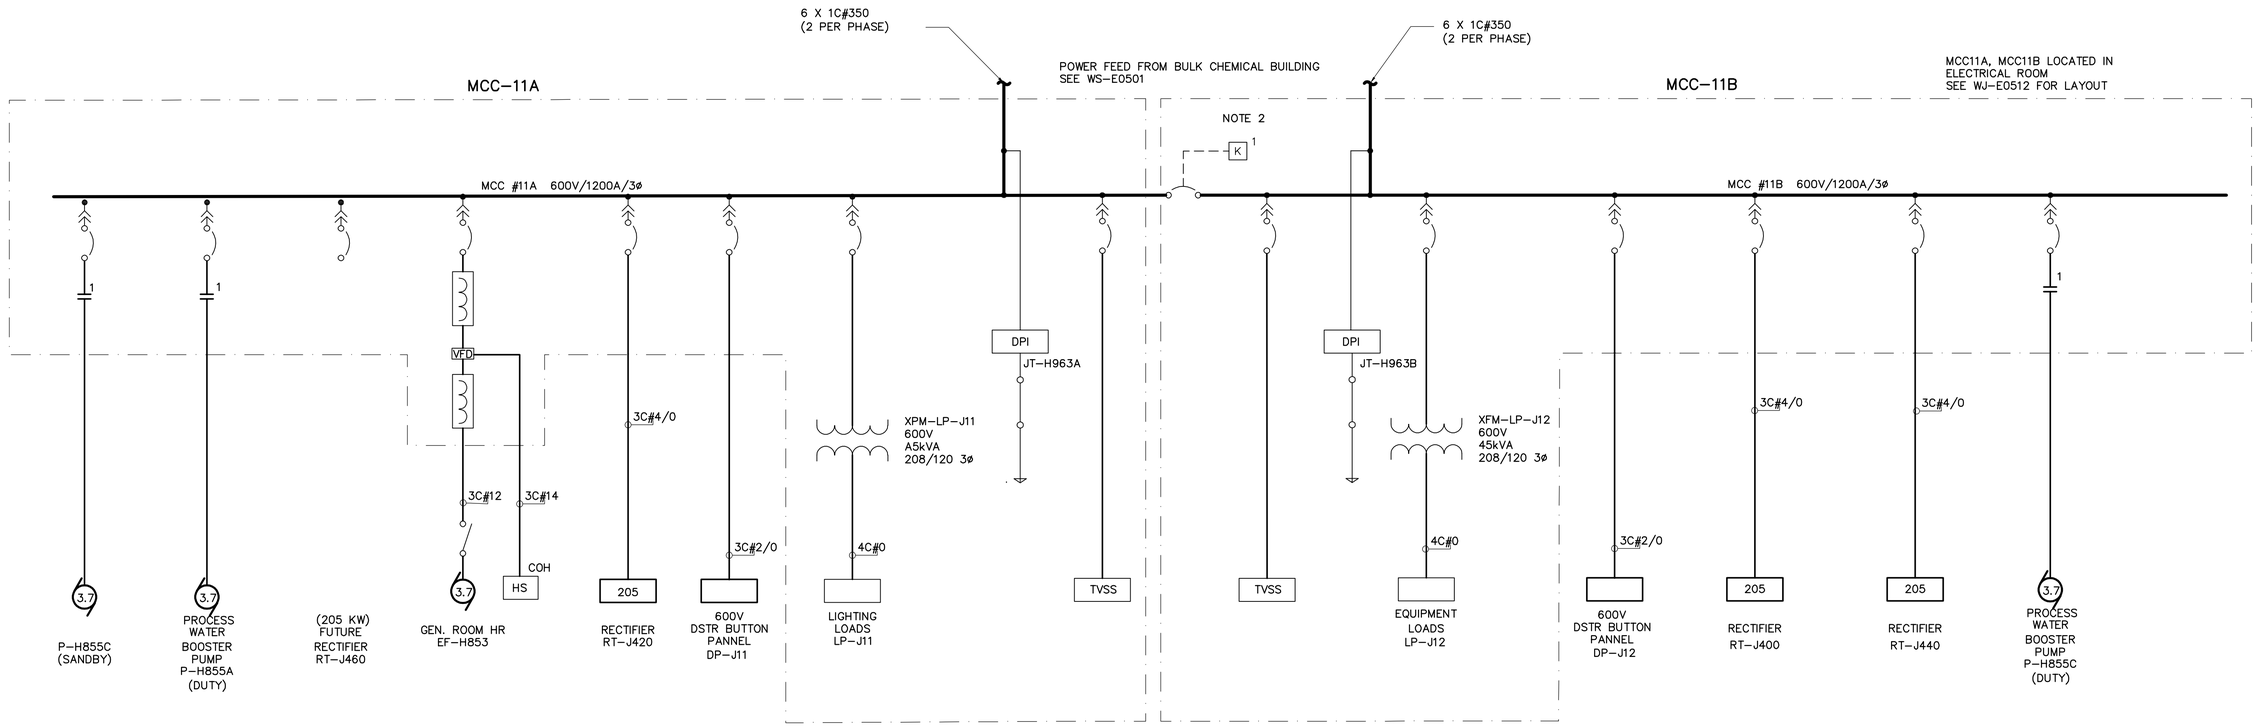

NOTES:

1. ALL POWER REQUIREMENTS ARE IN kW.
2. FOR KEY INTERLOCK SCHEME SEE WS-E0501
3. FOR MCC 11A, MCC11B ELEVATION SEE DRAWING WJ-E0512

* PART OF PACKAGE

APEGM
Certificate of Authorization
CH2M HILL Canada Ltd.
No. 1441 Expiry: April 30, 2007

B.M.
ELEV.

NO.	REVISIONS	DATE	BY
00	ISSUED FOR TENDER	07/01/31	LL

CH2MHILL
Fredericksen Cooper ARCHITECTS
EarthTech A Tyco International Ltd. Company

DESIGNED BY	LL	CHECKED BY	JRL
DRAWN BY	TL	APPROVED BY	AHL
SCALE:	NTS	RELEASED FOR CONSTRUCTION BY:	R. SOROKOWSKI
DATE	2006/08/29	DATE	2007/01/31

ENGINEER'S SEAL
ORIGINAL SIGNED BY
L.D. LLEWELLYN
2007/01/31

CONSULTANT DRAWING NO.
WJ-E0511

Winnipeg
THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT
ENGINEERING DIVISION

WATER TREATMENT PLANT
SODIUM HYPOCHLORITE BUILDING
SODIUM HYPOCHLORITE AND CHEMICAL STORAGE BUILDINGS

ELECTRICAL
SODIUM HYPOCHLORITE BUILDING
600V SINGLE LINE DIAGRAM

CITY FILE NUMBER
SHEET OF
CITY DRAWING NUMBER
1-0601J-F-E0511-001-00D

Last Save: 2007-01-29 9:13 AM

C:\DOCUMENTS AND SETTINGS\SEVERITT\MY DOCUMENTS\NDMPROJ\321352 - WINNIPEGWTP\DN_WJ-E0511_CH2M.DWG