
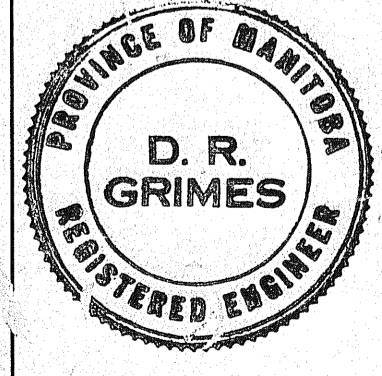


- GENERAL NOTES**
1. CAMBER AS FABRICATED TO BE 2 1/2" FOR 146'-4" TRUSS & 1 1/2" FOR 2-116'-4" TRUSSES.
  2. TRUSS MEMBER SIZES BASED ON 3/4" 15. BOLTS.
  3. MIN. THICKNESS OF
  4. TENSION - (NEGATIVE) IN KIPS. COMPRESSION + (POSITIVE) IN KIPS.
  5. USE A36 STRUCTURAL STEEL.
  6. SIDING TO BE CONTINUOUS ALL AROUND TRUSS & FLASHED TO PREVENT ENTRY OF OUTSIDE AIR OR MOISTURE.
  7. GREASE COLLECTING SYSTEM NOT SHOWN.

REVISIONS		
NO.	DATE	DETAIL

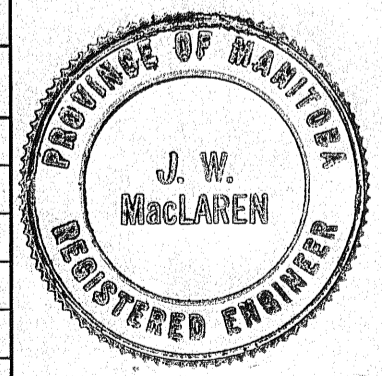

THE METROPOLITAN CORPORATION OF GREATER WINNIPEG  
WATERWORKS AND WASTE DISPOSAL DIVISION

**NORTH END SEWAGE TREATMENT PLANT**

**CONTRACT A - CLARIFIER CONTROL BUILDING - STRUCTURAL CLARIFIER BRIDGES**

APPROVED: *J. MacLaren*  
JAMES F. MACLAREN LIMITED ENGINEERS TORONTO

APPROVED: *W.L. Wardrop*  
W.L. WARDROP ASSOCIATES (MANAGEMENT) LIMITED ENGINEERING CONSULTANTS WINNIPEG

DATE: MARCH 11, 1963  
SCALE: AS SHOWN  
DWG. NO. OF: 66 OF 217  
NEP-86

FOR ACTUAL ELEV. SUBTRACT 2.21 FT.

AUG 1966  
S. PULLT

FILE # NR 10295