


- NOTES:**
- REFER TO SITE PLAN FOR CAMERAS MOUNTED ON EXTERIOR OF BUILDING.
 - LOCATE NEW DEVICES IN EXISTING SINGLE STALL ALONG WALL WITH DOOR (TYPICAL).
 - EXISTING WASHROOM AND STALL AREA HAS BEEN REMOUNTED. CIRCUITS SUPPLYING LIGHTS IN THIS AREA ARE UNKNOWN. INVESTIGATE CIRCUITS (SUSPECTED PANAL B IN SECOND FLOOR SOUTH MECHANICAL ROOM).
 - EXHAUST FAN DISCONNECT TO BE LOCKABLE 15A, 120V RATED CSA 1 DEVICE BOX. EXHAUST FAN TO BE CONTROLLED BY THE METASYS CONTROLLER. PROVIDE 15A, 120V RELAY IN CSA 1 ENCLOSURE IN CEILING SPACE ADJACENT TO EXHAUST FAN. PROVIDE 2 #12 AWG IN 21C FOR RELAY CONTROL FROM METASYS UNIT.
 - PROVIDE LUMINAIRE RECESSED IN CEILING OF SAUNA, RATED FOR LOCATION WITH 35W GU10, 120V DC EMERGENCY LIGHTING HEADS. CONNECT TO EMERGENCY LIGHTING SYSTEM

BATTERY BANK BB-PS (POOL SOUTH)


BATTERY BANK BB-LLG (LIBRARY LOBBY GYM)

BATTERY BANK BB-PN (POOL NORTH)

BATTERY BANK BB-LLG (LIBRARY LOBBY GYM)

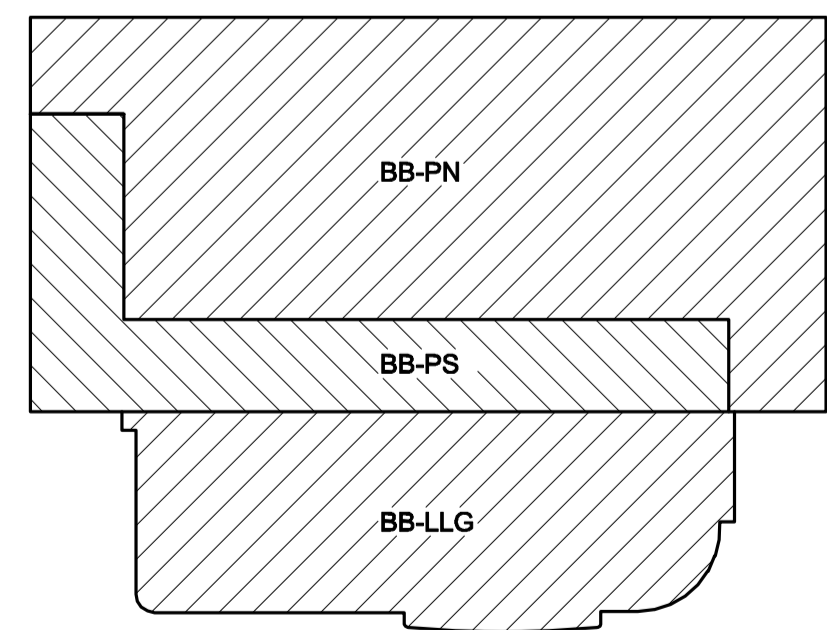

DETAIL
SCALE: N.T.S.
MAIN FLOOR AREA SERVED BY BATTERY BANKS

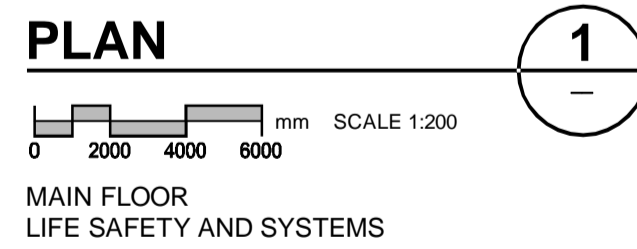

SECURITY MANAGEMENT SYSTEM (PEGASYS) ACCESS CONTROL LOCATION SCHEDULE								
DOOR NO.	DESCRIPTION	LOCATION		NOTES	DOOR NO.	DESCRIPTION	LOCATION	
		LEVEL	GRIDLINE				LEVEL	GRIDLINE
EXISTING DOOR LOCATIONS BEING MODIFIED								
DB01E	BASEMENT DOOR FROM MAINTENANCE	BASEMENT	EA,9,E3,4		D101A	MAIN ENTRANCE SLIDING DOUBLE DOOR	MAIN	A,7,8
D101E	CARPET BOWLING SOUTH	MAIN	EJ,2,E1		D101B	MAIN ENTRANCE, SOUTH OF SLIDING DOORS	MAIN	A,9,8
D103E	MAINTENANCE WEST	MAIN	EA, E1,1		D104A	SWINGING DOOR TO LIBRARY	MAIN	B,2,4
D104E	CHLORINE ROOM	MAIN	EA, E4,2		D117	NETWORK ROOM 114	MAIN	A,6,2
D105E	SOUTH EXIT	MAIN	EA, E5,6		D118	REC CENTER STAFF ROOM	MAIN	A,5, 6,7
D106E	EAST EXIT NORTH	MAIN	EA,7,E10		D209	JANITORS ROOM 209	SECOND	A,1,1,1
D107E	UNDER RAMP STORAGE	MAIN	EB,5, E9,1		D301	DOOR TO PENTHOUSE	PENTHSE	A,4,5,6
D108E	STAFF ROOM	MAIN	EJ,6,E9		D303	DOOR TO ROOF	PENTHSE	A,4,5,4 4
D109E	SOUTH STAIR TO BASEMENT/SECOND FLOOR MECHANICAL ROOM	MAIN	EJ,4,E6,8		D303	ROOF DOOR TO INSIDE	PENTHSE	A,5,5,4 5
D110E	SOUTH POOL EXIT	MAIN	EJ,E7		NOTES			
D111E	DATA ROOM 119	MAIN	EJ,8, E6,5		1.	ALL DOORS LISTED ABOVE REQUIRE FUNCTIONALITY AS SHOWN IN DETAIL 3/2.7 *TYPICAL SECURITY MANAGEMENT SYSTEM (PEGASYS) ACCESS CONTROL DOOR: INTERIOR AND EXTERIOR CARD READER, DOOR SENSOR, ELECTRIC STRIKE ETC.		
D112E	EAST EXIT SOUTH	MAIN	EJ,E10		2.	NOT DRAWN CORRECTLY ON FLOOR PLAN, GRID LOCATION IS CORRECT.		
D113E	EAST JANITORS ROOM	MAIN	EC,E9,6		3.	DELETE		
D114E	EAST POOL EXIT	MAIN	EB,5, E9		4.	NO MOTION SENSOR REQUIRED.		
D116E	S.W. JANITORS ROOM, EAST ENTRANCE	MAIN	EJ,2, E3,4		5.	CARD READER ONLY, PARALLEL WIRED TO D303 READER SCHEDULED ABOVE.		
D117E	S.W. JANITORS ROOM, WEST ENTRANCE	MAIN	EJ,2,E3,3					
D118E	SOUTH WEST POOL EXIT	MAIN	EJ,E2					
D119E	NORTH STAIR TO BASEMENT	MAIN	EA,2, E5,4	2.				
D210E	NORTH MECHANICAL ROOM	SECOND	EA,9, E4,4					

UMA | AECOM

© 2007 UMA ENGINEERING LTD. ALL RIGHTS RESERVED.

APEGM
Certificate of Authorization
UMA Engineering Ltd. (MB)
No. 256 Date: _____

DRN	CHK	DES	ENG	IDR

UMA | AECOM REVIEW

NO.	REVISION/DESCRIPTION	BY	DATE
2	ISSUED FOR ADDENDUM #4	QL	07/08/30
1	ISSUED FOR ADDENDUM #2	QL	07/08/21
0	ISSUED FOR TENDER	QL	07/07/23

SEALS

DRAWN BY: QL CHECKED BY: USER APPROVED

DATE: 2007.02.21

CITY OF WINNIPEG
PLANNING, PROPERTY & DEVELOPMENT DEPARTMENT
CIVIC ACCOMMODATIONS DIVISION
300 - 65 GARRY ST. R3C 4K4

PROJECT
Construction of Cindy Klassen
Recreation Complex Facility
Enhancement Project
999 Sargent St. Winnipeg, Manitoba

SHEET TITLE
Electrical
Main Floor
Life Safety and Systems

SCALE: 1:200 PROJECT NO.: 2005-059 SHEET NO.: E2.8

DRAWING SHEET SIZE: A1 (841mm x 594mm) PLOT 1:1