


B SIZE - 279mm x 432mm

INSTRUMENT LOOP DIAGRAM

LOOP NO. IEZ-911-EM IEZ-911-QF
IEZ-911-JAL IEZ-911-YS

FIELD

PLC 28 PANEL

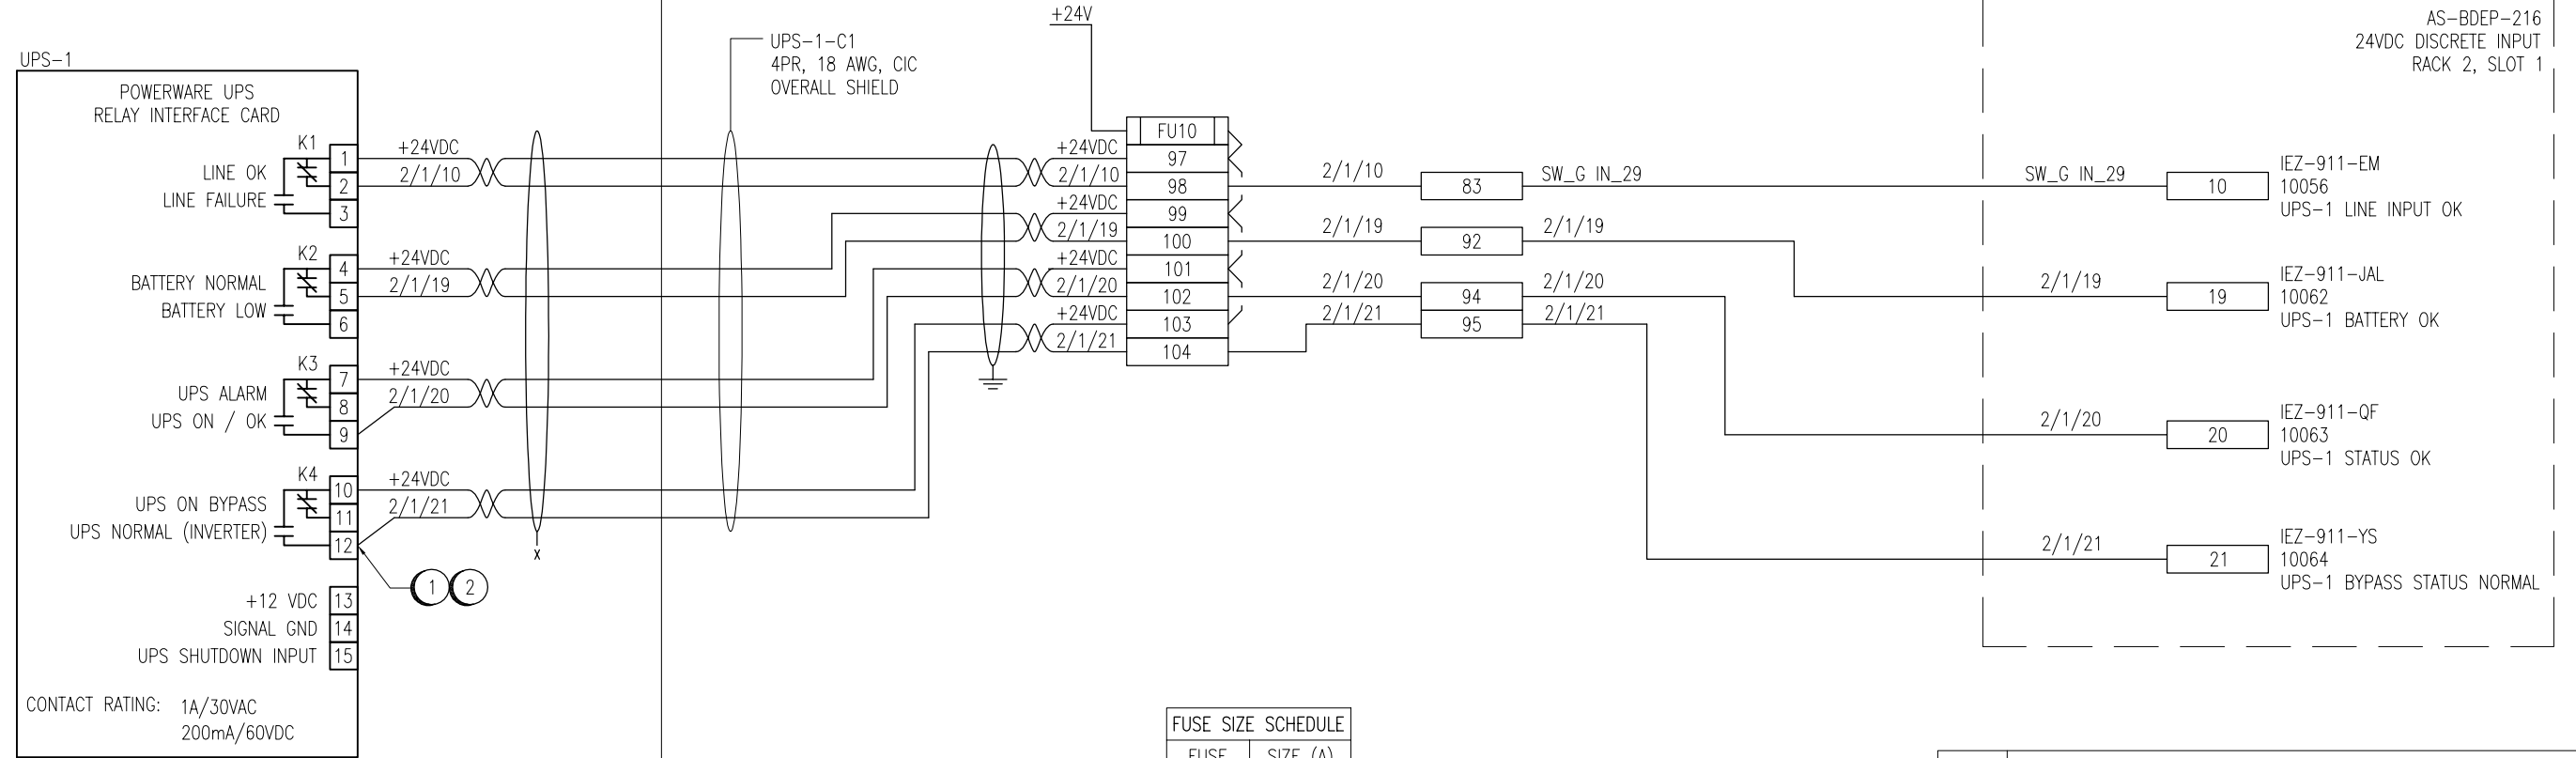

UPS-1 SETTINGS	VALUE	UNITS
BATTERY LOW LEVEL ALARM	1.950	V/CELL

LAST SAVE: 2008/01/09 - 10:30am
PATH: M:\113063\4ENG\48&C\DD - General DWG\1-0600M-A0001-001-PA.dwg

APEGM
Certificate of Authorization
SNC-Lavalin Inc. (MB)
No. 4489 Expiry: April 30, 2008

SNC-LAVALIN		SNC-LAVALIN INC. 148 Nature Park Way Winnipeg, MB, Canada R3P 0X7 204-786-8080	
DESIGNED BY:	C. REIMER	ENGINEER'S SEAL	
DRAWN BY:	A. OLIVER	PRELIMINARY NOT TO BE USED FOR CONSTRUCTION	
CHECKED BY:	C. REIMER		
APPROVED BY:	C. REIMER		
SCALE:	N.T.S.		
DATE:	2007/08/28		
CONSULTANT NO.:	113063		
NO.	ISSUED FOR TENDER	2008/01/09	AEO
NO.	REVISIONS	DATE	BY

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

SHOAL LAKE INTAKE
UPS UPGRADES
INSTRUMENT LOOP DIAGRAM
UPS-1 ALARMS

CITY DRAWING NUMBER	SHEET	REV.	SIZE
1-0600M-A0001	001	0	B