
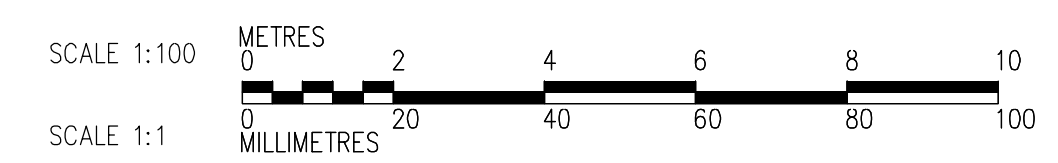


THIRD FLOOR FACILITY PLAN  
1:100

- NOTES:**
1. PROVIDE STAIRWELL SMOKE DETECTORS AS SHOWN ON FIRE PROTECTION DRAWINGS
  2. SEE DRAWING WB-E0401 FOR CABLE TRAY MOUNTING DETAIL.

FOR CABLE TRAY TAGGING SEE DETAIL 3  
WB-E0455

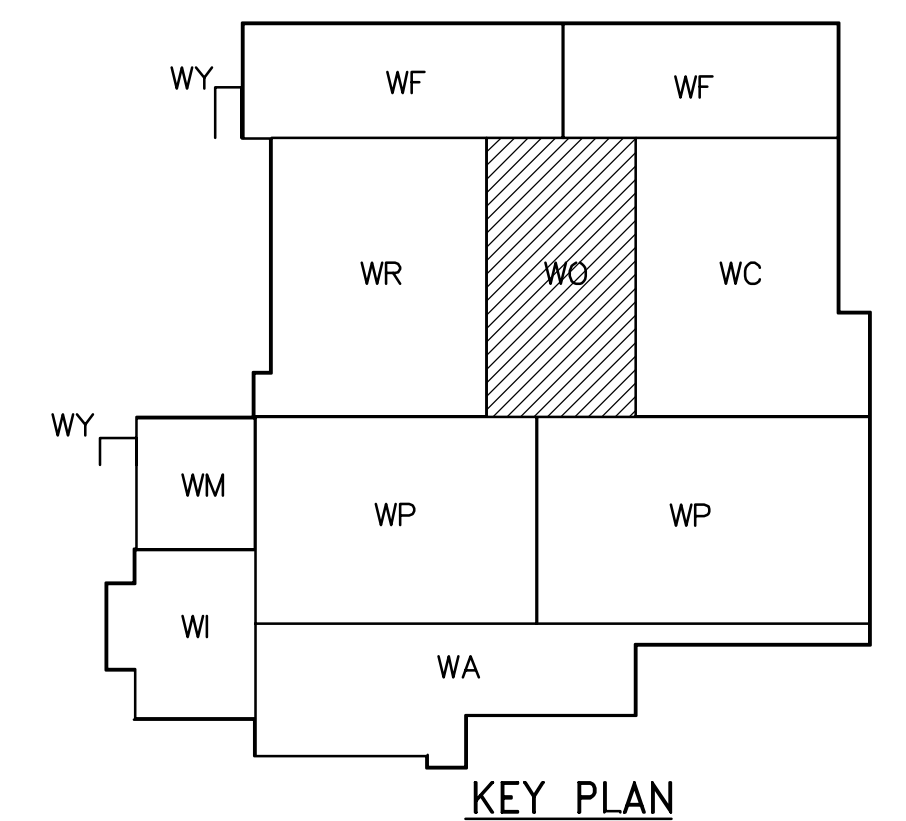

 Certificate of Authorization CH2M HILL Canada Ltd. No. 1441 Expiry: April 30, 2007	<b>INFORMATION ONLY</b>	B.M. ELEV. CH2M HILL Frederickson Cooper ARCHITECTS	EarthTech A Tyco International US Company	ENGINEER'S SEAL ORIGINAL SIGNED BY L.D. LLEWELLYN 2006/03/29	<b>THE CITY OF WINNIPEG</b> WATER AND WASTE DEPARTMENT ENGINEERING DIVISION WATER TREATMENT PLANT OZONE MECHANICAL AND ELECTRICAL	
NO. REVISIONS      DATE      BY		DESIGNED BY      LL      CHECKED BY      ND DRAWN BY      TL      APPROVED BY      AHL SCALE:      1:100      RELEASED FOR CONSTRUCTION BY: R. SOROKOWSKI		CONSULTANT DRAWING NO. WO-E0131		CITY FILE NUMBER SHEET      OF CITY DRAWING NUMBER 1-06010-A-E0131-001-030
03 ISSUED FOR CONSTRUCTION      06/07/28      LL 02 742-2005 ADDENDUM 5      06/05/19      LL 01 742-2005 ADDENDUM 3      06/05/05      LL 00 ISSUED FOR TENDER      06/03/29      LL		DATE      2005/07/13      DATE      2006/03/29		ELECTRICAL OZONATION AREA THIRD FLOOR FACILITY PLAN		