
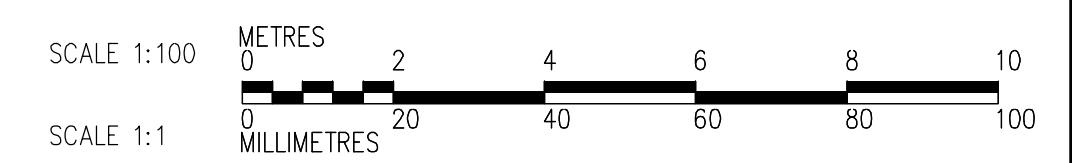


- NOTES:**
1. ALL WIRING IN THIS AREA WILL BE RUN IN CONDUIT.
 2. PROVIDE STAIRWELL SMOKE DETECTORS AS SHOWN ON FIRE PROTECTION DRAWINGS

FOR CABLE TRAY TAGGING SEE DETAIL 3
WB-E0455

THIRD FLOOR FACILITY PLAN
1:100

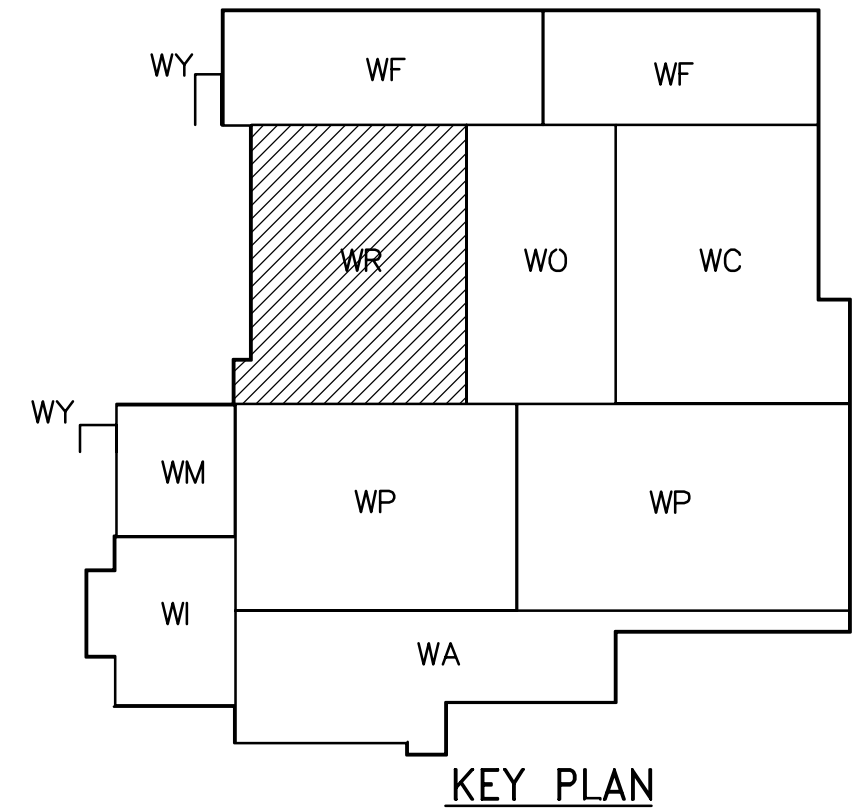

 APEGM Certificate of Authorization CH2M HILL Canada Ltd. No. 1441 Expiry: April 30, 2007	INFORMATION ONLY	B.M. ELEV.	 Frederickson Cooper ARCHITECTS	 EarthTech A Tyco International US Company	ENGINEER'S SEAL ORIGINAL SIGNED BY L.D. LLEWELLYN 2006/03/29	 THE CITY OF WINNIPEG WATER AND WASTE DEPARTMENT ENGINEERING DIVISION WATER TREATMENT PLANT RESIDUALS HANDLING MECHANICAL AND ELECTRICAL	CITY FILE NUMBER
		DESIGNED BY LL CHECKED BY ND DRAWN BY TL APPROVED BY AHL SCALE: 1:100 RELEASED FOR CONSTRUCTION BY: R. SOROKOWSKI DATE 2005/07/12 DATE 2006/03/29 CONSULTANT DRAWING NO. WR-E0131	SHEET OF				
						ELECTRICAL RESIDUALS HANDLING AREA THIRD FLOOR FACILITY PLAN	CITY DRAWING NUMBER 1-0601R-A-E0131-001-020