


PARTIAL MAIN FLOOR PLAN - RENOVATION
 SCALE: 1/8"=1'-0"

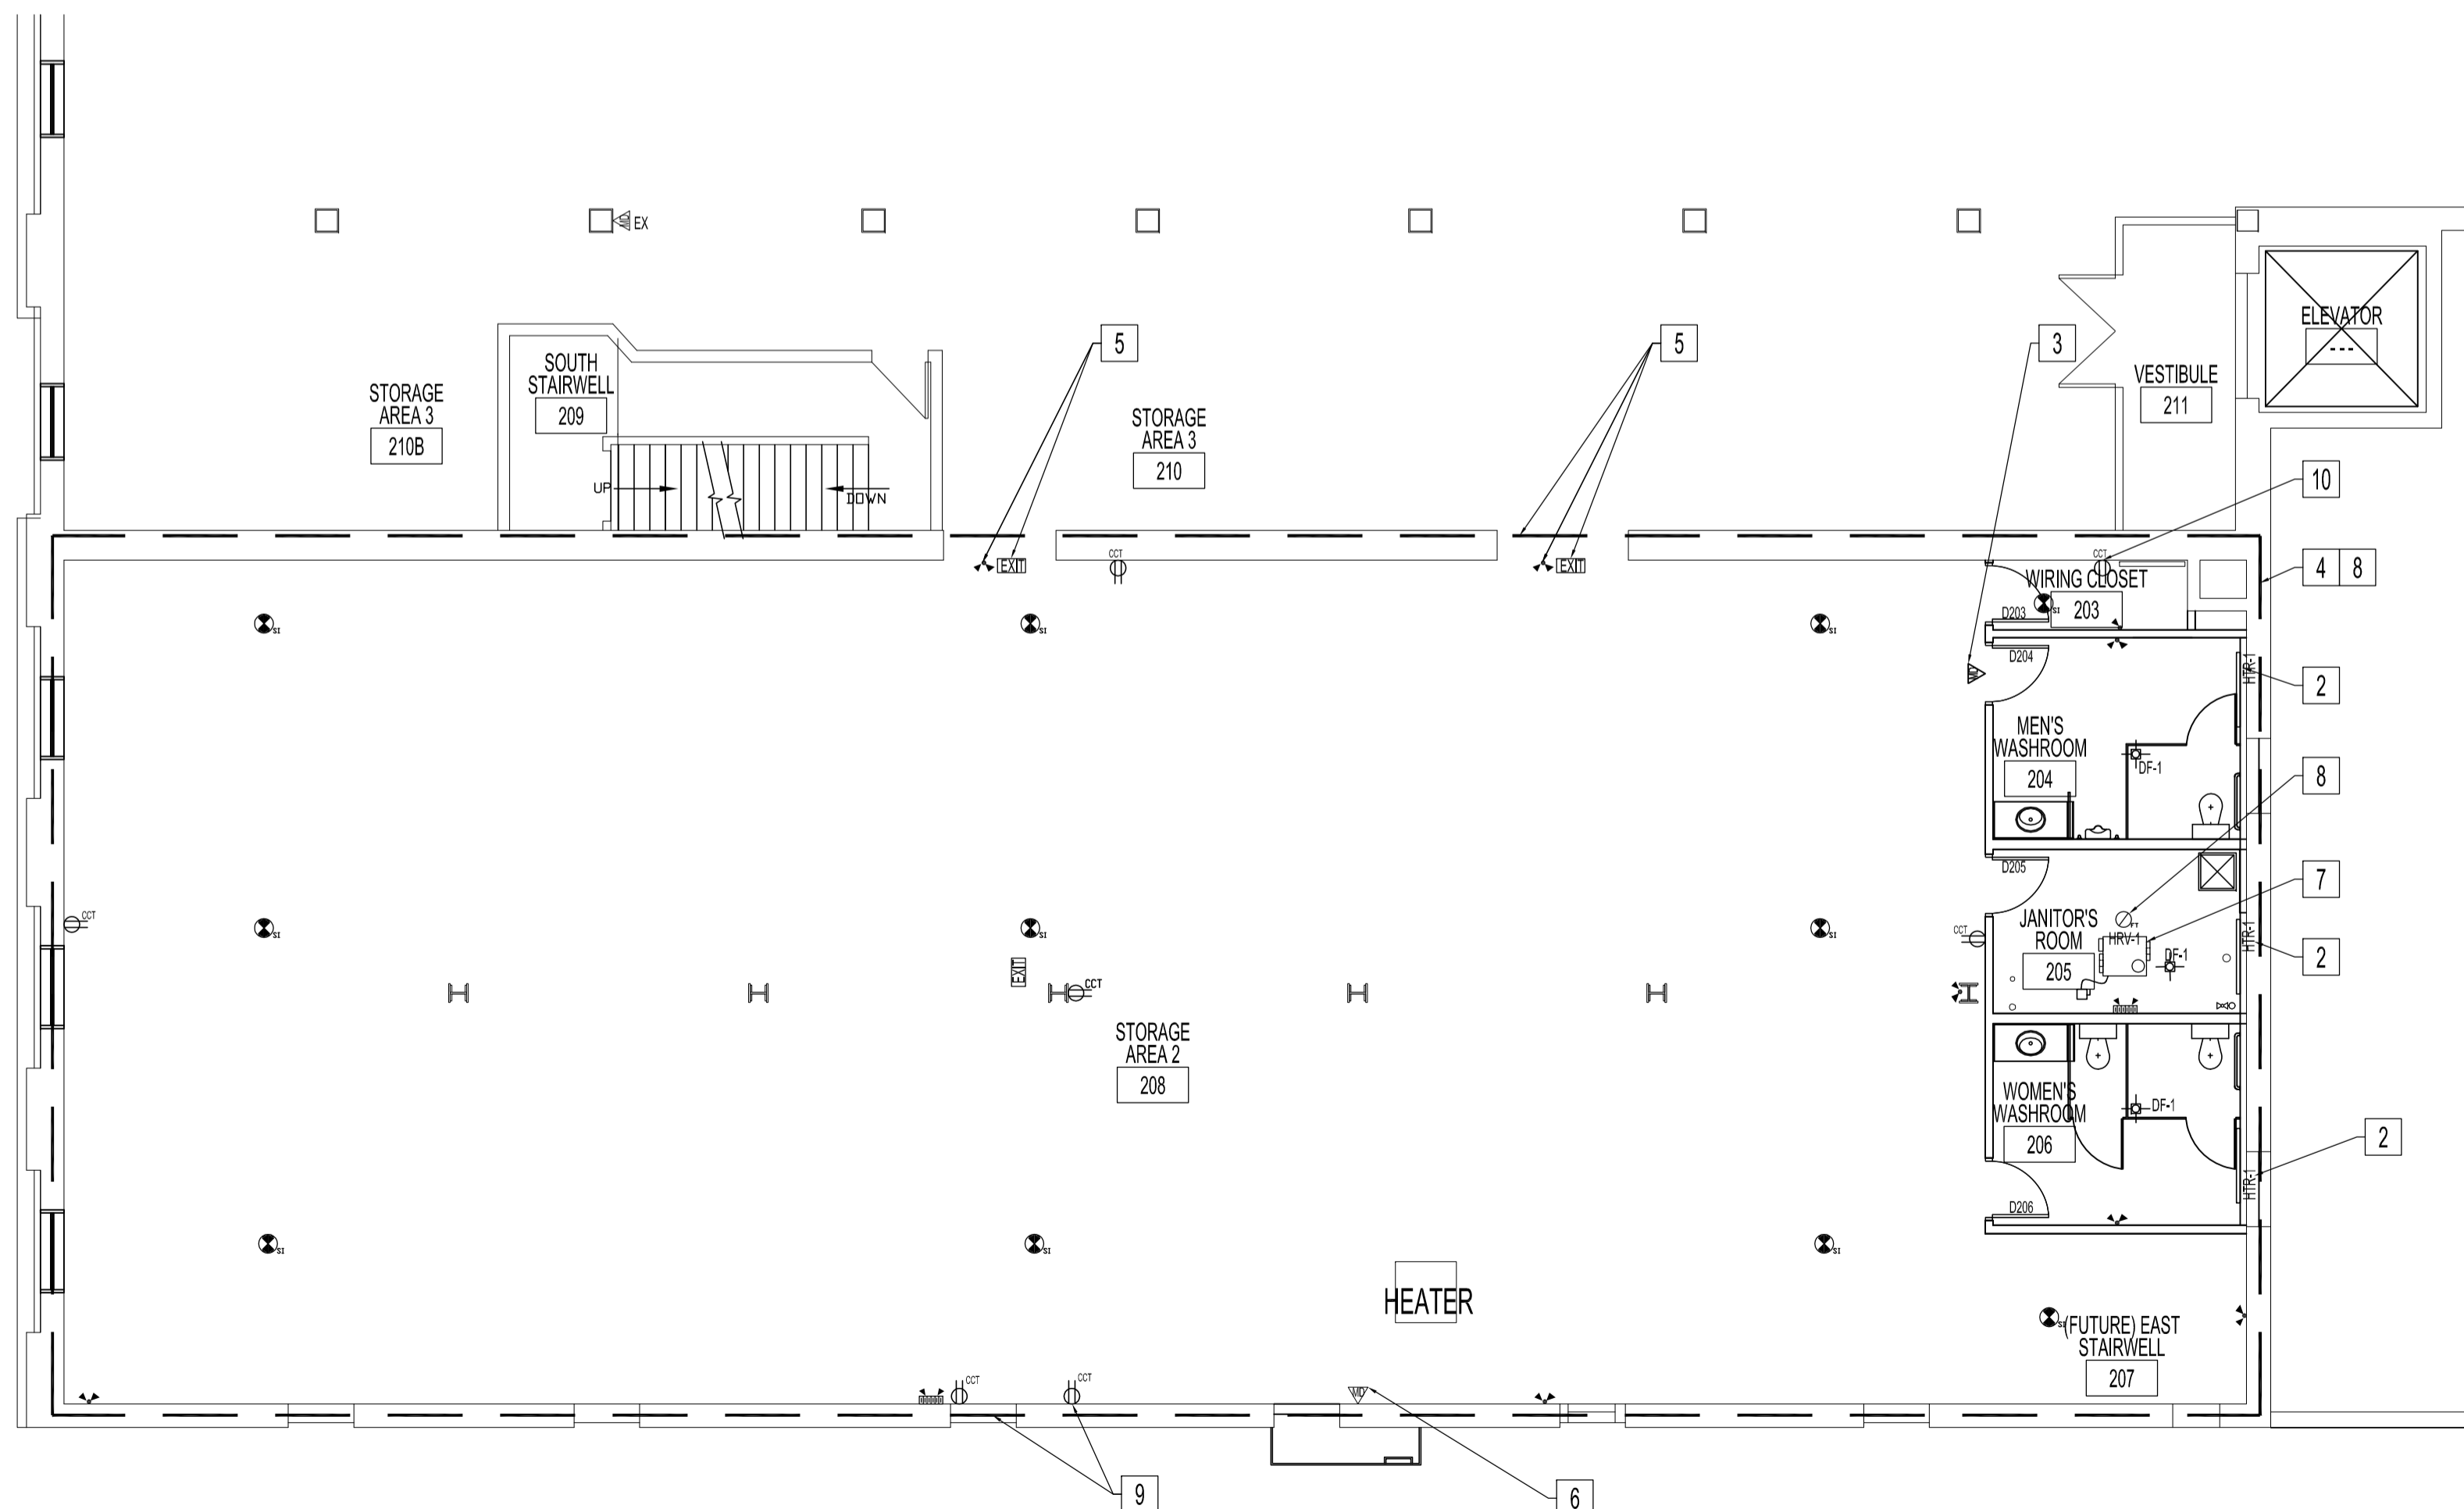

PARTIAL SECOND FLOOR PLAN - RENOVATION
 SCALE: 1/8"=1'-0"

RENOVATION NOTES:
 ALSO SEE NOTES.

- 1 RELOCATE AS SHOWN.
- 2 SUPPLY & INSTALL ELECTRIC BASE BOARD HEATER, SEE HVAC SCHEDULE.
- 3 SUPPLY & INSTALL SECURITY MOTION HEAD ABOVE DOOR, TYPE TO BE SAME AS THIRD FLOOR SECURITY MOTION SENSOR INCLUDING MOUNTING HEIGHT. PROVIDE 1/2"EMT (MIN) FOR ALL NEW DEVICES.
- 4 SUPPLY & INSTALL EMERGENCY LIGHTING BATTERY UNIT, EMERGENCY DOUBLE HEADS, & EMERGENCY SINGLE HEAD AS SHOWN (DASHED LINE) IN LIGHT FIXTURE SCHEDULE IN LOCATIONS SHOWN. MOUNTING HEIGHTS TO BE SAME AS THIRD FLOOR WASHROOM 305 & JANITOR 307. PROVIDE 3/4"EMT (MIN) FOR ALL NEW DEVICES.
- 5 SUPPLY & INSTALL EMERGENCY EXIT SIGN & EMERGENCY DOUBLE HEADS AS SHOWN IN LIGHT FIXTURE SCHEDULE IN LOCATIONS SHOWN. MOUNTING HEIGHTS TO BE SAME AS THIRD FLOOR STORAGE 309. PROVIDE 3/4"EMT (MIN) FOR ALL NEW DEVICES.
- 6 CHECK & REPAIR (IF REQUIRE) EXISTING SECURITY MOTION SENSOR, RE-SECURE TO WALL INCLUDING WIRING. PROVIDE 1/2"EMT (MIN) FOR ALL NEW DEVICES.
- 7 SUPPLY & INSTALL HEAT RECOVERY VENTILATOR, HRV-1, AS SHOWN (SHEET M2) IN COMPLIANCE WITH MANUFACTURER'S INSTALLATION INSTRUCTIONS & MECHANICAL & ELECTRICAL SPECIFICATIONS. HRV-1 SHALL OPERATE CONTINUOUSLY ON LOW-SPEED. ANY LIGHT SWITCHES ENERGIZED FROM NEW WIRING CLOSETS, JANITOR'S ROOM, & WASHROOMS (FROM MAIN FLOOR & SECOND FLOOR) SHALL ACTIVATE HRV-1 TO HIGH-SPEED THEN TO LOW-SPEED WHEN LIGHT SWITCH(S) IS TURNED OFF. DIRECT DRAIN TO NEW FLOOR DRAIN. MOUNT DISCONNECT SWITCH ON CEILING. PROVIDE 1/2"EMT (MIN) FOR ALL NEW DEVICES.
- 8 SUPPLY & INSTALL SMOKE DETECTORS (ADDRESSABLE) & FIX TEMP SENSOR (ADDRESSABLE) & AS SHOWN IN LIGHT FIXTURE SCHEDULE IN LOCATIONS SHOWN. MOUNTING HEIGHTS TO BE SAME AS THIRD FLOOR STORAGE 309 AND JANITOR 305. PROVIDE 3/4"EMT (MIN) FOR ALL NEW DEVICES.
- 9 SUPPLY & INSTALL ELECTRICAL RECEPTACLES AS SHOWN IN DASHED LINE AREA. SUPPLY AND INSTALL SEPARATE 15A CIRCUIT FOR ELECTRICAL RECEPTACLES FOR EMERGENCY LIGHTING BATTERY UNIT AT 14" FROM CEILING. POWER AVAILABLE IN ELECTRICAL PANEL LOCATED AT SOUTH-WEST INTERIOR BUILDING CORNER OF EACH FLOOR.
- 10 SUPPLY & INSTALL DEDICATED 15A CIRCUIT.

NOTES :
 SEE SHEET E1 NOTES.

NO.	REVISION/DESCRIPTION	BY	DATE
SEALS			

DRAWN BY	DATE	CHECKED BY	APPROVED
DTA	2008.12.01	USER APPROVAL	

CITY OF WINNIPEG
 PLANNING, PROPERTY AND
 DEVELOPMENT DEPARTMENT
 CIVIC ACCOMMODATIONS DIVISION
 300 - 65 GARRY ST. R3C 4K4

PROJECT
 SURPLUS STORAGE FACILITY
 MAIN & SECOND FLOOR RENOVATION

311 ROSS AVENUE

SHEET TITLE
 PARTIAL MAIN & SECOND FLOOR PLANS
 RENOVATION
 ELECTRICAL POWER AND SYSTEMS

SCALE	PROJECT NO.	SHEET NO.
AS SHOWN	2008-016-02	E2