


NOTES :

GENERAL NOTES

- 1. QUANTITY AND SIZE OF GENERATOR CONTROL/FUEL SYSTEM CONTROL WIRING IS TYPICAL AND SHALL BE COORDINATED BY CONTRACTORS. PROVIDE WIRE QUANTITY AND SIZE REQUIRED BY GENERATOR SUPPLIER.

DRAWING NOTES

- 1. PROVIDE ALL BREAKERS PHASE 1 AND PHASE 2 SHOWN AS PART OF PHASE 1.
- 2. TEST UPS UPON COMPLETION OF WORK.

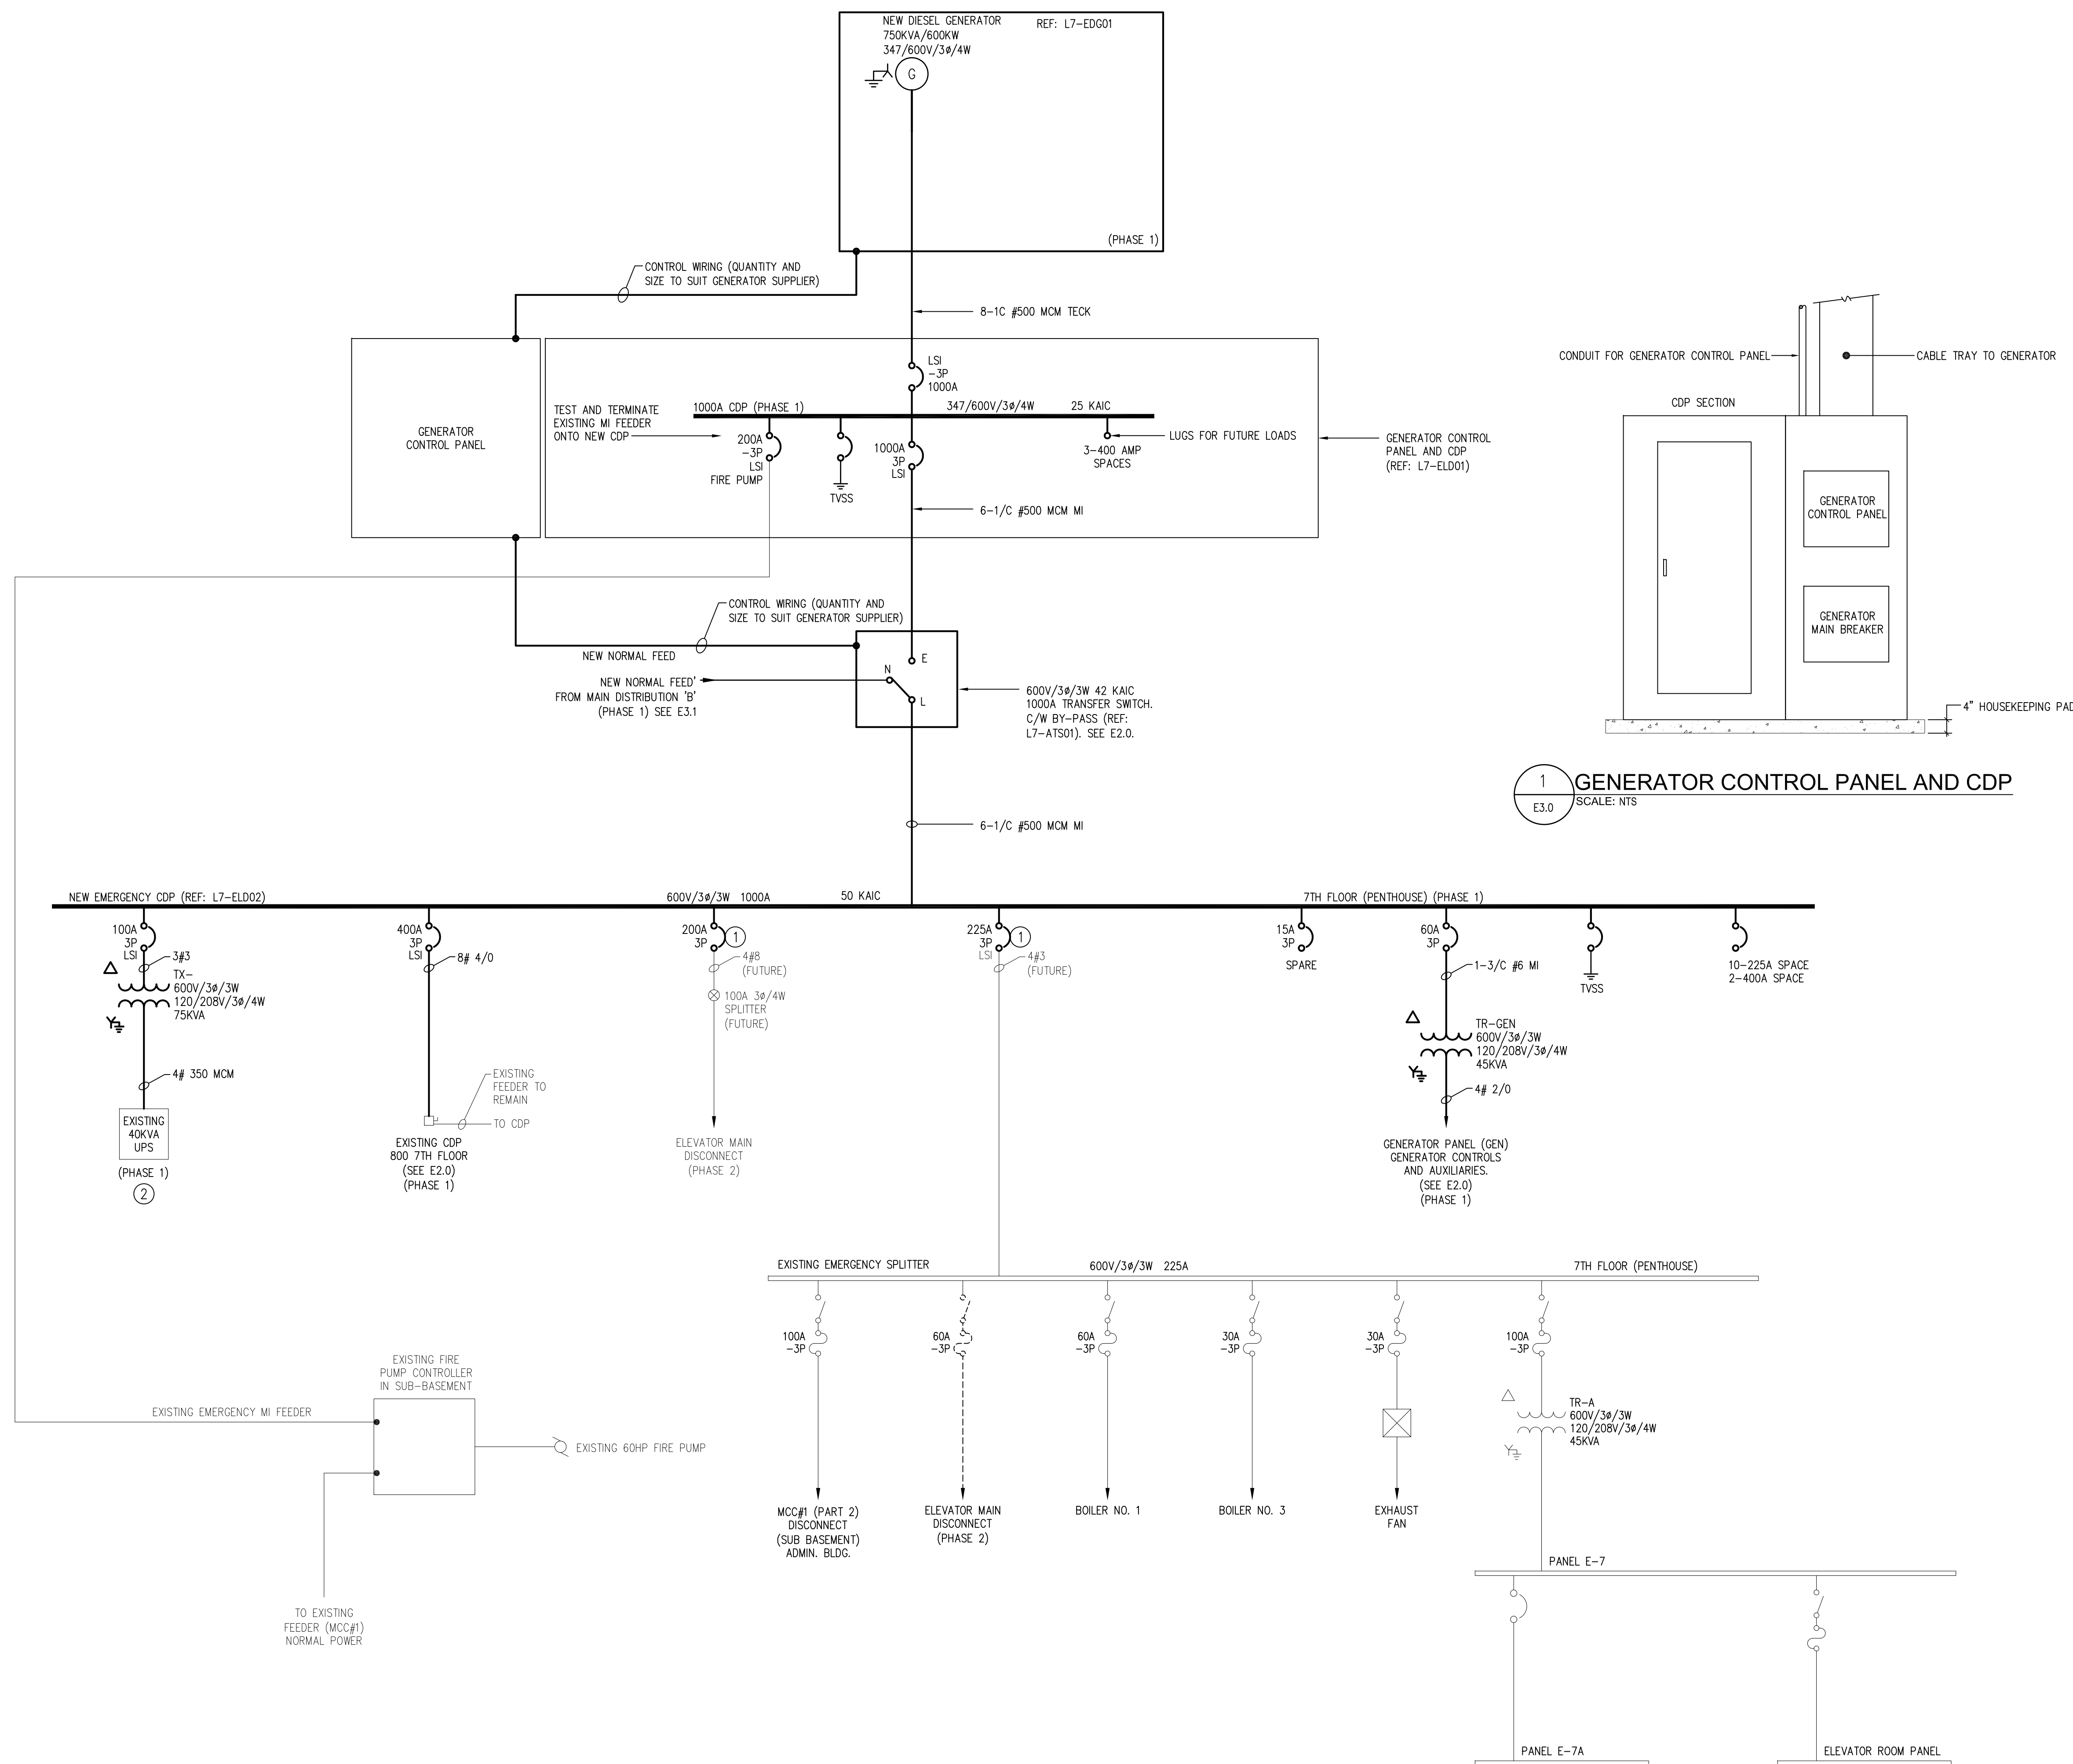

2 NEW SINGLE LINE DIAGRAM  
SCALE: NTS

1. ISSUED FOR OWNER'S FINAL REVIEW CB 09.04.24

NO.	REVISION/DESCRIPTION	BY	DATE

SEALS

**APEGM**  
Certificate of Authorization  
SMS Engineering Ltd.  
No. 166 Expiry: April 30, 2009

**PRELIMINARY**  
DATE PLOTTED  
March 31, 2009  
NOT FOR CONSTRUCTION

DRAWN BY	CHECKED BY	APPROVED BY
KAM	GR	

CITY OF WINNIPEG  
PLANNING, PROPERTY &  
DEVELOPMENT DEPARTMENT  
CIVIC ACCOMMODATIONS DIVISION  
300 - 65 GARRY ST. R3C 4K4

PROJECT  
CITY OF WINNIPEG 510 MAIN ST.  
EMERGENCY DISTRIBUTION UPGRADE  
PHASE 1

SHEET TITLE  
NEW EMERGENCY GENERATOR  
SINGLE LINE SCHEMATIC OF NEW  
EMERGENCY SYSTEM UPGRADE

**SMS ENGINEERING**

SMS Engineering Ltd. Consulting Engineers  
770 Bradford Street Winnipeg MB Canada R3M 0E3  
Telephone: 204.775.0291 Fax: 204.772.2153  
www.smseng.com

SCALE	PROJECT NO.	SHEET NO.
AS SHOWN	07-232-01	E3.0

DRAWING SHEET SIZE: A1 (841mm x 594mm) PLOT 1:1