



MAIN FLOOR PLAN
SCALE: 1:125

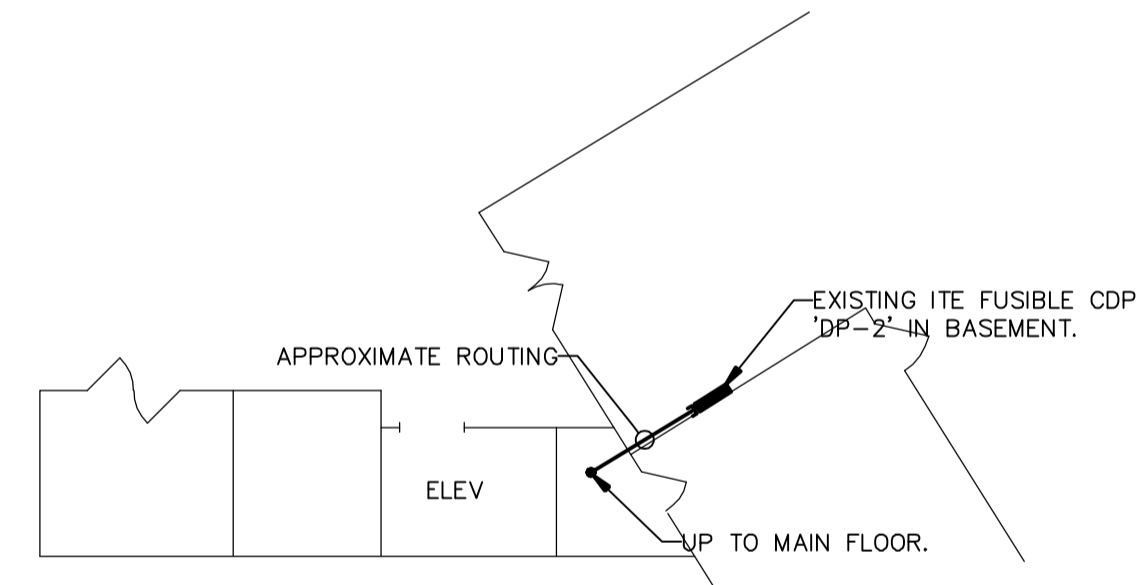

PARTIAL BASEMENT FLOOR PLAN
SCALE: 1:125

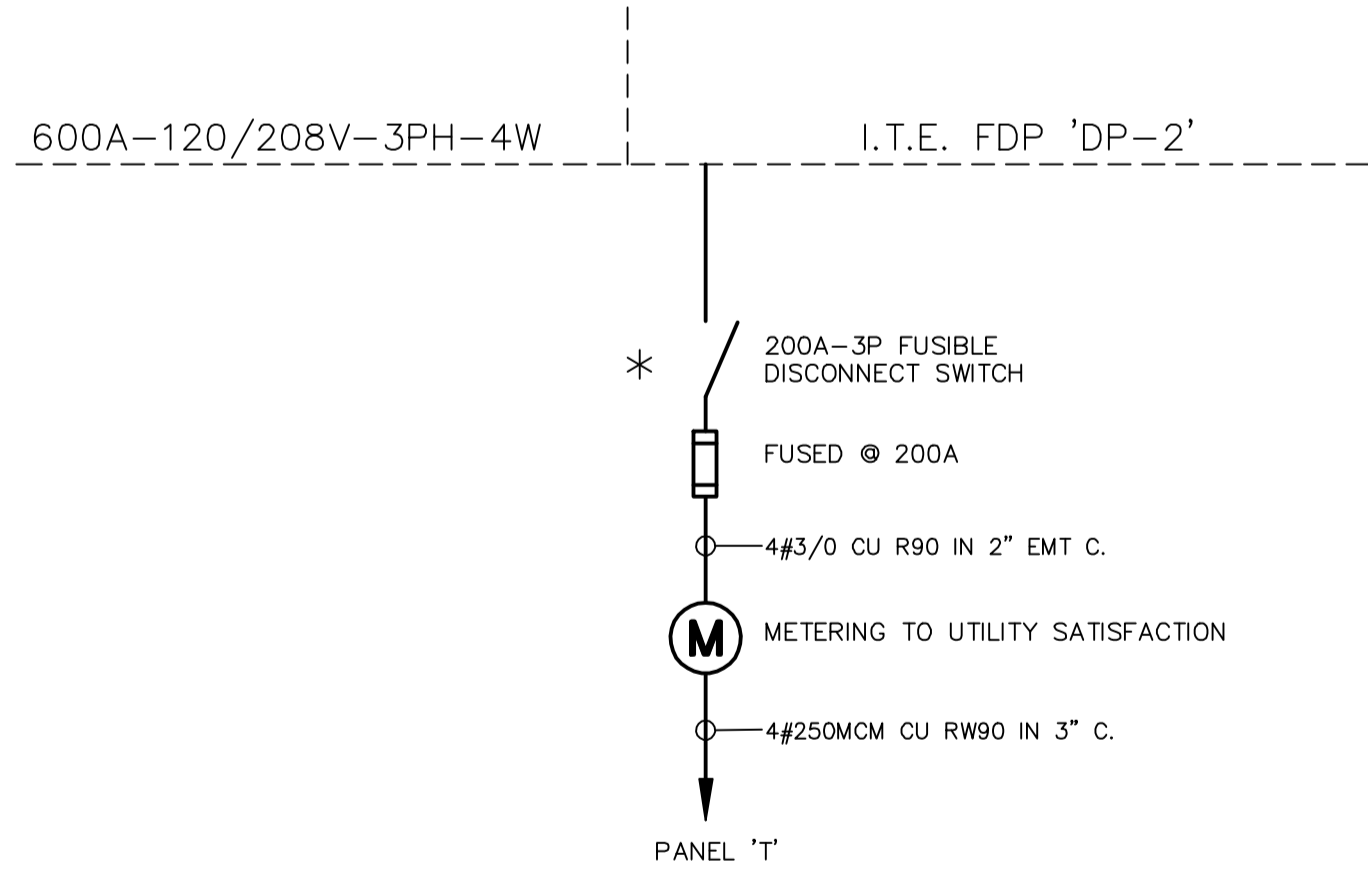

DISTRIBUTION SINGLE LINE
N.T.S.
* TO MATCH EXISTING
NOTE: DASHED INDICATES EXISTING.

SPECIFIC ELECTRICAL NOTES

- 1 WIRE & CONNECT ILLUMINATED SIGN ARM AND/OR EBBD AS REQUIRED.
- 2 WIRE & CONNECT NEW HEATED SHELTER AS REQUIRED. COORDINATE POWER ACCESS WITH SUPPLIER.
- 3 2#8 AND 4#10 RW90 CU AND GROUND IN 32mm RIGID PVC CONDUIT.
- 4 PROVIDE ROUGH-IN ONLY FOR FUTURE LED LIGHTING ON ORNAMENTAL FENCE. REFER TO LANDSCAPE ARCHITECT'S DRAWINGS FOR DETAILS. PROVIDE CONDUIT ONLY. RUN UP NEAREST COLUMN TO CEILING AND BACK TO PANEL 'T'.
- 5 INSTALL NEW TYPE 'C' LUMINAIRES WITHIN EXISTING CAVITIES FROM DEMOLISHED FLUORESCENTS. REUSE EXISTING CIRCUITRY. (TYPICAL)
- 6 LOCATE PANEL 'T', TIMELOCKS AND RECEPTACLE IN A SUITABLE LOCKABLE, WEATHERPROOF STEEL ENCLOSURE PAINTED TO MATCH WALL. ENCLOSURE TO BE VANDAL AND CORROSION RESISTANT.
- 7 PROTECT CONDUIT FROM GRADE TO CEILING WITH STAINLESS STEEL SHROUD. REFER TO LANDSCAPE ARCHITECTS FOR DETAIL.

GENERAL ELECTRICAL NOTES

1. ALL ELECTRICAL TO BE FED FROM ABOVE.
2. ALL CONDUITS TO BE PAINTED TO MATCH WALL/CEILING/COLUMN.

LUMINAIRE SCHEDULE

TYPE	DESCRIPTION	CATALOG NUMBER	LAMPS
A	PENDANT SUSPENDED HID MOUNTED 0.3m BELOW BEAMS	HOLOPHANE EP 40RMH 12P + B31	1-400W MH
A1	PENDANT SUSPENDED HID MOUNTED 0.3m BELOW BEAMS (WITH QUARTZ RESTRIKE)	HOLOPHANE EP 40RMH 12P + B31 + QRSTD	1-400W MH + 1-250W Q18
B	UP/DOWN HID COLUMN MOUNTED AT 3.5m A.F.F.	SISTEMALUX S.3946-120	2-70W MH T6 G12 4000K
C	4' FLUORESCENT RECESSED IN EXISTING CEILING	LITHONIA FFB 14 4 32 N1 X12 PCL125 MVOLT GEBIOPS LPB41 AL PAF	4-32W T8
E	EXISTING RECESSED HID TO REMAIN	N.A.	N.A.

LUMINAIRE SCHEDULE NOTES:
1. ALL FLUORESCENT BALLAST TO BE ELECTRONIC. MB HYDRO "POWER SMART" APPROVED.

THIS DRAWING IS THE EXCLUSIVE PROPERTY OF NOVA 3 ENGINEERING LTD. AND MAY ONLY BE REPRODUCED WITH THE WRITTEN PERMISSION OF NOVA 3 ENGINEERING LTD. THE CONCEPT AND DESIGN INCORPORATED INTO THIS DRAWING ARE BASED ON INFORMATION PROVIDED BY THE CLIENT AND OTHER RELATED SOURCES. PROFESSIONAL ENGINEER ACCEPTS NO RESPONSIBILITY FOR DRAWING AND DESIGN UNLESS DRAWING IS ACCOMPANIED BY ORIGINAL SEALED AND SIGNED LETTER OF INTENT AND CERTIFICATE OF INSPECTION. REFER TO WWW.NOVA3.CA FOR CAUTIONARY NOTES.

UNDERGROUND STRUCTURES		BENCHMARK INFO HERE	
SUPPLY	DATE	B.M. ELEV.	
U/G STRUCTURES COMMITTEE			

NO.	REVISIONS	DATE	BY
2	ISSUED FOR TENDER	2009.07.31	DZ
1	ISSUED FOR REVIEW	2009.07.15	DZ

DESIGNED BY	DZ
DRAWN BY	DF
CHECKED BY	WJT / DZ
APPROVED BY	
HOR. SCALE	AS SHOWN
VERTICAL	
DATE	JULY 31, 2009

NOVA 3
NOVA 3 ENGINEERING LTD.
CONSULTING ENGINEERS

201-120 FORT STREET
WINNIPEG, MANITOBA R3C 1C7
TEL.: (204) 943-6142
FAX.: (204) 942-1276

ENGINEER'S SEAL
PROVINCE OF MANITOBA
ORIGINALLY STAMPED BY
D. P. ZILINSKI
2009.07.31
REGISTERED ENGINEER

THE CITY OF WINNIPEG
TRANSIT DEPARTMENT

BALMORAL TRANSIT TERMINAL

ELECTRICAL LAYOUT

CITY DRAWING NUMBER
P-3313-10

SHEET **10** OF **10**

540-2009