

EXIST. SECOND FLR. OFFICE PLAN ABOVE KITCHEN

EXISTING SECOND FLOOR

LEGEND


- POT LIGHT
- ▭ FLUORESCENT LIGHT
- EXTERIOR LIGHT FIXTURE
- ⊗ JUNCTION BOX
- ⊙ MOTOR
- ⊕ CEILING MOUNT FAN
- ⊕ RECEPTACLE
- ⊕ 1-WAY SWITCH
- ⊕ 3-WAY SWITCH
- ◀ CAT-6
- ◀ PHONE
- ⊕ RG-6 CO-AX CONNECTOR
- R TO BE REMOVED (INCLUDING ALL ASSOCIATED EQUIPMENT BACK TO THE POWER ORIGIN)

GENERAL NOTES

1. ALL EXISTING T-BAR MOUNTED FIXTURES SHALL BE REMOVED AND RE-INSTALLED TO ACCOMMODATE THE INSTALLATION OF THE NEW FIRE SPRINKLER PIPING SYSTEM.

DRAWING NOTES


1. EXISTING BASE BOARD HEATER, JUNCTION BOX AND WIRING
2. PANELS AND RECEPTACLES TO BE REMOVED, REPLACED AND REWIRED FROM NEW DISTRIBUTION TRANSFORMER AND CDP
3. REMOUNTED PANEL LOCATIONS
4. RELOCATE EXTERIOR SIGN COMMUNICATION CABLE TO NEW FACILITY MANAGER ROOM
5. SEE E-3.1 FOR SWITCHING/WIRING OF NEW LIGHT FIXTURES
6. RELOCATE EXISTING DISTRIBUTION BY COMBINING EXISTING PANELS 100, 300 AND 400 INTO NEW SCHNEIDER CDP, NF PANELS AND USING NEW BREAKERS
7. COMPLETELY REMOVE EXISTING OVERHEAD SERVICE MAST
8. REMOVE AND RECONNECT POWER FOR FAN RELOCATION

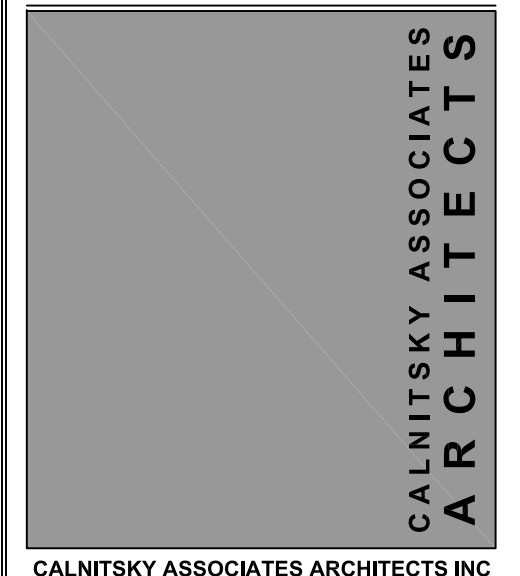

ARCHITECTURE | INTERIOR DESIGN
124 Nassau Street North Winnipeg, Manitoba R3L 2H1
Tel: (204) 453-8841 Fax: (204) 453-3392
E-mail: caa@escape.ca

This drawing is not intended to be an as-built or record drawing. The contractor is responsible for verifying the accuracy of the information on-site. If there is any information that is in error, the contractor shall record the discrepancy and contact the Engineer immediately with his findings.

REVISIONS			
NO.	DATE	DESCRIPTION	DRAWN BY
0	2010MAY13	ISSUE FOR TENDER	BH

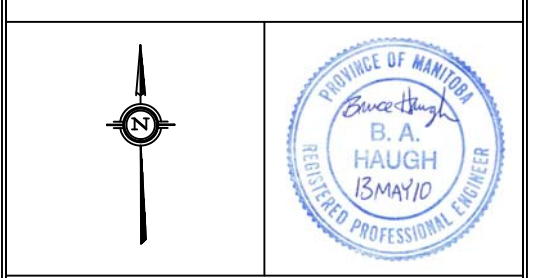

PhamEng Technology
A Division of P.E. Pharma Inc.

JOB TITLE:
ADDITION & RENOVATION OF WINAKWA COMMUNITY CENTRE
980 WINAKWA ROAD WINNIPEG, MB.

DRAWING TITLE:
EXISTING POWER DISTRIBUTION

SCALE: N.T.S.	DATE: 2010 MAY 13	DRAWING NO: E-1.3
DRAWN: B.H.	DESIGN: B.H.	CHECKED: B.H.
FILE NO: -	PROJECT NO: 339-2010	