
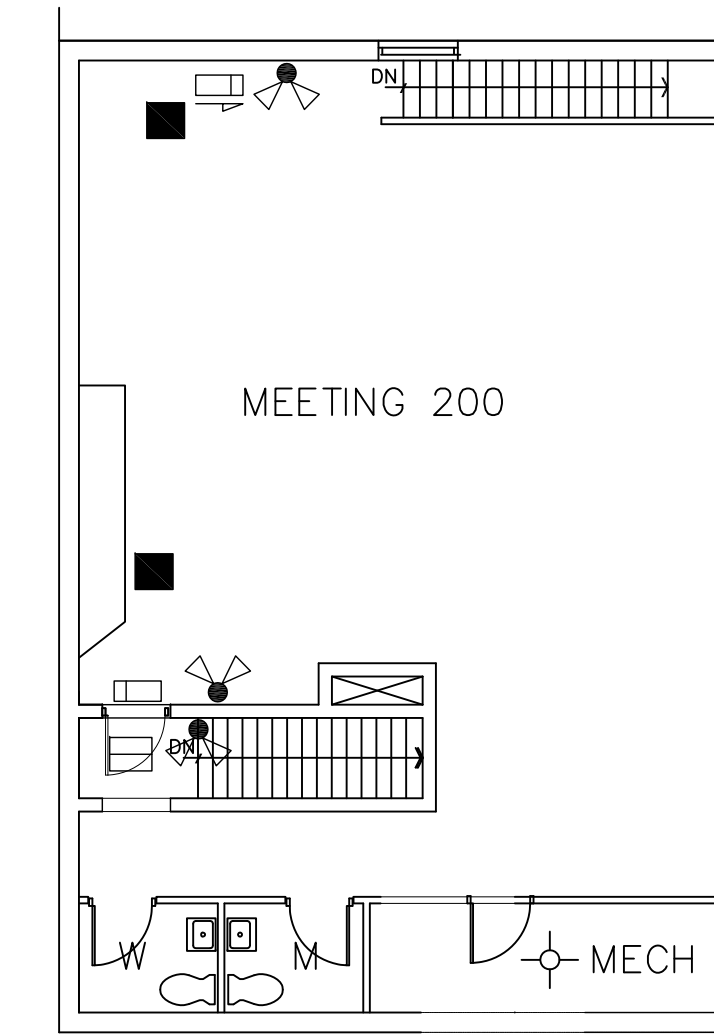


EXIST. SECOND FLR OFFICE PLAN (ABOVE KITCHEN)

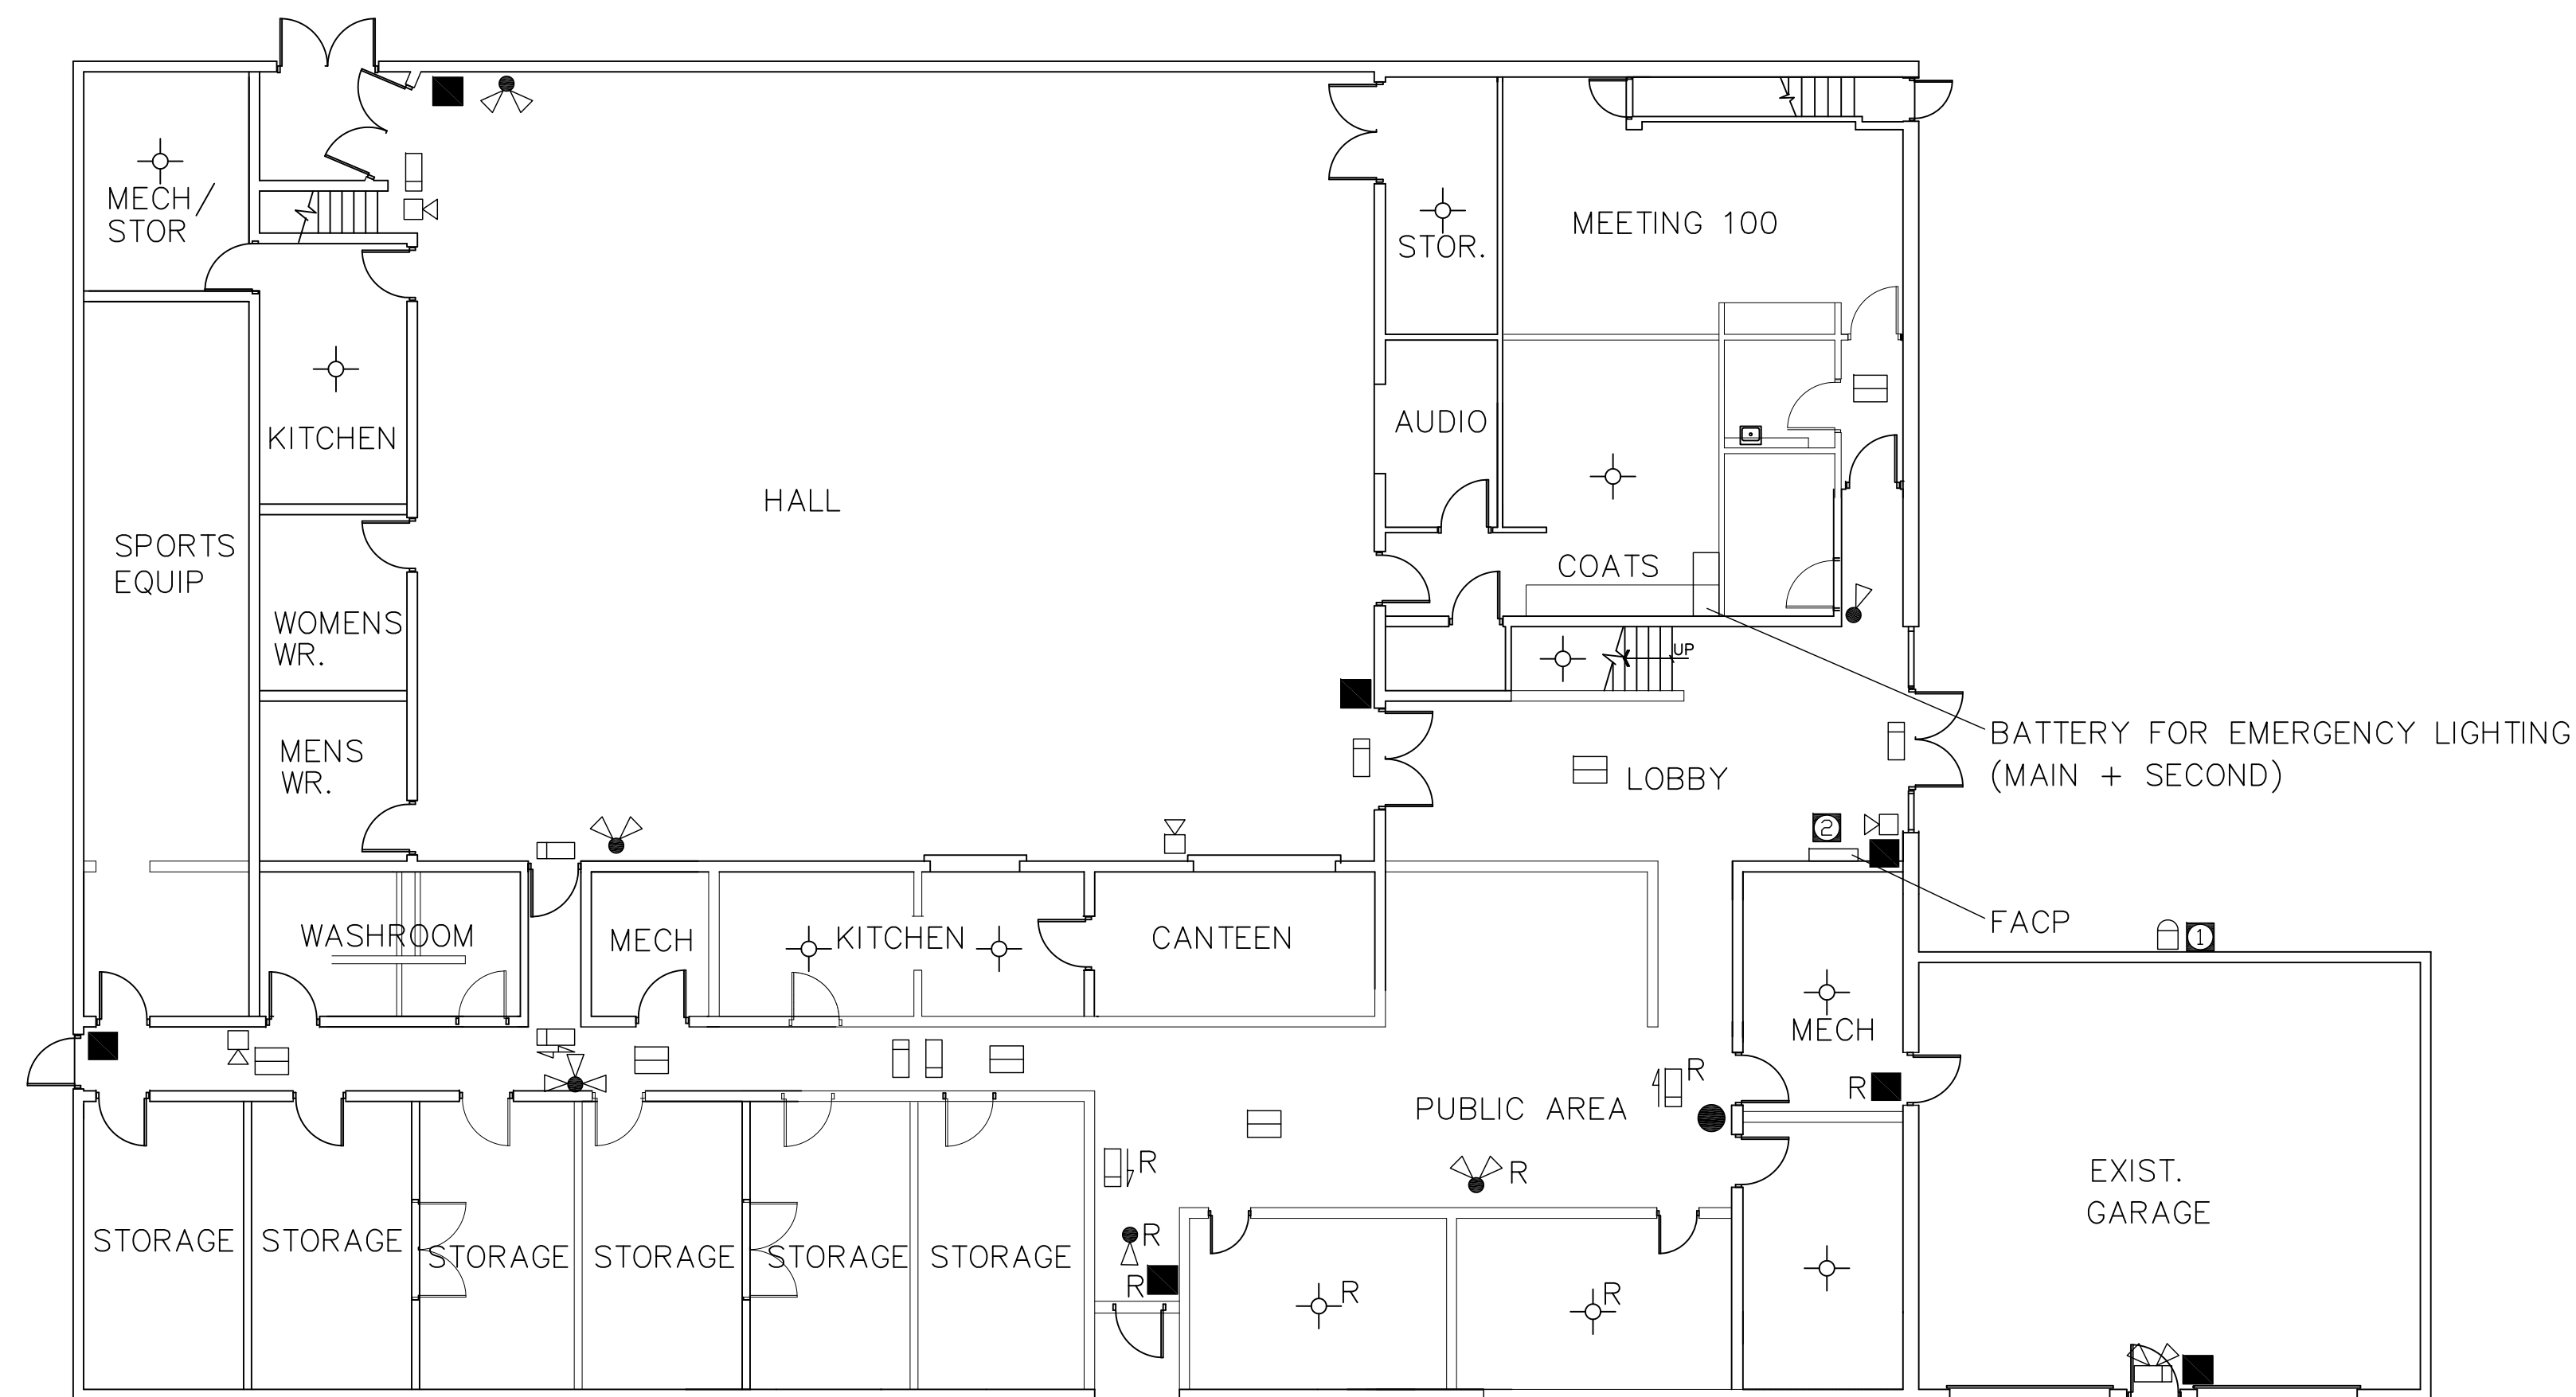

EXISTING SECOND FLOOR

DRAWING NOTES


- 1 EXISTING CAMERA TO BE RELOCATED. PROVIDE NEW CONDUIT FROM THIS LOCATION TO NEW FACILITY MANAGER OFFICE. SEE E-2.3.
- 2 COMPLETELY REMOVE EXISTING FIRE ALARM CONTROL PANEL SYSTEM AND ALL CONNECTED COMPONENTS FOR REPLACEMENT WITH NEW PANEL IN NEW VESTIBULE.

LEGEND

- ⊕ HEAT DETECTOR
- ⊕ FT HEAT DETECTOR (FIXED TEMP)
- PULL STATION
- ALARM BELL
- ⊠ ENUNCIATOR
- ⊕ EMERGENCY LIGHT
- EMERGENCY EXIT SIGN
- ⊠ SMOKE DETECTOR
- ⊠ SECURITY CAMERA

GENERAL NOTES

1. ALL EXISTING FIRE ALARM COMPONENTS ARE TO BE REPLACED WITH ADDRESSABLE COMPONENTS.
2. ALL EXIT SIGNS TO BE REPLACED WITH E-2 EXIT SIGNS (SEE DWG E-2.1 FOR FIXTURE INFORMATION).
3. ALL WASHROOMS TO HAVE NEW SMOKE DETECTORS.
4. ALL LIFE-SAFETY COMPONENTS TO BE REMOVED AND REPLACED WITH ADDRESSABLE SYSTEM COMPONENTS.

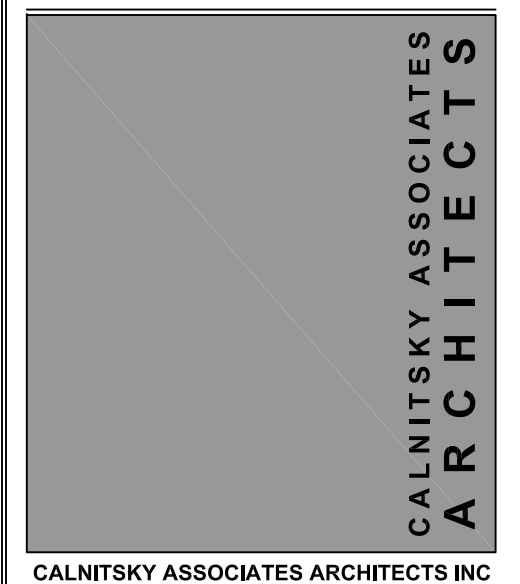


ARCHITECTURE | INTERIOR DESIGN
 124 Nassau Street North Winnipeg, Manitoba R3L 2H1
 Tel: (204) 453-8841 Fax: (204) 453-3392
 E-mail: caa@escape.ca

This drawing is not intended to be an as-built or record drawing. The contractor is responsible for verifying the accuracy of the information on-site. If there is any information that is in error, the contractor shall record the discrepancy and contact the Engineer immediately with his findings.

| DATE | NO. | DESCRIPTION | DRAWN BY |
|-----------|-----|------------------|----------|
| 2010MAY13 | 0 | ISSUE FOR TENDER | BH |

REVISIONS

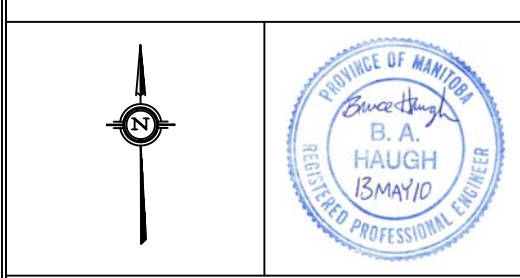

JOB TITLE:
ADDITION & RENOVATION OF WINAKWA COMMUNITY CENTRE
 980 WINAKWA ROAD WINNIPEG, MB

EXISTING LIFE SAFETY

| SCALE: | DATE: | DRAWING NO.: |
|------------|--------------|--------------|
| N.T.S. | 2010 MAY 13 | E-1.4 |
| DRAWN B.H. | DESIGN B.H. | CHECKED B.H. |
| FILE NO.: | PROJECT NO.: | |
| - | 339-2010 | |