

PLUMBING FIXTURES (REFER TO ARCHITECTURAL DWGS FOR NUMBER OF FIXTURES)		
LOCATION	EQUIPMENT	OPTIONS
112 MALE WR	SINK: FRANKE OV1619/5/3	
	FAUCETS: MOEN 8301 (AC POWERED)	
	WATER CLOSETS: TOTO CT705ELN, C/W TOILET SEAT SS534	
	FLUSH VALVES: TOTO TET2ANS-31 C/W 38mm (1.5") V.B.	
	URINALS: TOTO UT447EV	
113 BAR	SINK: FRANKE LB54408P-1/3	
	FAUCET: MOEN 8940 (SWIVEL SPOUT)	
117 FEMALE WR	SINK: FRANKE OV1619/5/3	
	FAUCETS: MOEN 8301 (AC POWERED)	
	WATER CLOSETS: TOTO CT705ELN, C/W TOILET SEAT SS534	
	FLUSH VALVES: TOTO TET2ANS-31 C/W 38mm (1.5") V.B.	
134 RENOV JANITOR'S	MOP SINK FIAT SB-3636	900X900X150 HIGH TERRAZZO MOP SERVICE BASIN COMPLETE WITH STAINLESS STEEL CAPS ON ALL SIDES NOT AGAINST A WALL. SINK TO HAVE MAXIMUM 1500mm HIGH SIDE TO APPLY MOP BUCKETS TO BE DRAINED EASILY

ROOF (REFER TO M3.3)	ELEVEN (11) ROOF DRAINS ZURN ZcF-121-VF-B4 (CONTROL-FLO, VANDAL PROOF SECURED TOP, STAINLESS STEEL PERFORATED GRAVEL GUARD)
101 GRAND HALL	DRINKING WATER FOUNTAIN HALSEY TAYLOR HRFSEBP C/W VANDAL RESISTANT KIT, CANE TOUCH APRON & WATER FILTERS
REFER TO PLUMBING DRAWINGS	TEN (10) FLOOR DRAINS ZURN ZKN-211-A FLOOR DRAIN WITH HEAVY-DUTY, 127mm NICKEL BRONZE ROUND STRAINER, TRAP PRIMER CONNECTION, VANDAL-PROOF SECURED TOP AND SEDIMENT BUCKET.
SOUTH EXTERIOR WALL OF ST4	ONE (1) HYDRANT ZURN Z-136S, ENCASED, NON-FREEZE, AUTOMATIC DRAINING, 38mm MALE HOSE CONNECTION C/W VACUUM BREAKER, INSTALL "GROUND" HYDRANT HORIZONTALLY FLUSH TO WALL. 610mm DEPTH. INSTALL PER TYPICAL FINISHED FLOOR APPLICATION.
REFER TO PLUMBING DRAWINGS	THREE (3) HOSE BIBBS ZURN Z-132D, ENCASED, NON-FREEZE, ANTI-SIPHON, AUTOMATIC DRAINING, 19mm HOSE CONNECTION, WALL THICKNESS VARIES. SELECT UNITS BASED ON ACTUAL WALL THICKNESS.
REFER TO PLUMBING DRAWINGS	STACK JACK FLASHINGS FOR PLUMBING VENT THALER SJ31



CALNITSKY ASSOCIATES ARCHITECTS INC


ARCHITECTURE | INTERIOR DESIGN  
 224 Hazlett Street North | Winnipeg, Manitoba R3B 2H1  
 Tel: (204) 453-5441 | Fax: (204) 453-3392  
 E-mail: [cas@escape.ca](mailto:cas@escape.ca)

This drawing is not intended to be an as-built or record drawing. The contractor is responsible for verifying the accuracy of the information on-site. If there is any information that is in error, the contractor shall record the discrepancy and contact the Engineer immediately with his findings.

DATE	NO.	DESCRIPTION	DRAWN BY

2010MAY13 0 ISSUE FOR TENDER JIC

REVISIONS

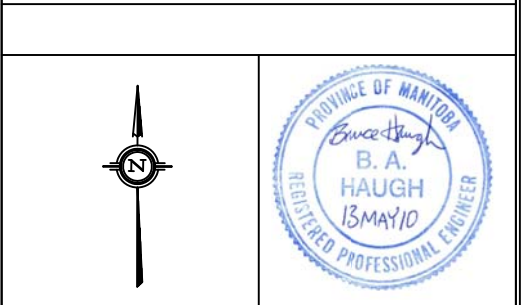

**PharmEng**  
 Technology  
 A Division of P.L. Pharma Inc.

JOB TITLE:  
 ADDITION &  
 RENOVATION OF  
 WINAKWA COMMUNITY  
 CENTRE  
 980 WINAKWA ROAD  
 WINNIPEG, MB

DRAWING TITLE:  
 EQUIPMENT  
 SCHEDULE

SCALE:	DATE:	DRAWING NO.:
-	2010 MAY 13	
DRAWN JIC	DESIGN JIC	CHECKED BHI
FILE NO: N/A	PROJECT NO: 339-2010	<b>M-4.2</b>