


1 FIRE PROTECTION - 2ND FLOOR
M-5.2 SCALE: 1:100

GENERAL NOTES:

1. DRAWING SHOWS THE DIFFERENT SPRINKLER ZONES AND SPRINKLER MAIN LINE COMING FROM THE SPRINKLER ROOM.
2. PIPE ZONE VALVE DRAIN LINES FROM ZONES 4 & 5 TO SEPARATE FLOOR DRAINS IN ROOM 202.
3. VALVES SHALL BE LOCATED IN LOCATION THAT OFFER EASE OF ACCESS FOR TESTING, AS APPROVED BY THE FIRE MARSHAL.
4. ALL PIPES ARE TO BE INSTALLED AS TIGHT TO CEILING AS POSSIBLE WHILE MAINTAINING SLOPE AS REQUIRED.

LEGEND:

- ⊠ SPRINKLER ZONE VALVE COMPLETE WITH TAMPER SWITCH.

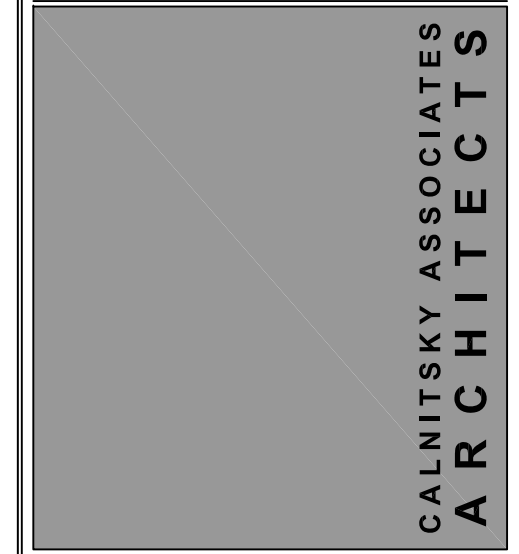


CALNITSKY ASSOCIATES ARCHITECTS INC.
ARCHITECTURE | INTERIOR DESIGN
124 Hazlour Street North Winnipeg, Manitoba R2L 2H1
Tel: (204) 453-6441 Fax: (204) 453-3392
E-mail: cas@escape.ca

This drawing is not intended to be an as-built or record drawing. The contractor is responsible for verifying the accuracy of the information on-site. If there is any information that is in error, the contractor shall record the discrepancy and contact the Engineer immediately with his findings.

DATE	NO.	DESCRIPTION	DRAWN BY
2010MAY13	0	ISSUE FOR TENDER	JC

REVISIONS

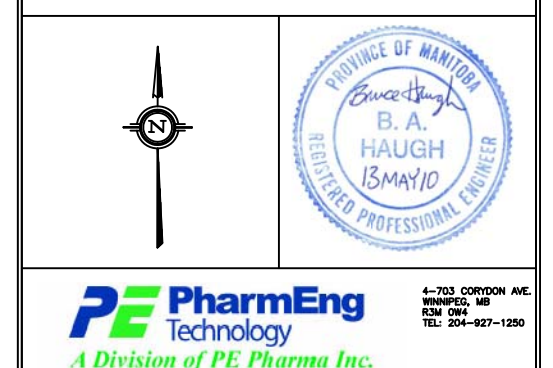

PharmEng Technology
A Division of PE Pharma Inc.
JOB TITLE:
ADDITION & RENOVATION OF WINAKWA COMMUNITY CENTRE
980 WINAKWA ROAD
WINNIPEG, MB

DRAWING TITLE:
FIRE PROTECTION 2ND FLOOR SPRINKLER

SCALE: 1:100	DATE: 2010 MAY 13	DRAWING NO.:
DRAWN JC	DESIGN JC	CHECKED BHT
FILE NO: N/A	PROJECT NO: 339-2010	M-5.2