


WATER SERVICE INFORMATION

ADDRESS	SIZE(mm) & TYPE (STREET)	SIZE(mm) & TYPE (PROP)	SHORT & LONG MEASUREMENT	CORP. LOCATION	REMARKS
607 BANNING ST RESIDENTIAL	20 COPPER	12 LEAD	1.15 SSL HSE	OPP S/C	-
608 BANNING ST RESIDENTIAL	20 COPPER	16 LEAD	0.3 SSL HSE	0.3 S OF S/C	WYE'D BEFORE C/S W/ #606 RENEW W/20 COPPER
609 BANNING ST RESIDENTIAL	20 COPPER	12 LEAD	1.59 SSL HSE	0.5 N OF S/C	-
610 BANNING ST RESIDENTIAL	16 COPPER	20 LEAD	3.67 SSL HSE	0.6 S OF S/C	WYE'D AFTER C/S W/ #612 RENEW W/20 COPPER
611 BANNING ST RESIDENTIAL	20 COPPER	20 COPPER	47.58 SSL ELICE	0.7 S OF S/C	-
612 BANNING ST RESIDENTIAL	16 COPPER	12 LEAD	2.21 SSL HSE	0.6 S OF S/C	WYE'D AFTER C/S W/ #610 RENEW W/20 COPPER
614 BANNING ST RESIDENTIAL	20 COPPER	20 COPPER	39.49 SSL ELICE	OPP S/C	-
616 BANNING ST RESIDENTIAL	20 COPPER	12 LEAD	2.05 SSL HSE	0.3 S OF S/C	-
617 BANNING ST RESIDENTIAL	16 COPPER	20 COPPER	20.03 SSL ELICE	OPP S/C	WYE'D BEFORE C/S W/ #619 RENEW W/20 COPPER
618 BANNING ST RESIDENTIAL	20 COPPER	13 LEAD	0.38 SSL HSE	0.6 N OF S/C	-
619 BANNING ST RESIDENTIAL	16 COPPER	20 COPPER	16.75 SSL ELICE	0.6 S OF S/C	WYE'D BEFORE C/S W/ #617 RENEW W/20 COPPER
621 BANNING ST RESIDENTIAL	16 COPPER	20 COPPER	11.88 SSL ELICE	OPP S/C	-
623 BANNING ST RESIDENTIAL	16 COPPER	20 COPPER	1.96 SSL HSE	OPP S/C	WYE'D AFTER C/S W/ #623
625 BANNING ST RESIDENTIAL	12 COPPER	12 LEAD	2.50 SSL ELICE	0.2 N OF S/C	WYE'D AFTER C/S W/ #621 SERVICED OFF BANNING RENEW W/20 COPPER
627 ELLICE AVE RESIDENTIAL	12 LEAD	12 LEAD	5.76 SSL ELICE	-	-

* SERVICES TO BE RENEWED TO R ALL OTHERS TO BE RECONNECTED

NOTE: CHAINAGES SHOWN ARE ALONG E PL OF BANNING ST

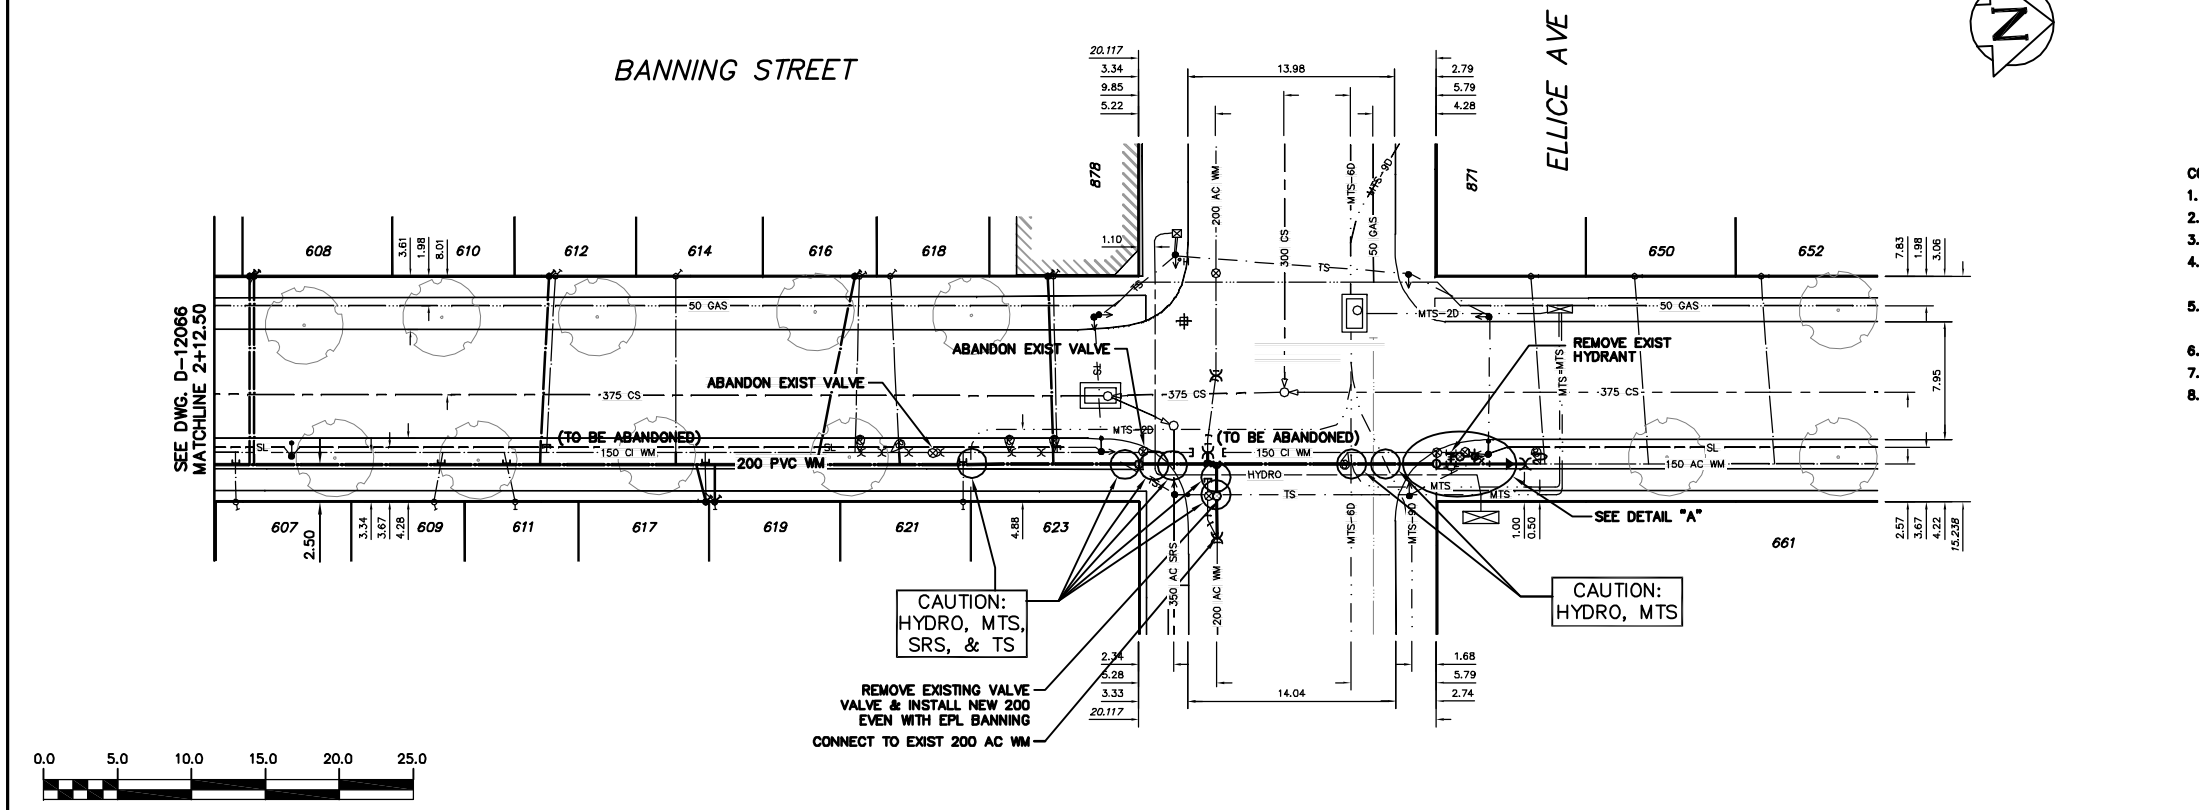

- CONSTRUCTION NOTES**
- EXPOSE EXISTING WATERMAIN & CONFIRM INVERTS PRIOR TO CONSTRUCTION.
 - LOCATION OF ALL SERVICES TO BE CONFIRMED IN THE FIELD.
 - INSTALL WATERMAIN BY TRENCHLESS METHODS.
 - TRENCHES AND EXCAVATIONS WITHIN 1 METRE OF A PAVED AREA INCLUDING SIDEWALKS SHALL BE CLASS 3 BACKFILL.
 - ALL MATERIALS SHALL CONFORM TO THE CITY OF WINNIPEG STANDARD CONSTRUCTION SPECIFICATIONS.
 - MINIMUM COVER TO TOP OF WATERMAIN SHALL BE 2.4 m.
 - REPLACE ALL EXISTING LEAD SERVICES FROM PROPOSED WATERMAIN TO R.
 - NOTIFY ALL AFFECTED RESIDENTS AND BUSINESSES 24 HOURS IN ADVANCE OF ANY WATER SHUTDOWNS OR DISRUPTION OF SERVICE.

METRIC
WHOLE NUMBERS INDICATE MILLIMETRES
DECIMALIZED NUMBERS INDICATE METRES

NOTE: ALL VALVES TO BE INSTALLED COUNTERCLOCKWISE TO CLOSE

WARNING

IF POWER EQUIPMENT OR EXPLOSIVES ARE TO BE USED FOR EXCAVATION ON THIS PROJECT THE CONTRACTOR MUST:

- NOTIFY THE GAS COMPANY OF THE PROPOSED LOCATION OF EXCAVATION.
- TAKE PRECAUTION TO AVOID DAMAGE TO GAS COMPANY INSTALLATIONS.

SEE PROVINCIAL REGULATION 210/72 FOR DETAILS

200 WM	WATERMAIN	200 WM	SL, HYDRO	150 WM	WATERMAIN	150 WM	LOCATION APPROVED UNDERGROUND STRUCTURES
+	HYDRANT	+	MTS	+	HYDRANT	+	
o	VALVE	o	TRAFFIC SIGNALS	o	VALVE	o	
525 LDS	LAND DRAINAGE SEWER	525 LDS	GAS	300 LDS	LAND DRAINAGE SEWER	300 LDS	
375 WWS	WASTEWATER SEWER	375 WWS	SURVEY BAR	250 WWS	WASTEWATER SEWER	250 WWS	
o	MANHOLE	o	FENCE	x	PROFILE	x	
□	CATCH BASIN	□	POLE - HYDRO, MTS	///	GROUND ABOVE PIPE	///	
▽	CURB INLET	▽	CURB STOP	▲	DITCH (NORTH & WEST)	▲	
△	REDUCER	△	GUY ANCHOR	▽	DITCH (SOUTH & EAST)	▽	
X	COUPLER	X	LIGHT STANDARD	□	GUTTER (NORTH & WEST)	□	
o	ANODE	o	TREE	o	GUTTER (SOUTH & EAST)	o	
EXISTING	LEGEND-PLAN	PROPOSED	EXISTING	LEGEND-PLAN	PROPOSED	EXISTING	LEGEND-PROFILE

NOTE: LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.

B.M. ELEV.	FIELD BOOK #:	CITY OF WINNIPEG WATER AND WASTE ENGINEERING DIVISION		ENGINEER'S SEAL
POSTED TO LBIS		DESIGNED BY: RC	CHECKED BY: SC	ORIGINAL SIGNED BY S.R.J COURNOYER 10/06/02
		DRAWN BY: DVG	APPROVED BY: KZ	
		HOR. SCALE: 1:250	RELEASED FOR CONSTRUCTION	BID OPPORTUNITY 352-2010 FILENAME D-12065_D-12066.dwg PLOT DATE: 2010 06 02
		VERTICAL: 1:50		
NO. REVISIONS	DATE	BY	DATE	2010 06 02

THE CITY OF WINNIPEG WATER AND WASTE DEPARTMENT

2010 WATERMAIN RENEWALS CONTRACT 4

BANNING STREET
ELLICE AVENUE TO
62.5 S OF ELLICE AVENUE

SHEET 1 OF 9
CITY DRAWING NUMBER
D-12065