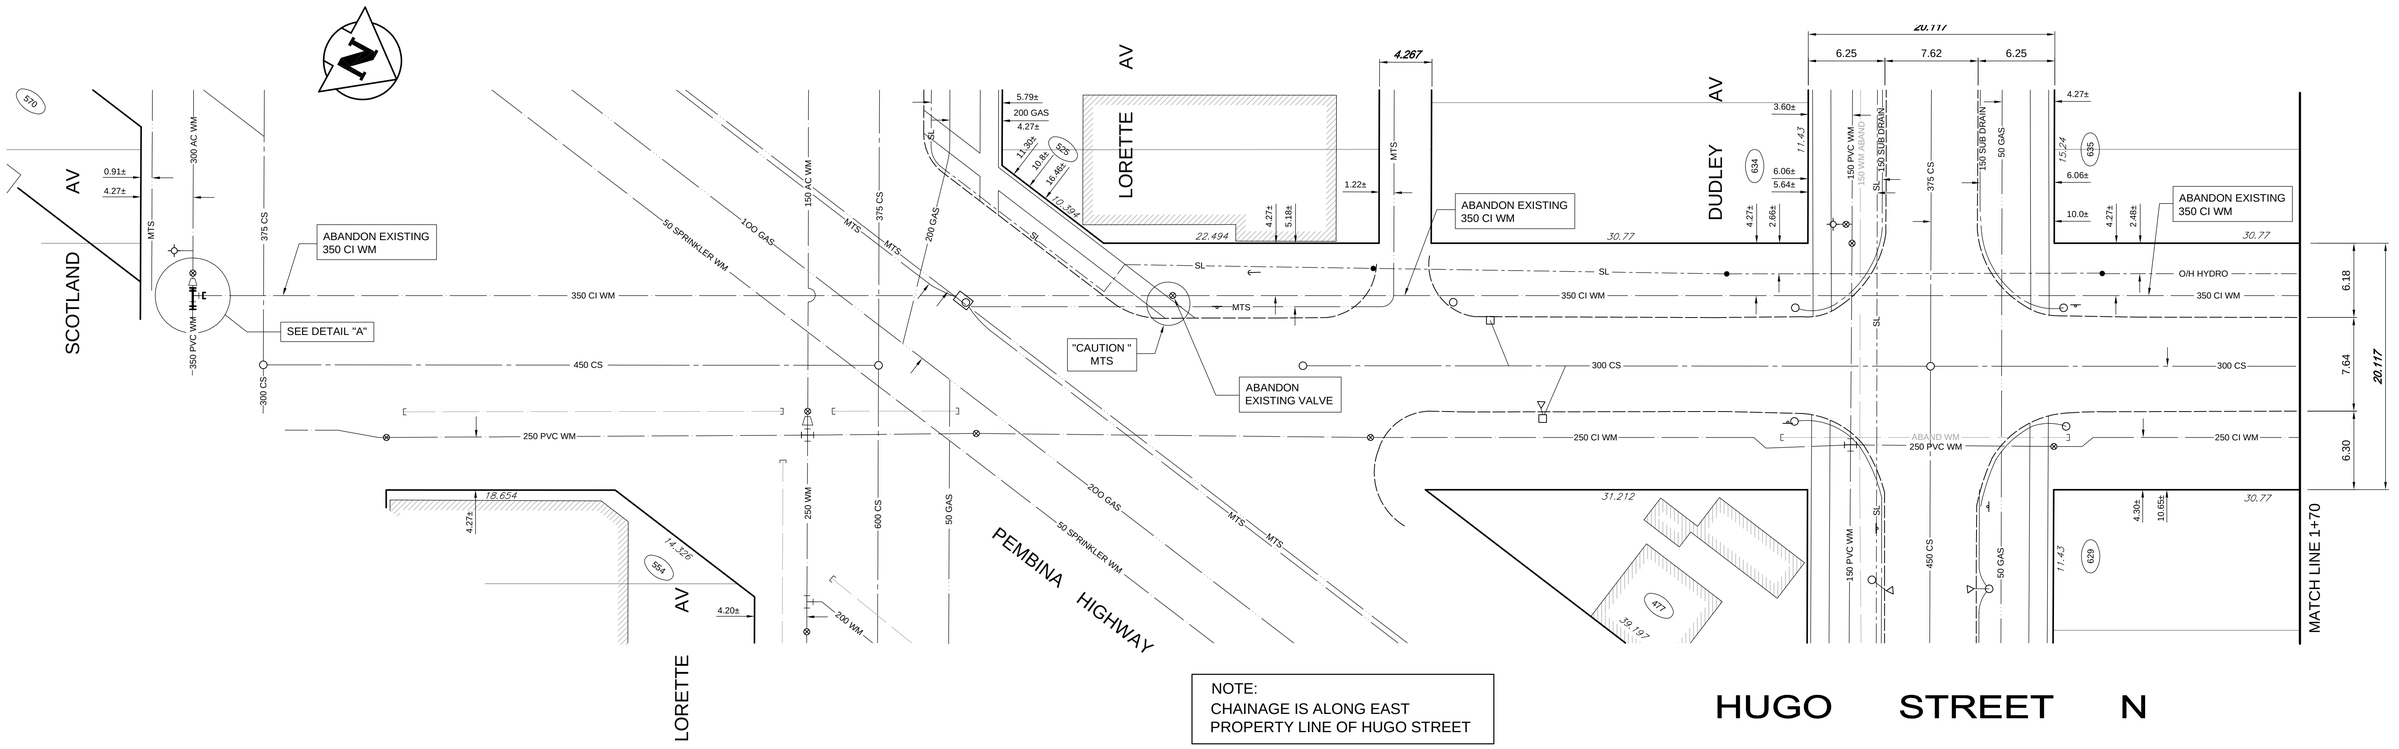

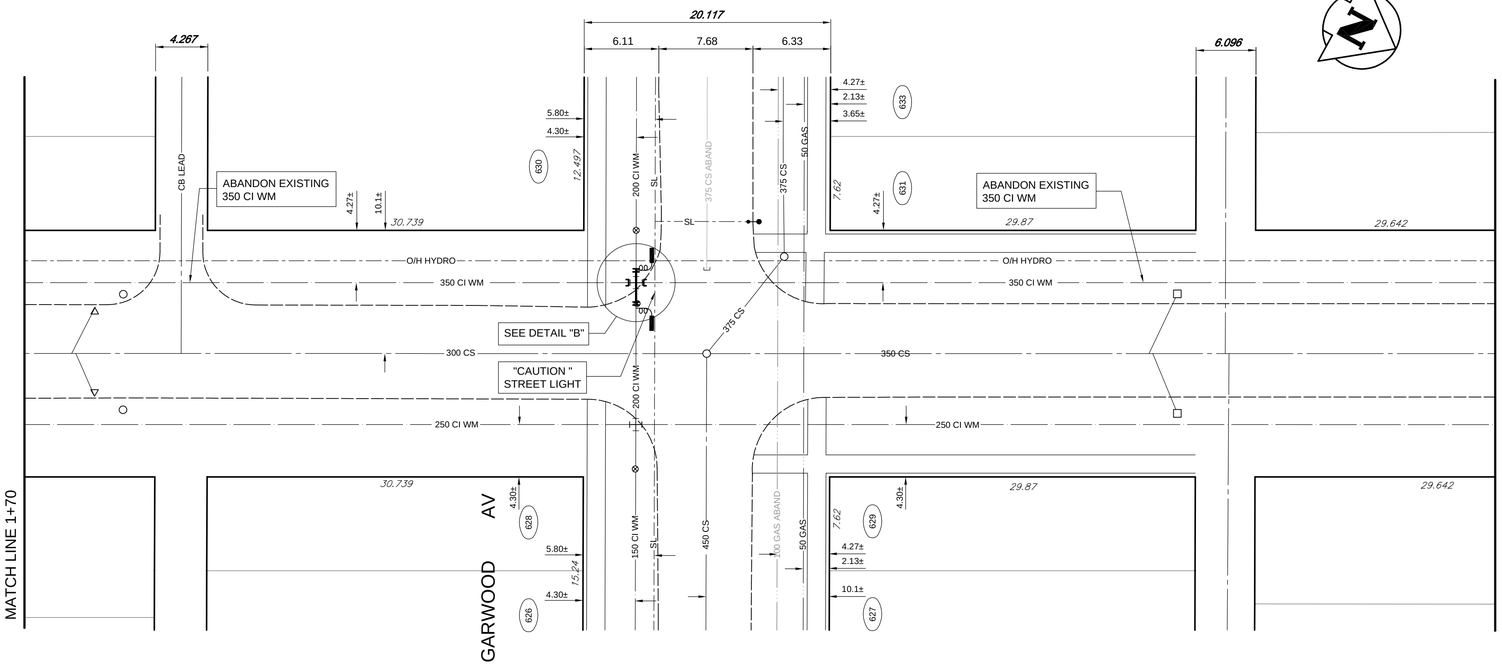

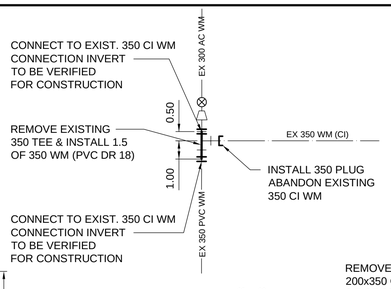

DETAIL "A"
N.T.S.

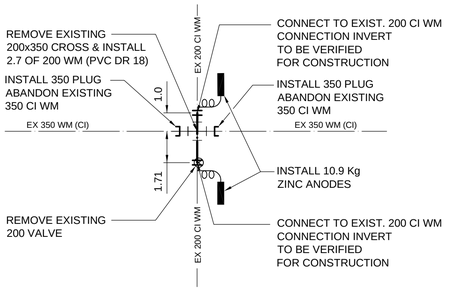

DETAIL "B"
N.T.S.

SEE DRAWING C0007

CONSTRUCTION NOTES

1. ALL CURB REPLACEMENT TO MATCH EXISTING CURB.
2. SALVAGE ALL EXISTING HYDRANT ASSEMBLIES AND VALVES WHEN DIRECTED BY THE CONTRACT ADMINISTRATOR AND RETURN TO THE CITY YARD. ABANDON THE REMAINING VALVES (AND/OR VALVE BOXES) AND HYDRANT ASSEMBLIES.
3. ALL BACKFILL UNDER PAVEMENT SHALL BE CLASS 3.
4. ALL BACKFILL UNDER BOULEVARD SHALL BE CLASS 5.
5. ABANDON SERVICES NO LONGER IN USE WHERE DIRECTED BY CONTRACT ADMINISTRATOR.
6. CONTRACTOR TO NOTIFY BUSINESSES AND RESIDENTS A MINIMUM OF 24 HOURS PRIOR TO ANY DISRUPTION TO WATER SERVICE.

GENERAL NOTES

STATION 3+00 = SOUTH LIMIT OF FLEET AVENUE.

APEGM Certificate of Authorization
Wardrop Engineering Inc.
No. 195 Expiry: April 30, 2011

EXISTING	LEGEND-PLAN	PROPOSED	EXISTING	LEGEND-PLAN	PROPOSED	EXISTING	LEGEND-PLAN	PROPOSED
150 WM	WATERMAIN		TEE			TREE		
400 FM	FEEDERMAIN		CURB STOP		15.240	LEGAL DIMENSION		
300 LDS	LAND DRAINAGE SEWER		PLUG			SURVEY BAR		
250 WWS	WASTEWATER SEWER		MANHOLE			TRAFFIC SIGNAL		
300 CS	COMBINED SEWER		CATCHBASIN			GAS		
200 FCM	FORCEMAIN		CURB INLET			HYDRO		
	REDUCER		ZINC ANODE			ASPHALT		
	HYDRANT		HYDRO POLE			CURB		
	VALVE		LIGHT STANDARD		66	ADDRESS		
	BEND		ANCHOR			SIGN		

LOCATION APPROVED
UNDERGROUND STRUCTURES

SUPV. U/G STRUCTURES COMMITTEE — DATE

NOTE:
LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE. BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.

B.M. ELEV.

NO.	REVISIONS	DATE	BY
01	ISSUED FOR TENDER	10.05.14	GS
00	ISSUED FOR APPROVAL	10.05.13	BLM

WARDROP A TETRATECH COMPANY — PEOPLE, PASSION, PERFORMANCE. TRUSTED GLOBALLY

DESIGNED BY	GWC	CHECKED BY	BLM
DRAWN BY	NL	APPROVED BY	GS
HOR. SCALE:	1 : 250	RELEASED FOR CONSTRUCTION	
VERTICAL:	1 : 50		
DATE	10.03.23	DATE	

ORIGINAL DRAWING REVISION "00" SEALED BY B.L. McINTOSH, P. ENG. 2010.05.13

CONSULTANT DRAWING NO.
1000120100-DWG-C0006-01

Winnipeg
THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

2010 - WATERMAIN RENEWALS AND SEWER REHABILITATION
CONTRACT 11
350 DIA WATERMAIN ABANDONMENT
HUGO STREET N
PEMBINA HIGHWAY TO
10m SOUTH OF FLEET AVENUE

CITY DRAWING NUMBER D-12029
SHEET 6 OF 10
C0006