

**PARTIAL MAIN FLOOR PLAN - ELECTRICAL, DATA & PHONE DEMOLITION**  
SCALE: 1/8"=1'-0"

**ELECTRICAL SYMBOLS**

REMOVE COMPONENTS & WIRING BACK TO SOURCE		ELECTRICAL SYMBOLS	
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
	DUPLEX RECEPTACLE		SMOKE DETECTOR (IONIZATION)
	FLOOR DUPLEX RECEPT.		HEAT DETECTOR (Fixed T.)
	POWERPOLE		SINGLR POLE SWITCH
	ELECTRIC IN-WALL HEATER (EXIST.)		LIGHT SWITCH WIRED AS LIGHTING SWITCH "3" NOT ELECTRICAL CIRCUIT ASSOCIATED WITH ELECTRICAL PANEL
	FIRE ALARM BELL		2-GANG SWITCHES
	FIRE ALARM PULL STATION		THERMOSTAT (EXIST.)
	TELEPHONE - WALL		EXISTING DEVICE
	FLOOR TELEPHONE		NEW DEVICE
	EMERGENCY LITE HEAD		REPLACE & REWIRE
	DATA		MOTION DETECTOR
			CONTROL VALVE (EXIST.)
			JOHNSON CONTROLS (EXIST.)
			KEY PAD SECURITY (EXIST.)
			KEY PAD SWITCH (EXIST.)


**ELECTRICAL SYMBOLS**

	ELECTRICAL JUNCTION BOX ABOVE CEILING FOR 5 WORKSTATIONS (NEW)
	DATA JUNCTION BOX ABOVE CEILING FOR 5 WORKSTATIONS (NEW)
	PHONE JUNCTION BOX ABOVE CEILING FOR 5 WORKSTATIONS (NEW) COORDINATE WITH MTS

**ELECTRICAL DEMOLITION NOTES:**

REFER TO NOTES.  
----- INDICATES DEMOLITION, INCLUDES ELECTRICAL SYMBOLS

- REMOVE (SHOWN IN DASH) RECEPTACLES, CONNECTORS, & ASSOCIATED WIRING BACK TO SOURCE. TYPICAL.
- REMOVE (SHOWN IN DASH) COMPLETE DATA BOX, CONNECTOR, & ASSOCIATED CABLING BACK TO SOURCE. TYPICAL.
- REMOVE DATA CONNECTOR & CABLING BACK TO SOURCE. DO NOT REMOVE DATA BOX IN WALL. TYPICAL.
- REMOVE (SHOWN IN DASHED) FLOURESCENT LIGHTING AND RELOCATE AS SHOWN ON DRAWING E2.1 TYPICAL.
- RELOCATE SECURITY KEY PAD & SWITCH. CONTACT CITY OF WINNIPEG, CENTRAL CONTROLS, PH. 986-2351 PRIOR TO RELOCATE.

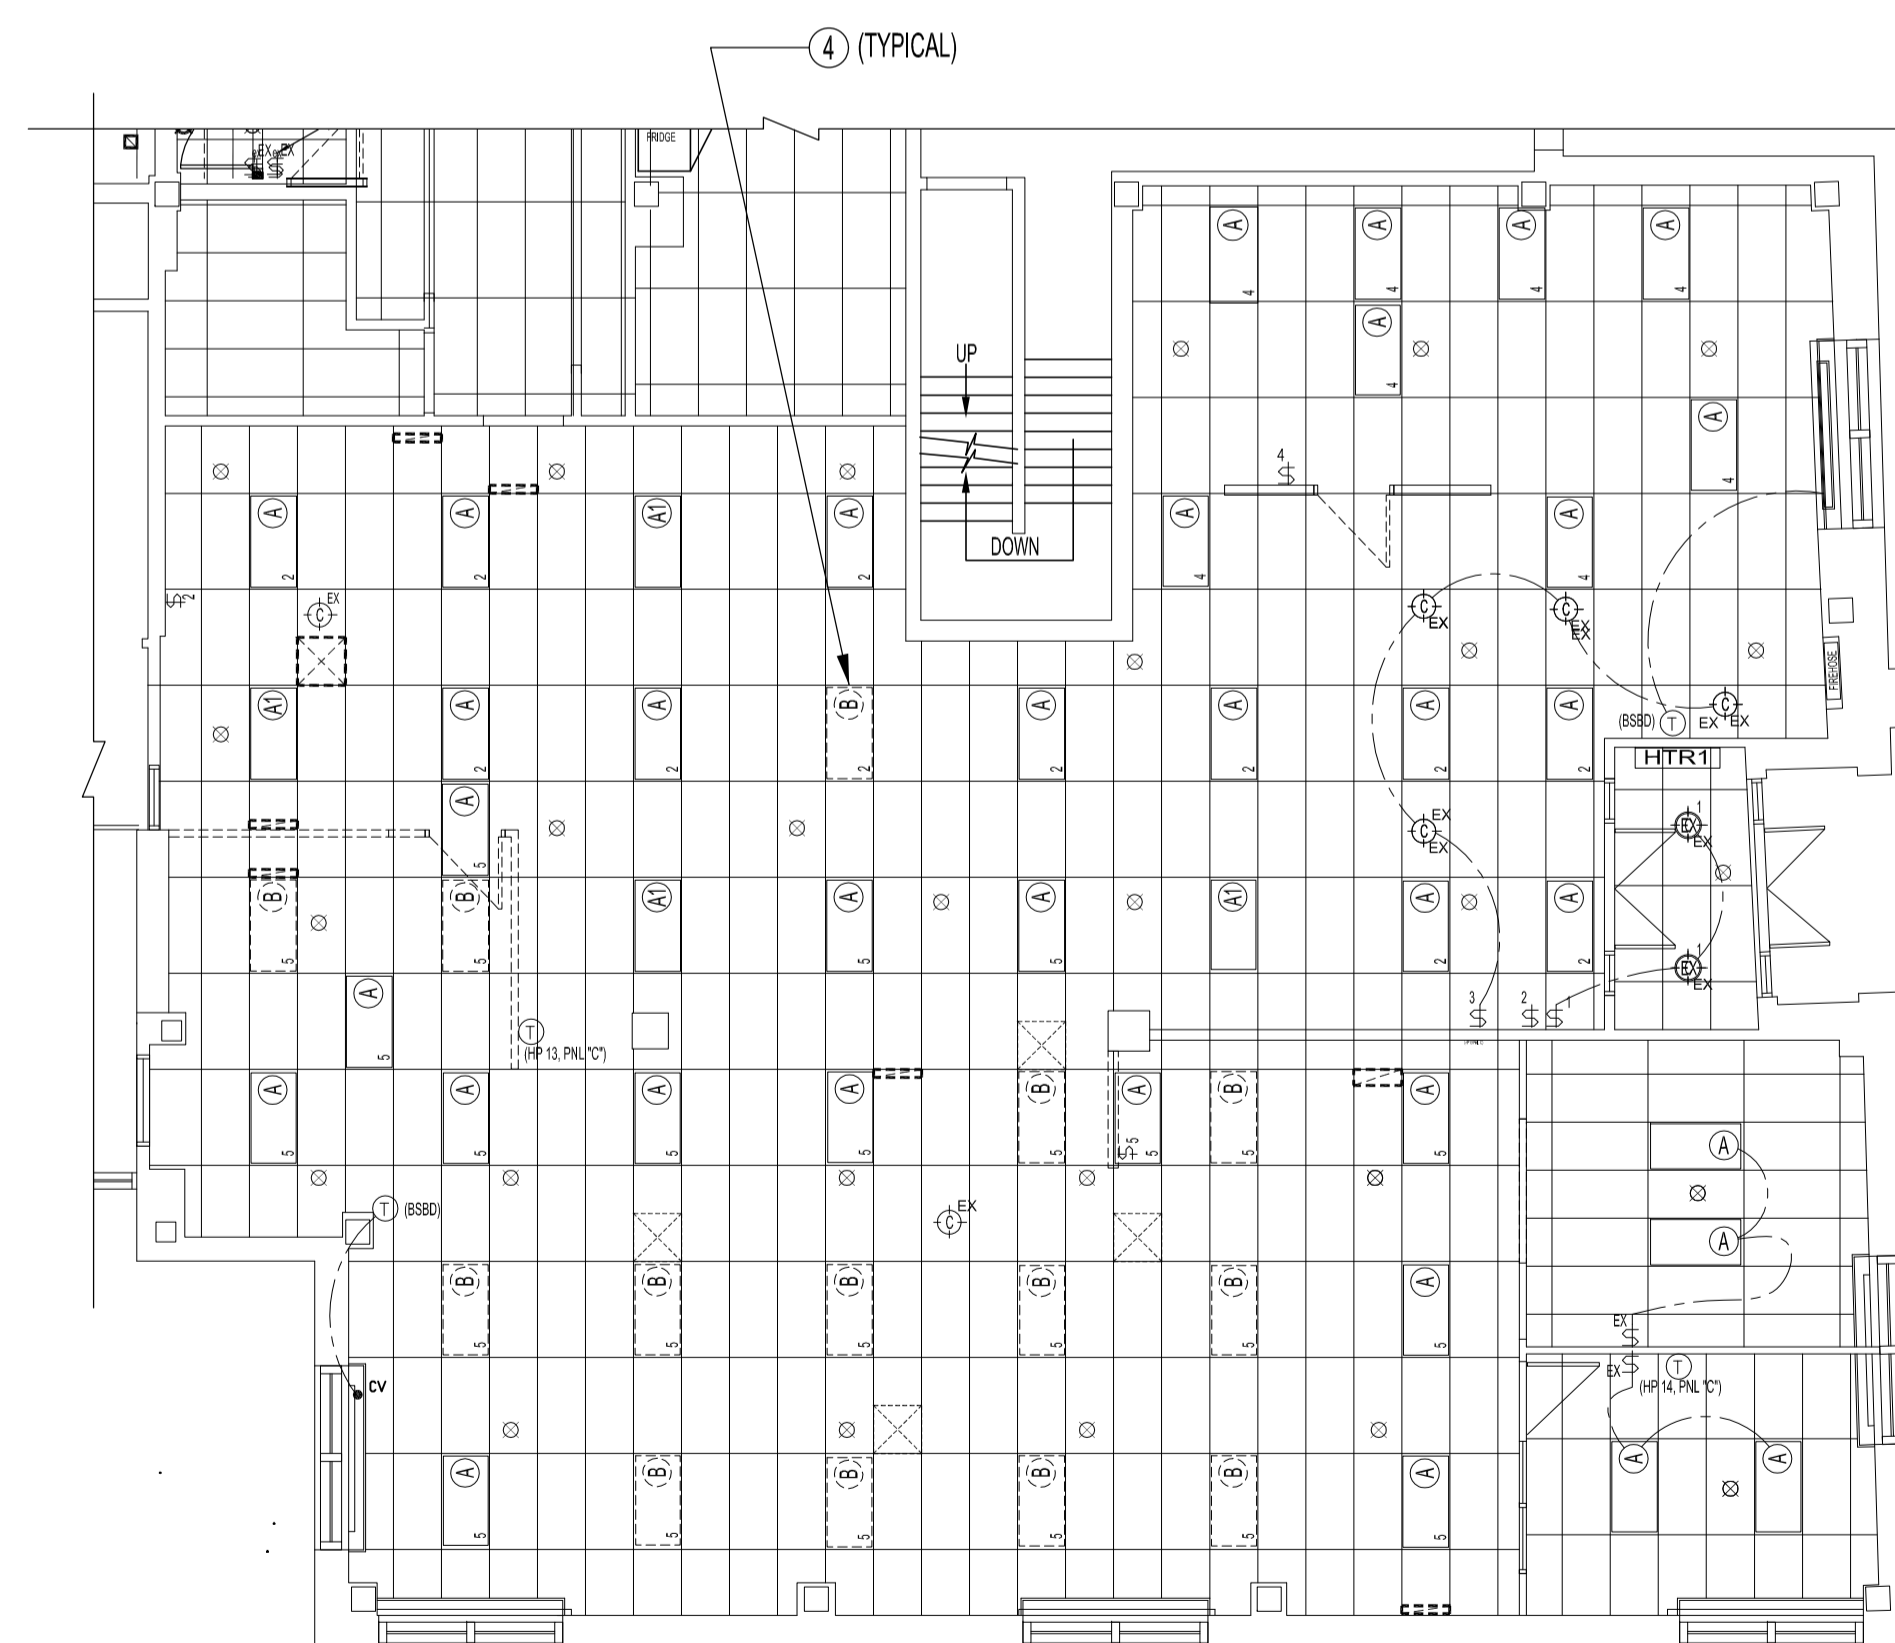

**PARTIAL MAIN FLOOR REFLECTED CEILING PLAN - DEMOLITION**  
SCALE: 1/8"=1'-0"

**NOTES :**

- THESE DRAWINGS SHALL NOT BE SCALED.
- THE CONTRACTOR SHALL VISIT THE SITE AND SATISFY HIMSELF ALL DIMENSIONS, DATUM, AND DETAILED INFORMATION SHOWN ARE CORRECT.
- THE CONTRACTOR IS TO REPORT ANY DISCREPANCIES PRIOR TO COMMENCEMENT OF WORK.
- THE CONTRACTOR IS TO REVIEW AND COORDINATE ALL ARCHITECTURAL, MECHANICAL AND ELECTRICAL DRAWINGS FOR ADDITIONAL OPENINGS THROUGH FLOORS, WALLS, AND CEILINGS FOR DUCT, PIPE & ELECTRICAL RISERS AND ALL OPENINGS NOT SHOWN ON DRAWINGS.
- ALL OPENINGS THROUGH FIRE ASSEMBLIES ARE TO BE FIRE STOPPED AND SEALED WITH ULC APPROVED FIRE STOPPING TO MAINTAIN THE INTEGRITY OF THE FIRE SEPARATION AND PROVIDE A SMOKE-TIGHT BARRIER.
- ALL PRODUCTS AND MATERIALS TO BE USED AND INSTALLED SHALL CONFORM WITH MANUFACTURER'S SPECIFICATIONS & APPLICABLE CODES.
- THE CONTRACTOR SHALL BE RESPONSIBLE TO PATCH AND MAKE GOOD ALL EXISTING CONSTRUCTION AFFECTED BY THE REMOVAL OF ALL ITEMS FORMING THE PART OF THE RENOVATION WORK.
- WHERE NEW FLOORING AND BASE IS TO BE INSTALLED IN EXISTING AREAS (REFER TO FLOOR PLAN AND ROOM SCHEDULE) THE EXISTING FLOORING SURFACE AND BASE MUST BE REMOVED UNLESS OTHERWISE NOTED. ALL FLOOR SURFACES SHALL BE PREPARED IN ACCORDANCE TO MANUFACTURER'S RECOMMENDATIONS FOR INSTALLATION OF NEW FLOOR.
- WHERE PAINTING OF EXISTING WALLS IS INDICATED ON THE ROOM SCHEDULE, THESE WALLS MUST BE CLEANED OF ANY EXISTING WALL COVERING, PATCHED & PREPARED TO ACCEPT NEW MATERIAL, UNLESS OTHERWISE NOTED.
- ALL NEW LIGHTING FIXTURES & NEW RECEPTACLES TO BE CONNECTED TO APPROPRIATE PANELS, EXCEPT FOR EMERGENCY LIGHT REMOTE HEADS TO BE CONNECTED TO EMERGENCY LIGHT BATTERY PACK(S).
- CONTRACTOR MAY REUSE EXISTING BREAKERS & WIRING PROVIDED SAME IS IN GOOD CONDITION & MEETS ALL APPLICABLE CODES.
- GENERAL DUTY RECEPTACLES SHALL BE CSA APPROVED, WHITE C/W STAINLESS STEEL TRIM PLATES MOUNTED AS EXISTING, EXCEPT AS NOTED.
- SUPPLY & INSTALL LAMACOID NAME PLATES ON ALL PANEL BOARDS, SWITCHES & RECEPTACLES. ELECTRICAL PANEL SCHEDULE SHALL BE TYPED & ADHERED TO INSIDE OF ASSOCIATED ELECTRICAL PANEL DOOR.
- ALL ABANDONED ELECTRICAL FIXTURES, COMPONENTS & RECEPTACLE WIRINGS SHALL BE REMOVED BACK TO SOURCE.

**DRAWING LIST**

SHEET No:	SHEET TITLE
E1.1	PARTIAL MAIN FLOOR PLAN - ELECTRICAL, DATA & PHONE DEMOLITION, REFLECTED CEILING.
E2.1	PARTIAL MAIN FLOOR PLAN - ELECTRICAL, DATA & PHONE RENOVATION, REFLECTED CEILING.
E3.1	ELECTRICAL & CATEGORY 6 CABLING SPECIFICATIONS

NO.	REVISION/DESCRIPTION	BY	DATE
SEALS			

ORIGINAL STAMPED BY: D.A.PALEY, P.ENG  
DATE: 2008.12.29

DRAWN BY	MBD	CHECKED BY	APPROVED
DATE	2008.12.23	USER	APPROVAL

**CITY OF WINNIPEG**  
PLANNING, PROPERTY AND DEVELOPMENT DEPARTMENT  
CIVIC ACCOMMODATIONS DIVISION  
300 - 65 GARRY ST. R3C 4K4

PROJECT  
MANDARIN BUILDING  
WFPS RELOCATION TO MAIN FLOOR

185 KING STREET

**SHEET TITLE**  
PARTIAL MAIN FLOOR PLAN  
ELECTRICAL, DATA & PHONE  
DEMOLITION, REFLECTED CEILING

SCALE	PROJECT NO.	SHEET NO.
AS SHOWN	2008-059-01	E1.1