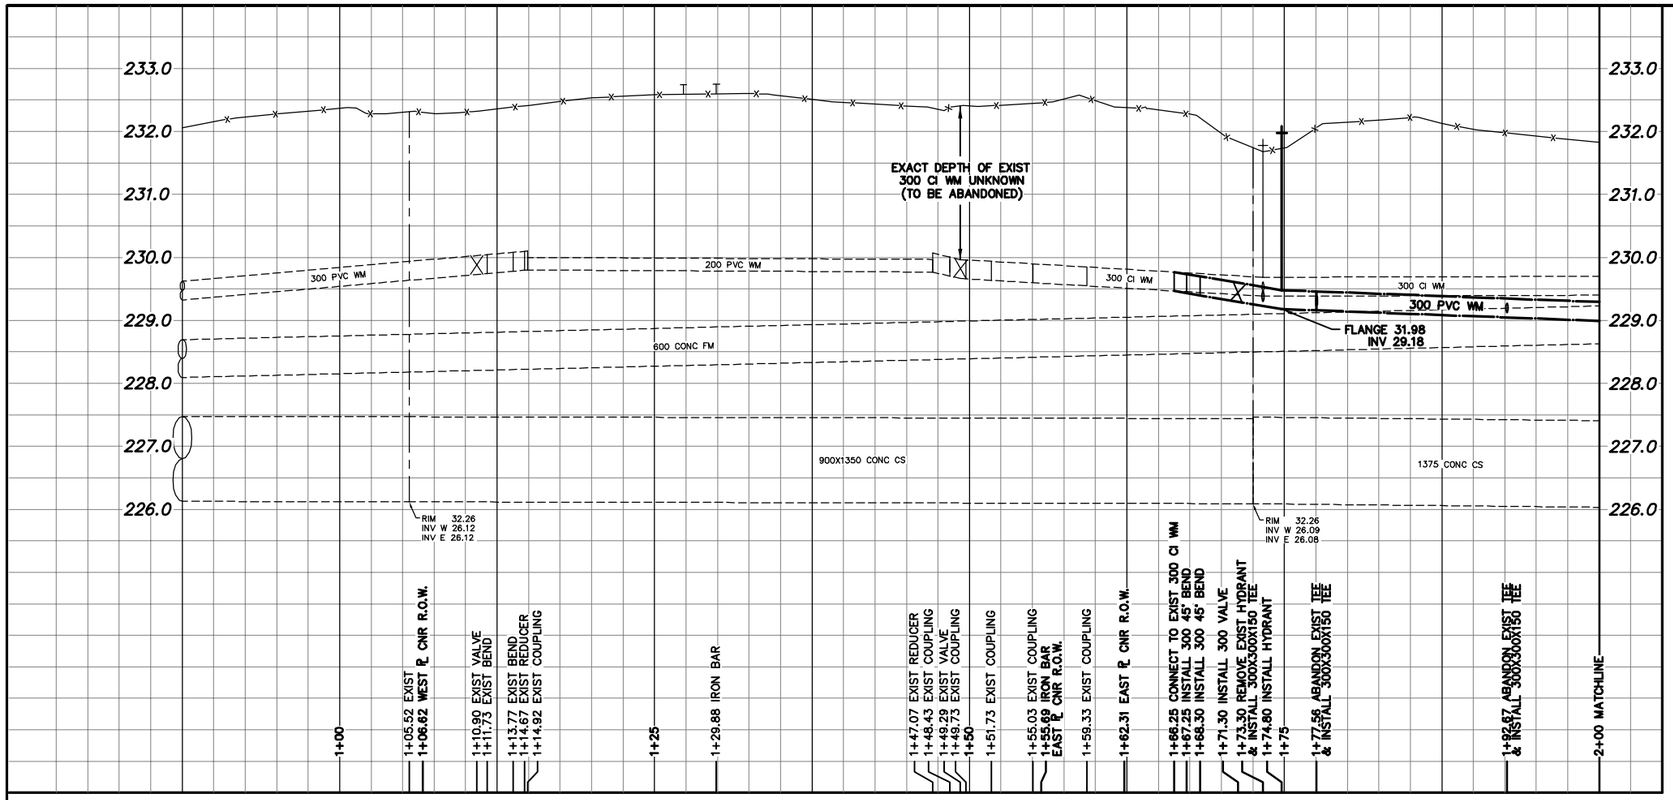

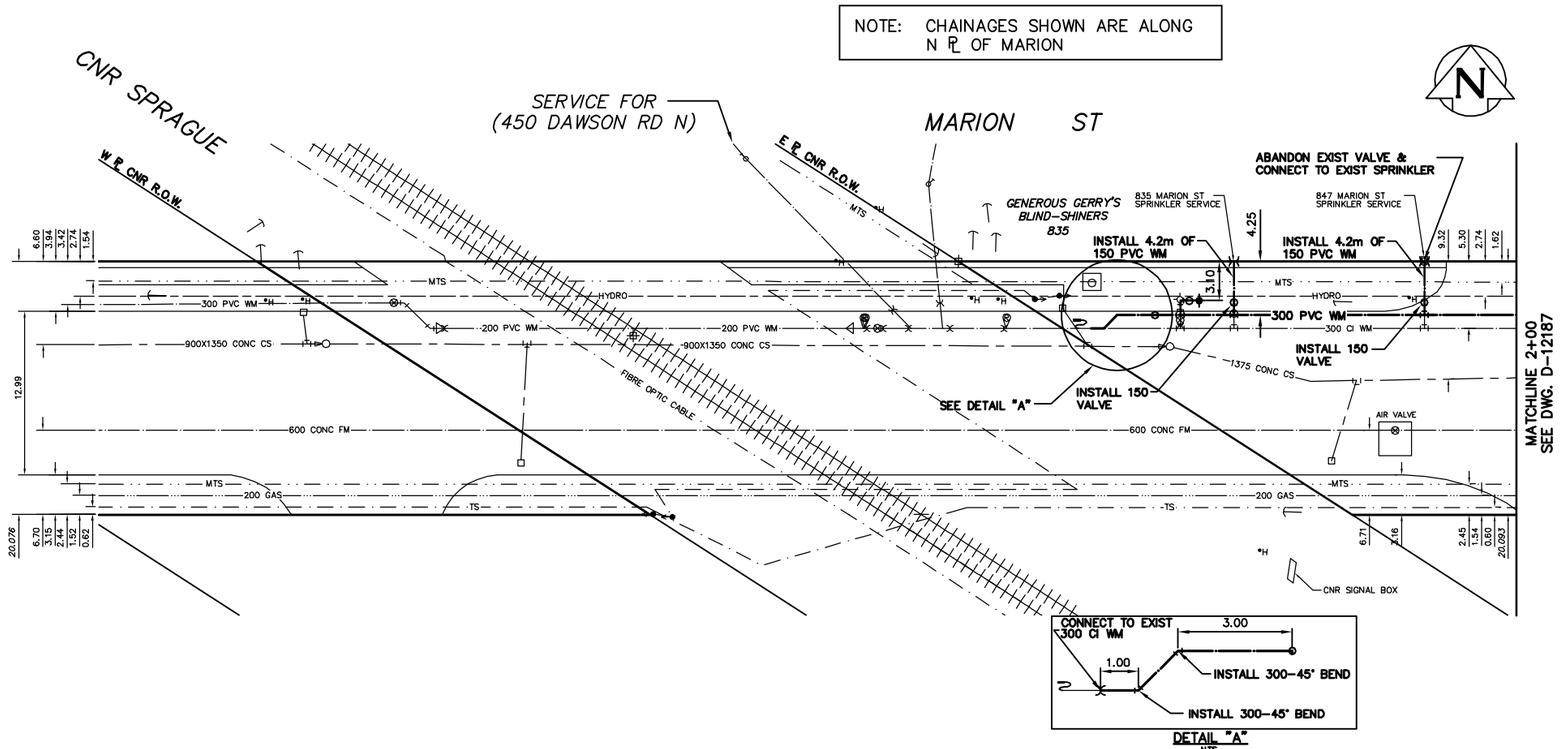

WATER SERVICE INFORMATION

	ADDRESS	SIZE(mm) & TYPE (STREET)	SIZE(mm) & TYPE (PROP)	SHORT & LONG MEASUREMENT	CORP. LOCATION	
*	835 MARION ST SPRINKLER	– –	– –	21.9 E OF W PL #835 MARION –	OPP OF TEE –	RENEW W/ 150 PVC
*	847 MARION ST SPRINKLER	– –	– –	36.9 E OF W PL #835 MARION –	OPP OF TEE –	RENEW W/ 150 PVC
*	853 MARION ST COMMERCIAL	– –	20 COPPER –	53.95 W OF HYDRANT –	– –	RENEW W/ 25 COPPER
*	853 MARION ST SPRINKLER	– –	UNKNOWN –	5.1 m WELL #860 MARION –	OPP OF TEE –	RENEW W/ 150 PVC
*	857 MARION ST COMMERCIAL	20 COPPER	20 COPPER	32 W OF E SIDE OF BLDG	3.1 E OF S/C	RENEW W/ 25 COPPER
	857 MARION ST SPRINKLER	200 PVC	200 PVC	7.9 W 1ST HYDRANT W PANET RD –	– –	– –
	860 MARION ST COMMERCIAL	– –	– –	UNKNOWN –	– –	– –
*	861 MARION ST COMMERCIAL	– –	20 COPPER –	7.7 W OF E SIDE OF BLDG 15.6 E OF HYDRANT	10.3 W OF S/C –	RENEW W/ 25 COPPER
*	864 MARION ST COMMERCIAL	– –	UNKNOWN –	2.21 E OF E PL –	– –	RENEW W/ 25 COPPER
	874 MARION ST COMMERCIAL	– –	– –	– –	– –	SERVICED FROM DAWSON –

* SERVICES TO BE RENEWED TO ℄ ALL OTHERS TO BE RECONNECTED

CONSTRUCTION NOTES

1. EXPOSE EXISTING WATERMAIN & CONFIRM INVERTS PRIOR TO CONSTRUCTION.
2. LOCATION OF ALL SERVICES TO BE CONFIRMED IN THE FIELD.
3. INSTALL WATERMAIN BY TRENCHLESS METHODS.
4. TRENCHES AND EXCAVATIONS WITHIN 1 METRE OF A PAVED AREA INCLUDING SIDEWALKS SHALL BE CLASS 3 BACKFILL.
5. ALL MATERIALS SHALL CONFORM TO THE CITY OF WINNIPEG STANDARD CONSTRUCTION SPECIFICATIONS.
6. MINIMUM COVER TO TOP OF WATERMAIN SHALL BE 2.4 m.
7. REPLACE ALL EXISTING LEAD SERVICES FROM PROPOSED WATERMAIN TO ℄.
8. NOTIFY ALL AFFECTED RESIDENTS AND BUSINESSES 24 HOURS IN ADVANCE OF ANY WATER SHUTDOWNS OR DISRUPTION OF SERVICE.

0.0 5.0 10.0 15.0 20.0 25.0

METRIC
WHOLE NUMBERS INDICATE MILLIMETRES
DECIMALIZED NUMBERS INDICATE METRES

NOTE: ALL VALVES TO BE INSTALLED CLOCKWISE TO CLOSE

WARNING

IF POWER EQUIPMENT OR EXPLOSIVES ARE TO BE USED FOR EXCAVATION ON THIS PROJECT THE CONTRACTOR MUST:
1) NOTIFY THE GAS COMPANY OF THE PROPOSED LOCATION OF EXCAVATION.
2) TAKE PRECAUTION TO AVOID DAMAGE TO GAS COMPANY INSTALLATIONS.

SEE PROVINCIAL REGULATION 210/72 FOR DETAILS

PROPOSED	LEGEND–PLAN	PROPOSED	EXISTING	LEGEND–PLAN	PROPOSED	EXISTING	LEGEND–PROFILE	PROPOSED
200 WM	WATERMAIN	200 WM		SL , HYDRO		150 WM	WATERMAIN	150 WM
⊹	HYDRANT	✦		MTS			HYDRANT	+
⊗	VALVE	⊙		TRAFFIC SIGNALS			VALVE	X
525 LDS	LAND DRAINAGE SEWER	525 LDS	50 GAS	GAS	50 GAS	300 LDS	LAND DRAINAGE SEWER	300 LDS
375 WWS	WASTEWATER SEWER	375 WWS		SURVEY BAR		250 WWS	WASTEWATER SEWER	250 WWS
○	MANHOLE	●		FENCE			℄ PROFILE	
□	CATCH BASIN	■		POLE – HYDRO, MTS			GROUND ABOVE PIPE	
▽	CURB INLET	▼		CURB STOP			℄ DITCH (NORTH & WEST)	
◁	REDUCER	◀		GUY ANCHOR			℄ DITCH (SOUTH & EAST)	
X	COUPLER	X		LIGHT STANDARD			GUTTER (NORTH & WEST)	
⊇	ANODE	⊇		TREE			GUTTER (SOUTH & EAST)	

LOCATION APPROVED
UNDERGROUND STRUCTURES

SUPV. U/G STRUCTURES COMMITTEE — DATE

NOTE:
LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.

B.M. ELEV. | FIELD BOOK #:
POSTED TO LBIS

NO.	REVISIONS	DATE	BY

CITY OF WINNIPEG
WATER AND WASTE
ENGINEERING DIVISION

DESIGNED BY	DB	CHECKED BY	KZ/SC
DRAWN BY	KB	APPROVED BY	KZ
HOR. SCALE	1:250	RELEASED FOR CONSTRUCTION	
VERTICAL	1:50		
DATE	2010 08 11	DATE	

ENGINEER'S SEAL
ORIGINAL SIGNED BY K.R. ZUREK 10/08/11

BID OPPORTUNITY 616–2010
FILENAME : marion_dawson.dwg
PLOT DATE: 2010 08 11

Winnipeg
THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

2010 WATERMAIN RENEWALS

MARION STREET
CNR SPRAGUE RAILWAY TO 138m W OF DAWSON ROAD

SHEET 1 OF 3

CITY DRAWING NUMBER
D–12186