

BAR SCHEDULE PER TANK

DIGESTER TANK BAR SUPPORTS.

MARK	TOTAL NO.	SIZE	LENGTH	SKETCH	LOCATION
D501	142	5/8"	10'0"	STR.	HEAD RODS
D502	12	1/2"	7'0"	✓	✓
D503	2	1/2"	4'0"	✓	✓

1850 LIN. FT. SPACER U570 (1 1/2" HIGH)
 250- 5 1/2" HY. CHAIRS
 350- 6 1/2" ✓
 60- 9 1/2" ✓


NOTE - ALL BAR SUPPORTS TO BE GALVANIZED.

BAR SCHEDULE PER TANK

DIGESTER TANK MIXER OPENINGS.

MARK	TOTAL NO.	SIZE	LENGTH	SKETCH	LOCATION
D401	4	3/4"	22'3"	CB 7 1/2" OUT. DIA. (WELDED RINGS)	6'0 3/4" OPENING
D402	4	1/2"	19'11"	CB 6 1/2" OUT. DIA. (WELDED RINGS)	DO.
D403	76	1/2"	4'3"	1'6" x 2'9"	DO.
D404	2	1/2"	15'10"	CB 5 1/2" OUT. DIA. (WELDED RINGS)	4'0" OPENING
D405	2	1/2"	13'6"	CB 4 1/2" OUT. DIA. (WELDED RINGS)	DO.
D406	26	1/2"	4'3"	1'6" x 2'9"	DO.
D601	2	3/4"	19'11"	CB 6 1/2" OUT. DIA. (WELDED RINGS)	6'0 3/4" OPENING
D602	1	1/2"	13'6"	CB 4 1/2" OUT. DIA. (WELDED RINGS)	4'0"

NOTE - 4 TANKS THUS.

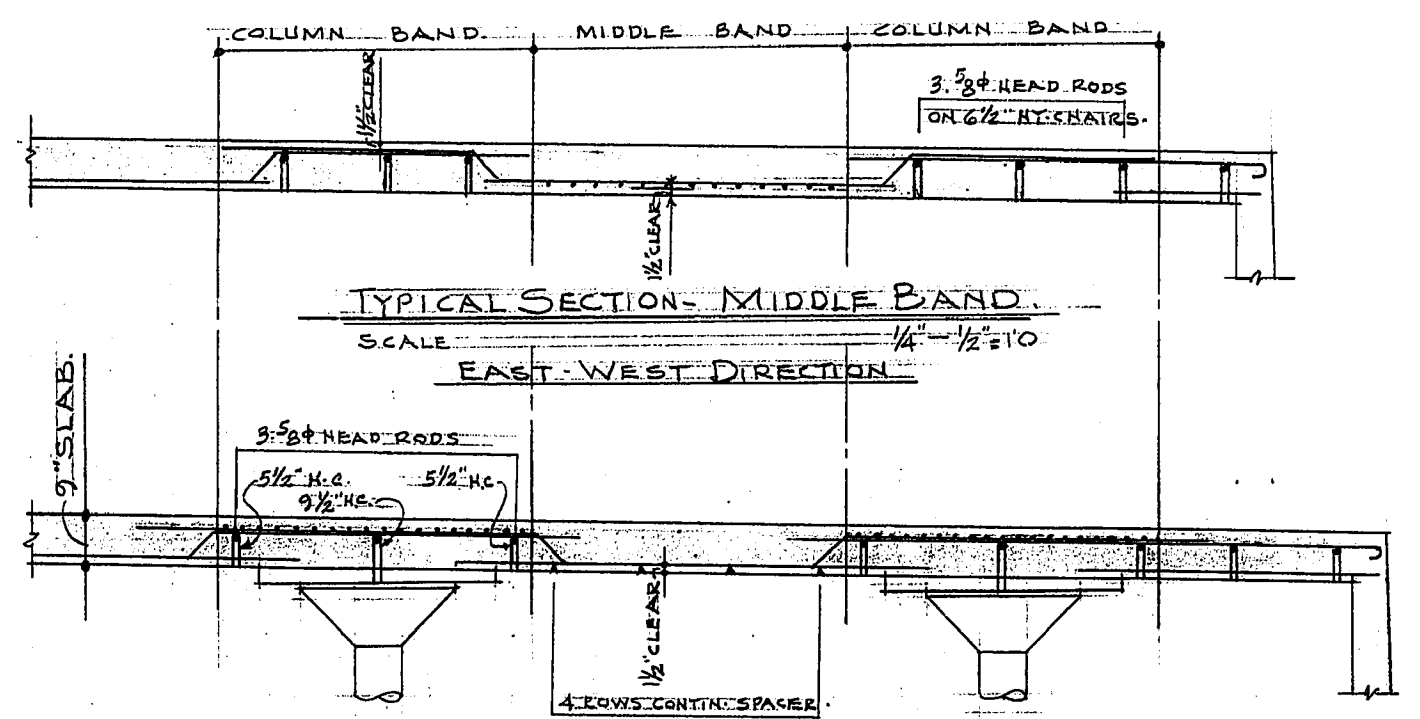

GENERAL NOTES:
 H.C. DENOTES HY. CHAIRS

DIGESTER TANK ROOF PLAN
 BAR SUPPORT PLAN - ALL TANKS
 SCALE 1/4" = 1'0"

NO.	DESCRIPTION	DATE



GREATER WINNIPEG SANITARY DISTRICT

DRAWN BY: <i>D.J.</i> DATE: <i>Oct 1932</i> CHECKED BY: <i>[Signature]</i> DIVISION: <i>[Signature]</i> Supt. OR DISTRICT: <i>[Signature]</i> GEN. MGR. FOR CONSULTING ENGINEERS	W. D. HURTT CHAIRMAN OF COMMISSIONERS N. S. BUDDIS GENERAL MANAGER ALVORD, FURFICK & H. W. WYMAN CONSULTING ENGINEERS	TITLE DIGESTION TANK ROOF PLAN BAR SUPPORT - ALL TANKS SCALE: DRAWING NOTED. PE 33
----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------