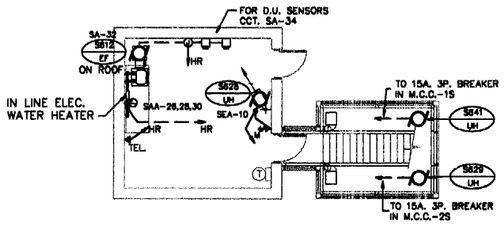

1 / SE5 SE5 MIXED LIQUOR BUILDING
SCALE 1:100

NOTES:

1. UTILIZE PVC JACKETTED TECK CABLE FOR ALL POWER WIRING, WIRING FOR LIGHTING, RECEPTACLES AND COMMUNICATIONS TO BE IN RIGID ALUMINUM CONDUIT.
2. ALL CONDUIT TO BE MINIMUM 19mm∅ CONDUIT UNLESS OTHERWISE NOTED.

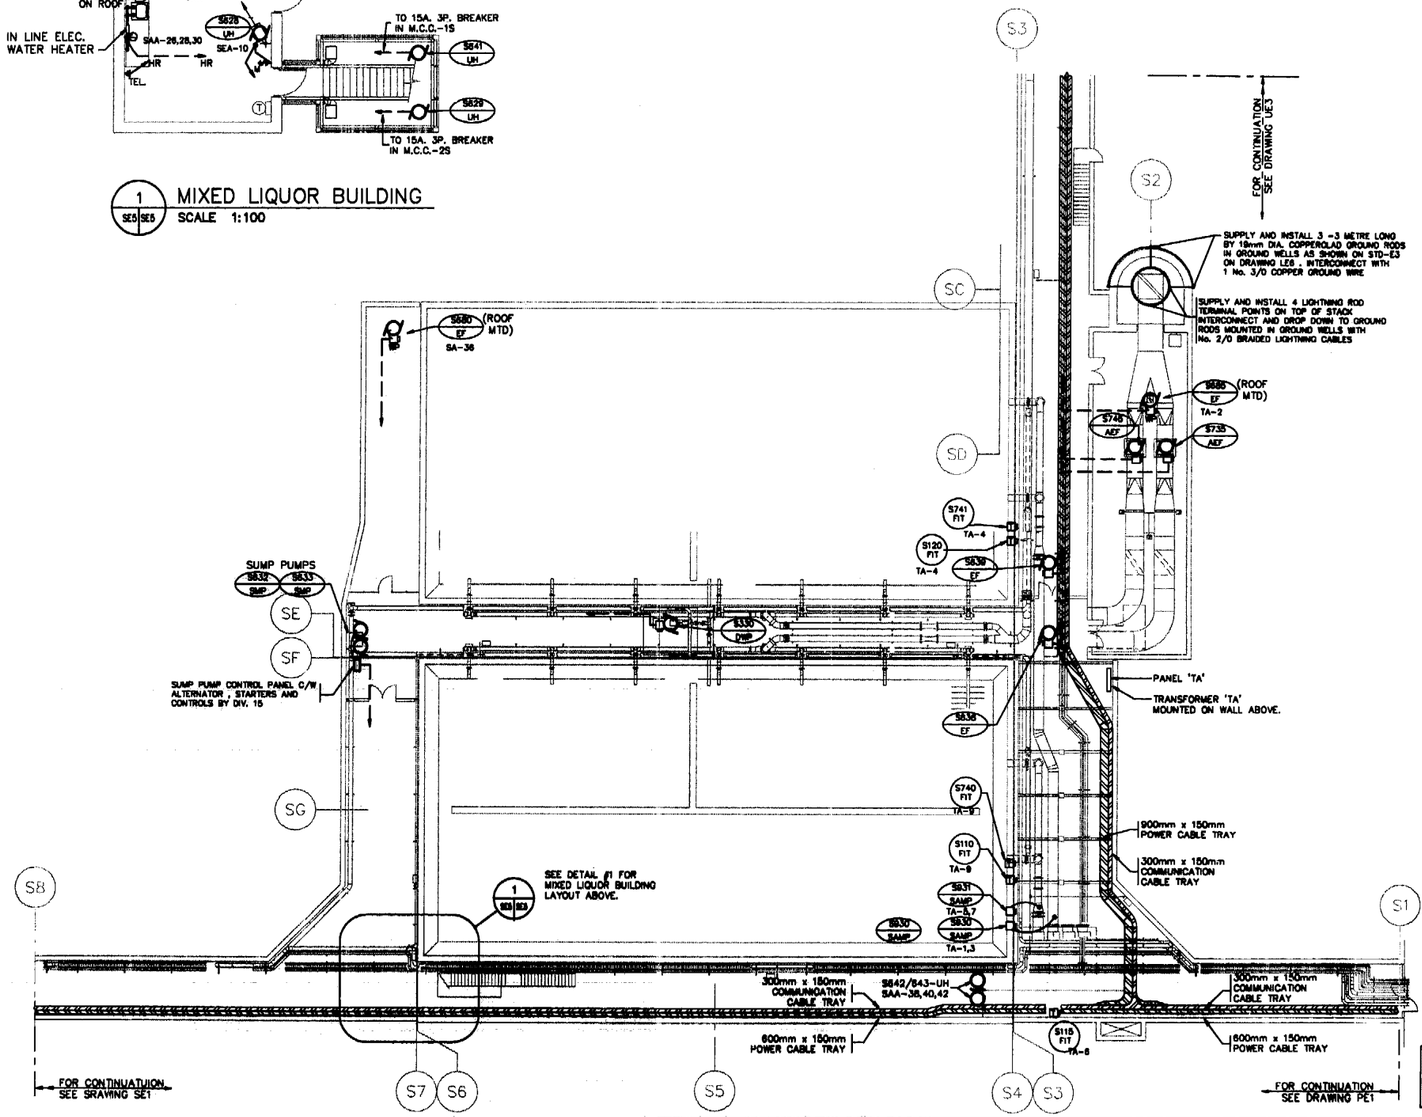

THE ENGINEER THAT SEALED THIS DRAWING IS RESPONSIBLE FOR ONLY THE AS-CONSTRUCTED CHANGES ON THIS DRAWING.

THE ORIGINAL DESIGN WAS THE RESPONSIBILITY OF THE DESIGN ENGINEER WHO SEALED THE ISSUED FOR TENDER DRAWINGS IN 1991.

REID, CROWTHER & PARTNERS LIMITED
WINNIPEG
AS CONSTRUCTED
SIG. ..... DATE NOV 29/94

detail symbol
A detail number
B drawing where detail shown
C cross reference to drawing where detail taken

B.M. 69-006
ELEV. 237.636 m

NO.	REVISIONS	DATE	BY
1	AS BUILT	93/11	DE
0	ISSUED FOR TENDER		

Reid Crowther

DESIGNED BY	LT	CHECKED BY	DJS
DRAWN BY	EJS	APPROVED BY	
HOR. SCALE:	1:200	RELEASED FOR CONSTRUCTION:	
VERTICAL:			
DATE	91-06-06	DATE	

ENGINEER'S SEAL
PROVINCE OF MANITOBA D.J. STRYK 9-91 ENGINEERING SERVICES

CONSULTANT DRAWING NO.
60910 - SE5

THE CITY OF WINNIPEG
WORKS AND OPERATIONS DIVISION
WATERWORKS WASTE AND DISPOSAL DEPT.

WEST END WATER POLLUTION CONTROL CENTRE EXPANSION
AREA S - AERATION BASIN

CITY DRAWING NUMBER
SHEET OF

AERATION BASIN LOWER LEVEL ELECTRICAL POWER LAYOUT

WEP-271

REVISED-1
PEP-ALT
91-06-06

File # WS10326