


KEY PLAN

NOTES:

- 1. EXISTING SIX FORCED AIR FANS TO BE REPLACED WITH NEW FORCED AIR FANS. DISCONNECT AND RECONNECT ELECTRICAL POWER.
- 2. PROVIDE POWER TO NEW 7kW HEATING COIL WITHIN DUCT FROM 600VAC PANEL WITHIN ELECTRICAL ROOM. HEATING COIL SHALL BE RATED FOR 600VAC.

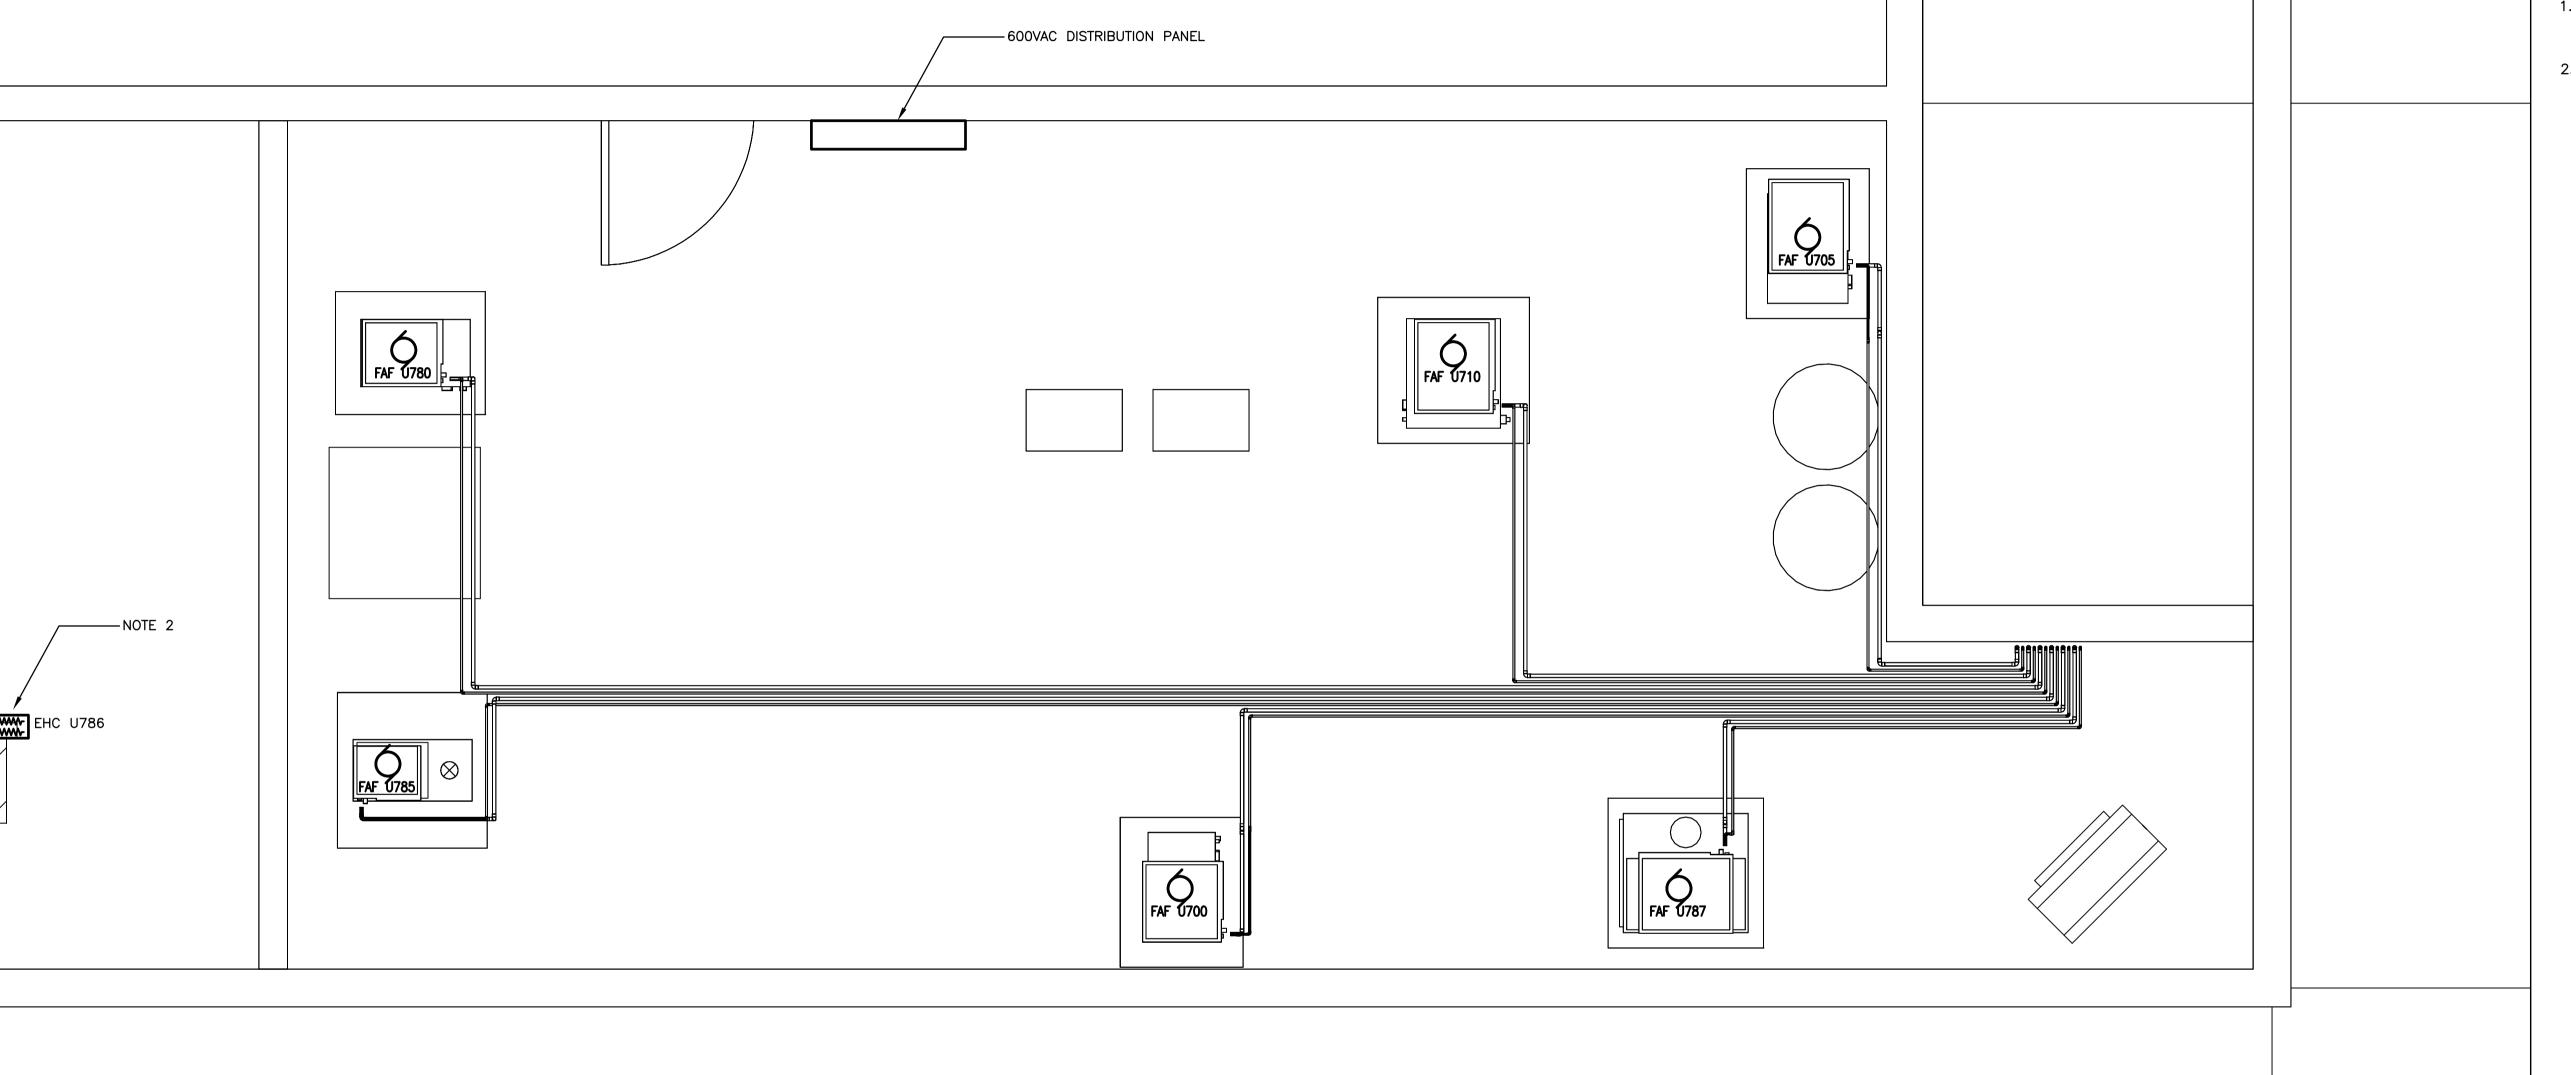

) MECHANICAL ROOM — ELECTRICAL SCALE 1:25

Certificate of Authorization
KGS Group
No. 245 Date: 2011/02/10

KGS Group

CONSULTING
ENGINEERS

01 ISSUED FOR ADDENDUM
00 ISSUED FOR TENDER
REVISIONS **APEGN**

FIELD BOOK #: POSTED TO LBIS 2011-02-10 REW HOR. SCA 2010-12-21 REW VERTICAL DATE BY DATE

ALLIANCE Engineering Services Inc.

2010 12 02 DATE

APPROVED BY GCN RELEASED FOR CONSTRUCTION HOR. SCALE

ENGINEER'S SEAL THE ORIGINAL ISSUE
REV. 00 WAS
STAMPED, DATED AND
SIGNED BY:

Winnipeg R.E. WILLMS, P.ENG ON 2010/12/21

TENDER No. UE4.1
FILENAME: 1-0103V-E0021-001.dwg
PLOT DATE: 2011/02/10

THE CITY OF WINNIPEG WATER AND WASTE DEPARTMENT

2010 HVAC REPLACEMENT AND ASSOCIATED WORKS

WEWPCC AREA U — ADMINISTRATION BUILDING MECHANICAL ROOM — ELECTRICAL SHEET 1 OF 1 CITY DRAWING NUMBER

1-0103V-E0021-001