


CONSTRUCTION NOTES	
①	COMPRESSION LUGS REQUIRED.
②	CABLE FOR J26 AND J30 ON UPS MONITORING BOARD COMES PRE-WIRED TO MAINTENANCE BYPASS CABINET.
③	CONNECT PNL-G10 CCT. 1 TO TERMINAL STRIP IN PCU-SA.
④	RE-LABEL EXISTING WIRES FROM RE-NAMED PANEL PNL-G9 (WAS PNL-BG).

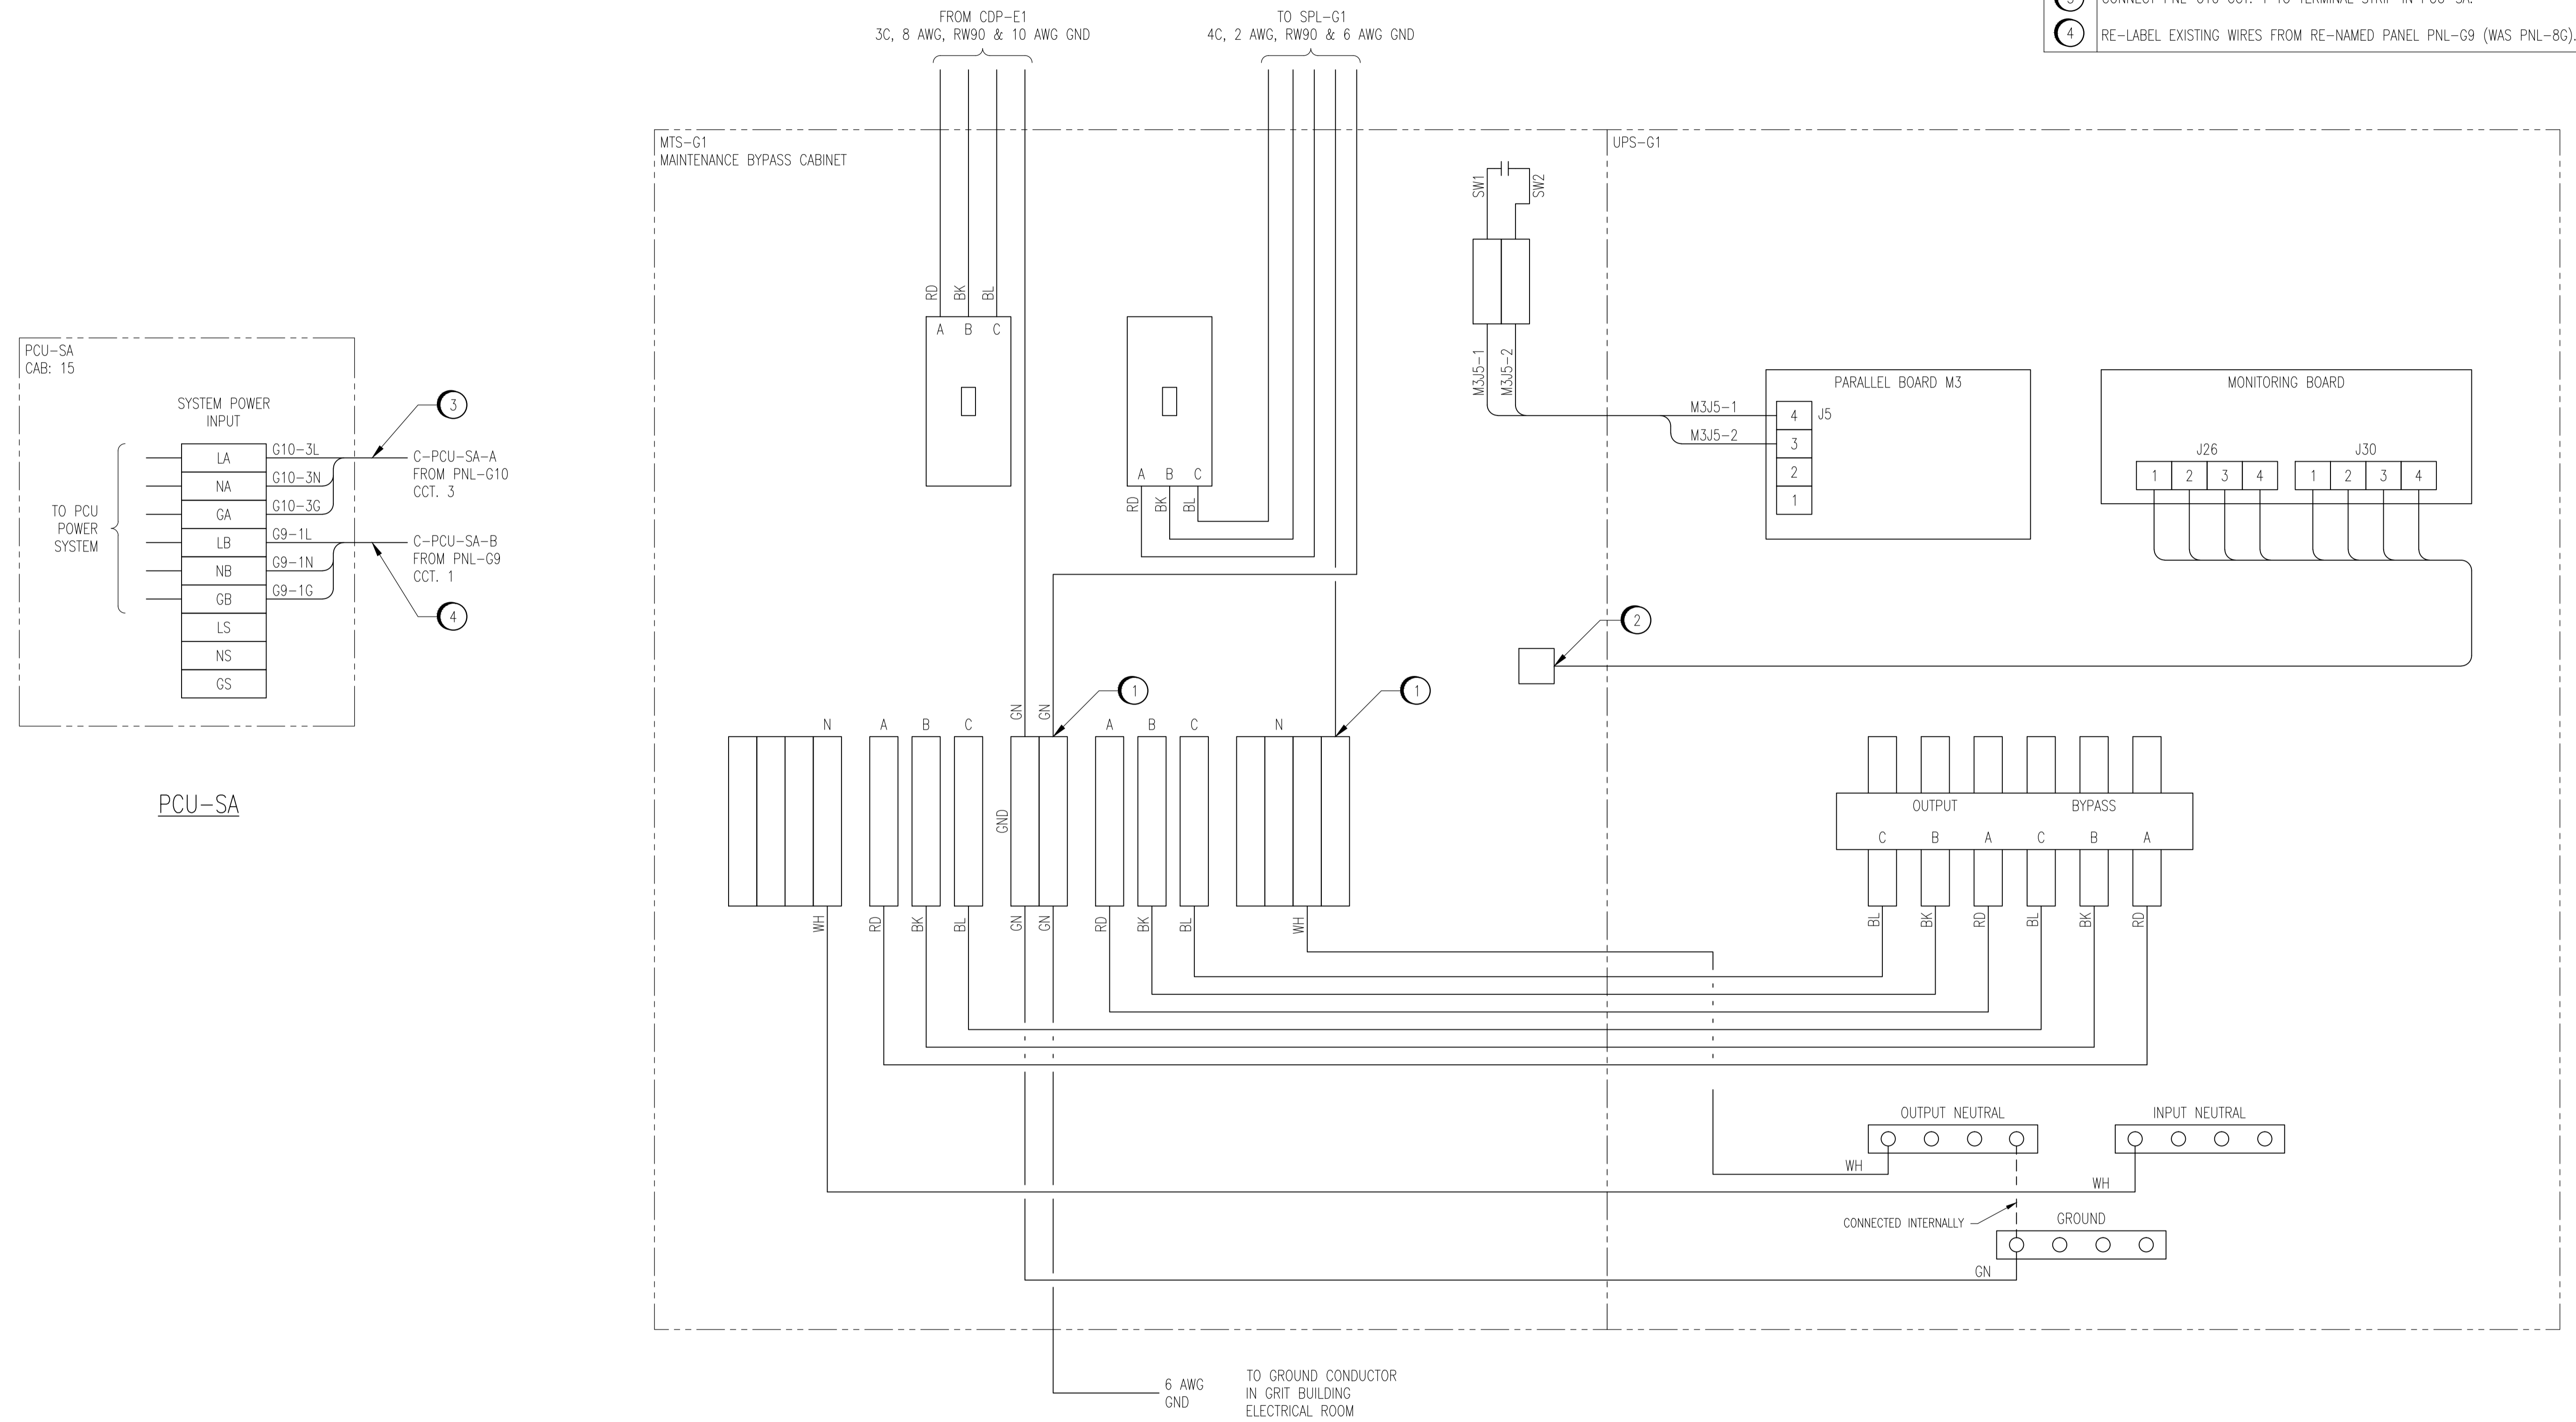

MTS-G1 AND UPS-G1

1-0102G-A0073	INSTRUMENT LOOP DIAGRAM - UPS-G1 ALARMS
DRAWING NUMBER	REFERENCE DRAWINGS

APECM
 Certificate of Authorization
SNC-Lavalin Inc.
 No. 4489

NO.	REVISIONS	DATE	DESIGN	CHECK
00	ISSUED FOR TENDER, BID OPP. 209-2011	2011/03/11	TMC	CJR

SNC-LAVALIN INC.
 148 Nature Park Way
 Winnipeg, MB, Canada R3P 0X7
 204-786-8080

DESIGNED BY: T. CHURCH
 CHECKED BY: C. REIMER
 DRAWN BY: S. COATES
 APPROVED BY: C. REIMER
 SCALE: NTS
 RELEASED FOR CONSTRUCTION BY: N. HARRINGTON
 DATE: 2009/10/28
 DATE: 2011/03/11
 CONSULTANT NO.: 112577-0106-47DD-0203

ENGINEER'S SEAL
 ORIGINAL DRAWING
 SEALED BY:
 T. M. CHURCH
 SNC-LAVALIN
 MEMBER #32682
 2011/03/25
 REV. 00

THE CITY OF WINNIPEG
 WATER AND WASTE DEPARTMENT

SOUTH END WATER POLLUTION CONTROL CENTRE
 ESSENTIAL SYSTEM UPGRADES
 WIRING DIAGRAM
 UPS-G1 & PCU-SA

CITY DRAWING NUMBER: 1-0102G-E0010
 SHEET: 001
 REV: 00
 SIZE: A1