


- NOTES:
- DISCONNECT AND REMOVE EXISTING CIRCUIT BREAKER OF CHILLER #1 AND CHILLER #2 FROM POWER PANEL "5D6-100" AND TURN BREAKERS OVER TO CITY.
 - DISCONNECT EXISTING FEEDERS FROM PANEL OF CHILLER #1 AND #2 AND REMOVE ALL EXISTING WIRING AND CONDUITS BETWEEN POWER PANEL "5D6-100" AND PANELS OF CHILLERS.
 - DISCONNECT AND REMOVE EXISTING MOTOR STARTER OF PUMP P-19, P-20, P-21 AND P-22 FROM MCC "MCC-1A" AND TURN MOTOR STARTERS OVER TO CITY.
 - DISCONNECT EXISTING FEEDERS FROM PUMP P-19, P-20, P-21 AND P-22 AND REMOVE ALL EXISTING WIRING AND CONDUITS BETWEEN "MCC-1A" AND PUMP P-19, P-20, P-21 AND P-22.
 - REMOVE EXISTING 30HP MOTORS AND HAND OVER TO CITY.

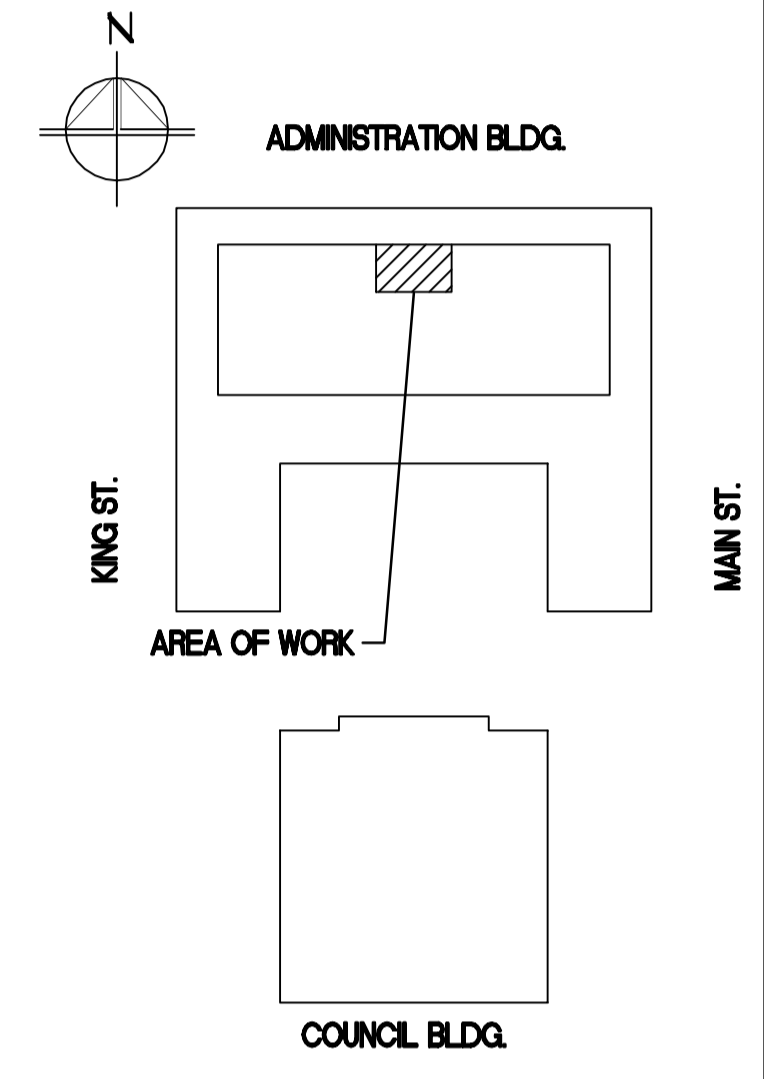


AECOM

This drawing has been prepared for the use of AECOM's client and may not be used, reproduced or relied upon by third parties, except as agreed by AECOM and its client, as required by law or for use by governmental reviewing agencies. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that modifies this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from stated dimensions.

0	ISSUED FOR TENDER	SS	2011.11.03
No.	REVISION/DESCRIPTION	BY	DATE

SEAL

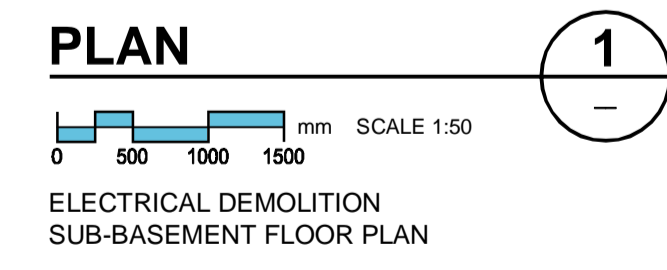

DRAWN	AL	CHECKED	AL	DESIGNED	AL	APPROVED	SS
DATE	2011.09.02	USER	APPROVAL				

THE CITY OF WINNIPEG
 PLANNING, PROPERTY AND DEVELOPMENT DEPARTMENT
 MUNICIPAL ACCOMMODATIONS DIVISION
 3-65 GARRY STREET, R3C 4K4

PROJECT
 ADMINISTRATION & COUNCIL BUILDING
 REPLACEMENT OF COOLING PLANT - 510 MAIN STREET
 BID OPPORTUNITY NO. 673-2011
 510 MAIN STREET, WINNIPEG, MANITOBA

APEGM
 Certificate of Authorization
 AECOM Canada Ltd.
 No. 4671 Date: _____

DRN	CHK	DES	ENG	IDR

AECOM REVIEW

SHEET TITLE
 ELECTRICAL DEMOLITION SUB-BASEMENT FLOOR PLAN

SCALE	PROJECT No:	SHEET No:
1:50	60220937	E-002

DRAWING SHEET SIZE: A1 (841mm x 594mm) PLOT 1:1