


CONTINUED AT RIGHT



FUSE SCHEDULE			
TB	IDENTIFIER	SIZE	RATED CURRENT (A)
TB03	5	5x20mm	0.2
	6	5x20mm	0.2
	8	5x20mm	0.2
	9	5x20mm	0.2
	10	5x20mm	0.2
	11	5x20mm	0.2
	12	5x20mm	0.2
	13	5x20mm	0.2
	14	5x20mm	0.2
	15	5x20mm	0.2
	16	5x20mm	0.2

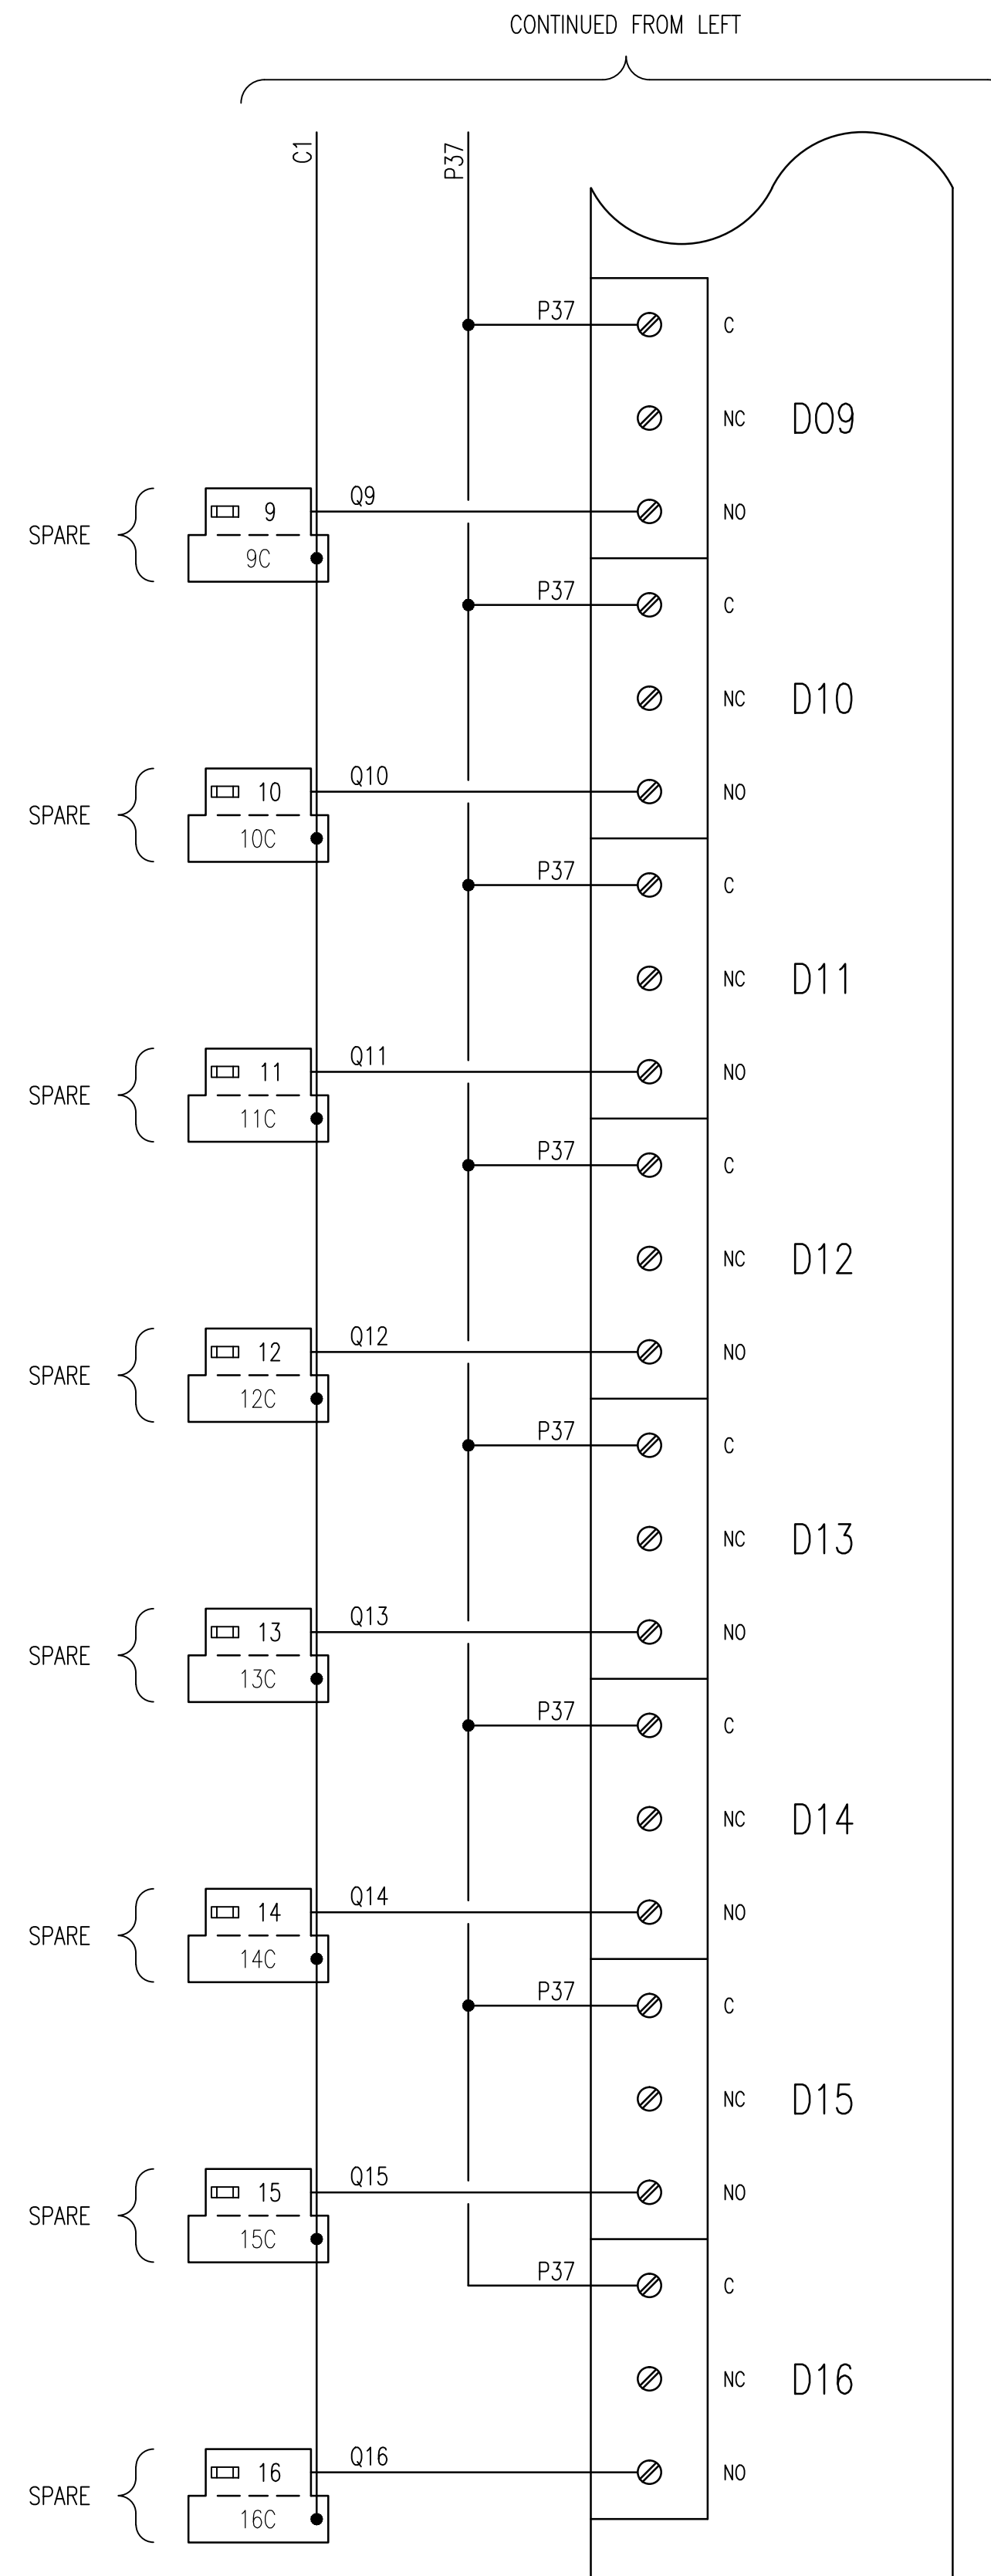

NO.	REVISIONS	DATE	DESIGN	CHECK
01	REVISED SCADAPACK ES PART NUMBER	2012/03/05	BC	CJR
00	ISSUED FOR TENDER, BID OPP. 907-2011	2011/11/04	BC	CJR

**SNC-LAVALIN INC.**  
 148 Nature Park Way  
 Winnipeg, MB, Canada R3P 0X7  
 204-786-8080

DESIGNED BY: B. CLEVEN  
 CHECKED BY: C. REIMER  
 DRAWN BY: S. FUNK  
 APPROVED BY: C. REIMER  
 SCALE: NTS  
 RELEASED FOR CONSTRUCTION BY: K. R. ZUREK  
 DATE: 2011/08/31  
 DATE: 2012/02/23  
 CONSULTANT NO.: 508042-0000-48DD-0004

ENGINEER'S SEAL  
 ORIGINAL DRAWING  
 SEALED BY:  
 C. J. REIMER  
 SNC-LAVALIN  
 MEMBER #21968  
 2012/02/23  
 REV. 00

**THE CITY OF WINNIPEG**  
 WATER AND WASTE DEPARTMENT

MONTCALM WASTEWATER PUMPING STATION  
 2011 UPGRADES  
 RTU I/O WIRING DIAGRAM  
 CONTROL PANEL CP-L1  
 DISCRETE OUTPUTS

CITY DRAWING NUMBER: 1-0164L-A0004  
 SHEET: 001  
 REV: 01  
 SIZE: A1