



NOTES:

1. CONTRACTOR TO COORDINATE CABLE TRAY WITH THE STRUCTURAL OPENING IN THE LEVEL 200 AND 300 FLOOR. REFER TO STRUCTURAL DRAWING S03 FOR ADDITIONAL DETAILS.
2. REFER TO STRUCTURAL DRAWING S03 FOR DETAILS ON THE GRIP MESH HOOKING SYSTEM.
3. PROVIDE STANDARD DUTY CLOSED MESH, DOUBLE EYE GRIP MESH TO SUPPORT THE POWER AND CONTROL CABLES. GRIP MESH SHALL CONNECT TO THE STRUCTURAL HOOKING SYSTEM.
4. PROVIDE A 6" OFFSET FOR THE VERTICAL PORTION OF THE CABLE TRAY. OFFSET TO BE COORDINATED ON SITE WITH THE LIFTING SYSTEM TO ENSURE NO CLASHING.
5. ALL FIELD WIRING SHALL BE WITHIN CONDUIT UNLESS STATED OTHERWISE. CONTRACTOR IS RESPONSIBLE FOR PATCHING AND/OR FIRE STOPPING ALL FLOOR/WALL PENETRATIONS AS A RESULT OF THE NEW WORK. CONTRACTOR TO ALLOW FOR SCANNING THE CONCRETE PRIOR TO ANY CONDUIT PENETRATIONS TO ENSURE REBAR AND EMBEDDED SERVICES ARE MISSED.



1


LEVEL 200 PLAN

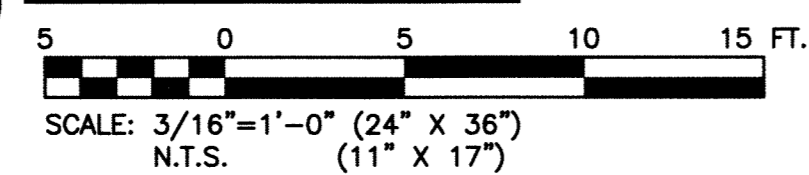

A

SECTION DETAIL

N.T.S.

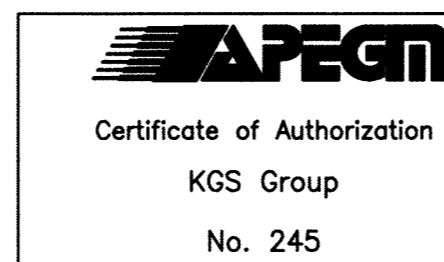

FIELD BOOK #:	
POSTED TO L.B.I.S.	
NO.	REVISIONS
0	ISSUED FOR TENDER 2011-11-07
	DATE

KGS GROUP CONSULTING ENGINEERS	
DESIGNED BY DDW	CHECKED BY JLL
DRAWN BY GCN	APPROVED BY RED
HOR. SCALE N.T.S.	RELEASED FOR CONSTRUCTION
VERTICAL N.T.S.	
DATE 2011 09 19	DATE

ENGINEER'S SEAL

NOV 7 2011

E05

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

REPLACEMENT OF RAW SEWAGE PUMP P-3
PERIMETER ROAD PUMPING STATION
ELECTRICAL
LEVEL 200 PLAN

SHEET 1 OF 1
CITY DRAWING NUMBER