



NOTES:

1. ALARM CONTACT OPENS ON FALLING PRESSURE.
2. ALARM CONTACT OPENS ON RISING PRESSURE.
3. EXISTING CABLES TO BE DISCONNECTED FROM THE EXISTING MCC AND SHALL BE RECONNECTED TO THE NEW MCC.

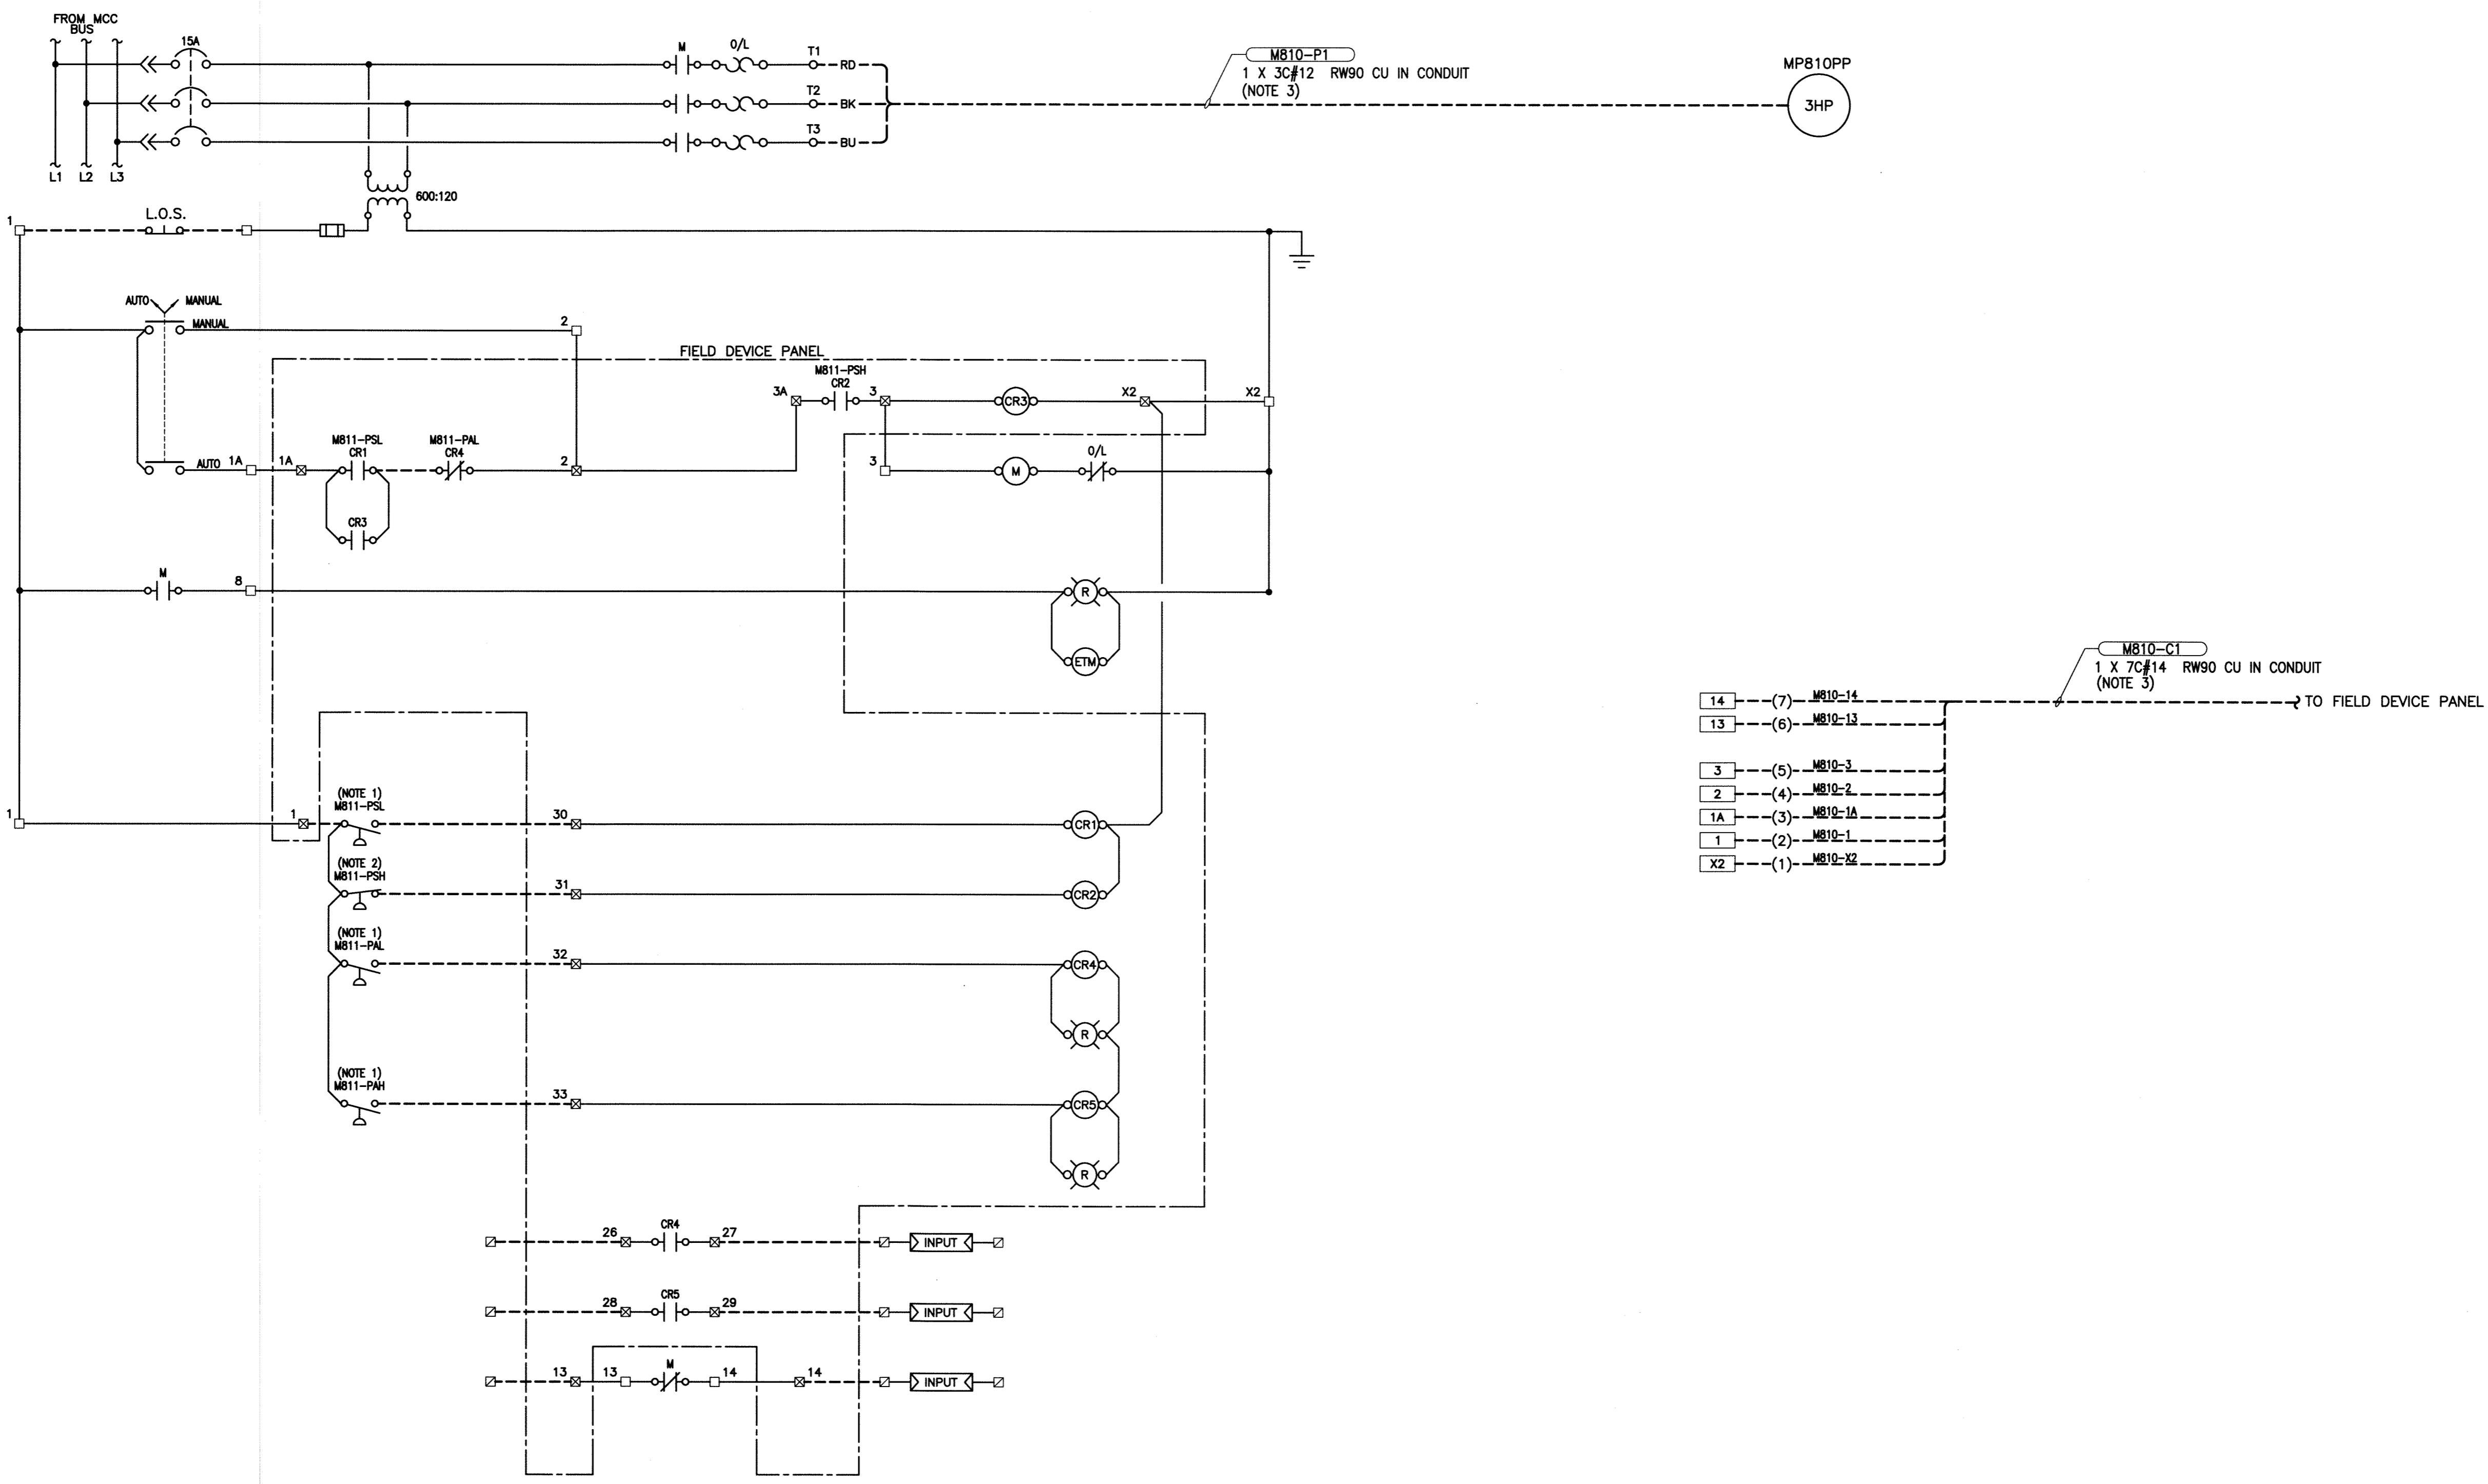

LEGEND

- MCC TERMINALS
- STATION DISCHARGE VALVE CONTROL PANEL TERMINALS
- ▣ DCS TERMINALS
- ⊠ REGUTRON MCC DISCONNECT TERMINALS
- ⊞ REGUTRON TERMINALS
- ⊟ M200PP DISCHARGE VALVE CONTROL PANEL TERMINALS
- FIELD WIRING
- PANEL WIRING
- () CONDUCTOR IDENTIFICATION
- WIRE CONNECTION
- ⊙ PILOT LIGHT
- ⊞ OUTPUT PLC OUTPUT
- ⊟ INPUT PLC INPUT

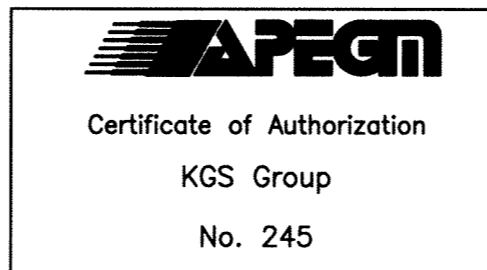

FIELD BOOK #:				ENGINEER'S SEAL	
POSTED TO L/BIS					
DESIGNED BY	DDW	CHECKED BY	JLL	E36	
DRAWN BY	GCN	APPROVED BY	RED		
HDR. SCALE	N.T.S.	RELEASED FOR CONSTRUCTION			
NO. REVISIONS	0	ISSUED FOR TENDER	2011-11-07	DATE	2011 07 13

THE CITY OF WINNIPEG
 WATER AND WASTE DEPARTMENT
 REPLACEMENT OF RAW SEWAGE PUMP P-3
 PERIMETER ROAD PUMPING STATION
ELECTRICAL
 PUMP M810PP FLUSH WATER
 SCHEMATIC & WIRING DIAGRAM

SHEET 1 OF 1
CITY DRAWING NUMBER