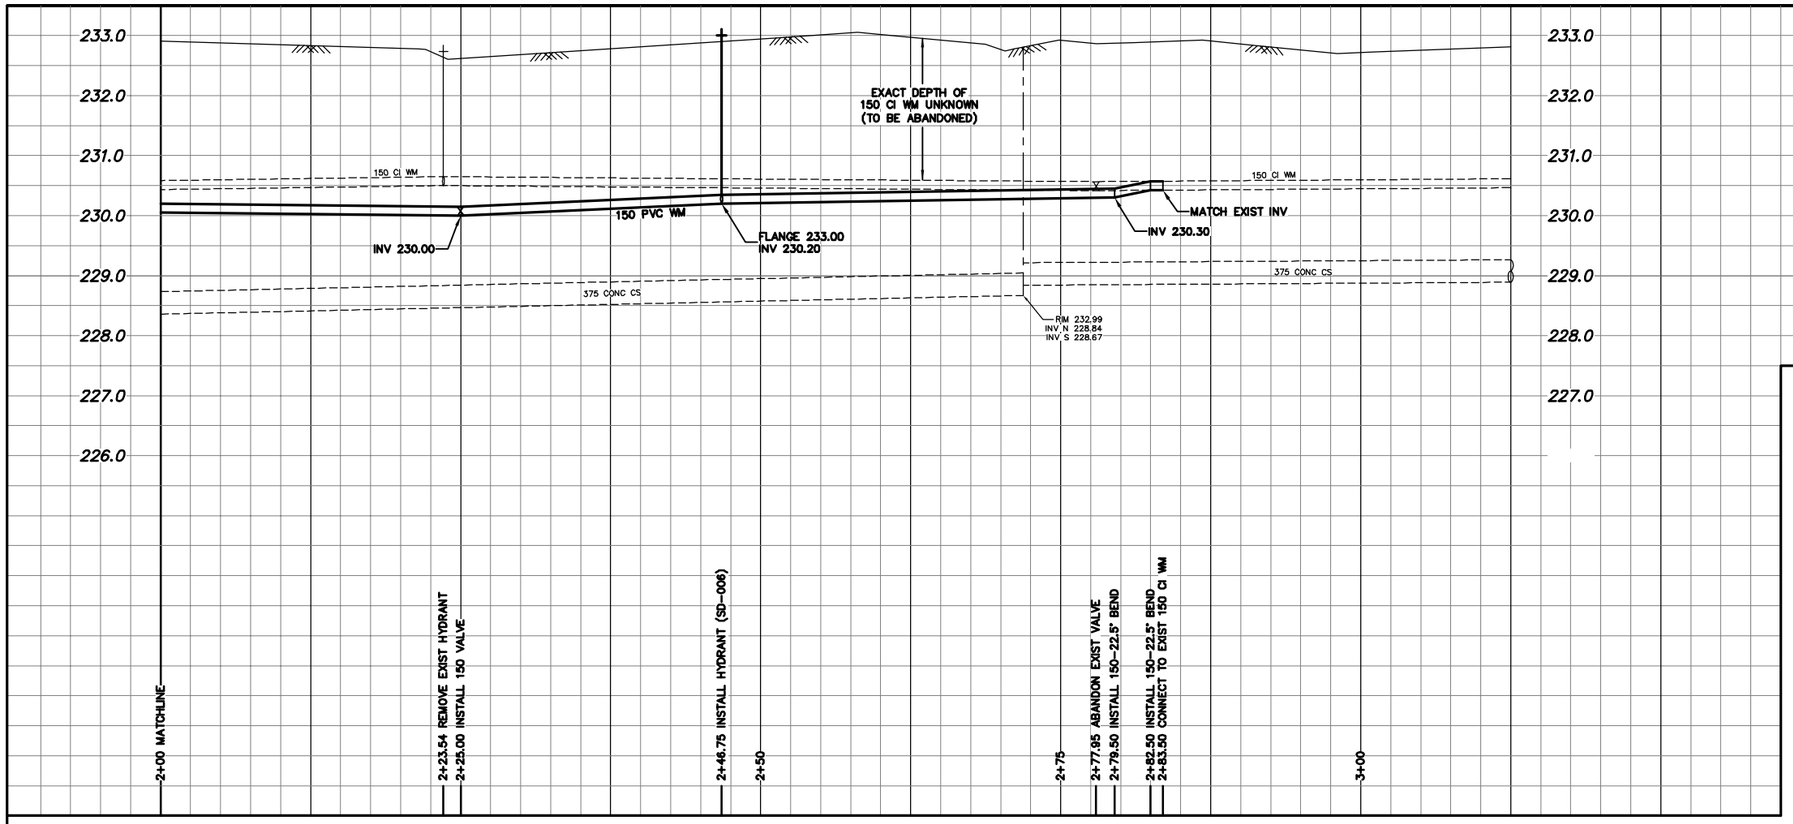

NOTE: CHAINAGES SHOWN ARE ALONG E. ℄ OF OAK ST.

WATER SERVICE INFORMATION

ADDRESS	SIZE (mm) MATERIAL (STREET)	SIZE (mm) MATERIAL (PROP.)	SHORT & LONG MEASUREMENT	CORP. LOCATION	REMARKS
336 OAK ST RESIDENTIAL	20 COPPER	12 LEAD	1.22 SSL HSE 195.98 NNL GROSVENOR	OPP S/C	–
339 OAK ST RESIDENTIAL	12 COPPER	20 COPPER	0.76 NSL HSE 185.58 NNL GROSVENOR	OPP S/C	–
340 OAK ST RESIDENTIAL	20 COPPER	12 COPPER	2.14 NNL HSE 195.48 NNL GROSVENOR	0.6 S OF S/C	–
343 OAK ST RESIDENTIAL	20 COPPER	20 COPPER	1.30 NSL HSE 174.46 NNL GROSVENOR	OPP S/C	–
344 OAK ST RESIDENTIAL	20 COPPER	12 LEAD	2.36 SSL HSE 172.25 NNL GROSVENOR	OPP S/C	–
347 OAK ST RESIDENTIAL	20 COPPER	20 COPPER	0.43 NSL HSE 161.55 NNL GROSVENOR	0.6 N OF S/C	–
348 OAK ST RESIDENTIAL	12 COPPER	12 COPPER	1.30 NSL HSE 161.79 NNL GROSVENOR	OPP S/C	–
351 OAK ST RESIDENTIAL	12 COPPER	20 COPPER	0.52 NSL HSE 148.81 NNL GROSVENOR	0.8 N OF S/C	–
352 OAK ST RESIDENTIAL	20 COPPER	12 LEAD	1.19 NSL HSE 150.84 NNL GROSVENOR	OPP S/C	–
355 OAK ST RESIDENTIAL	20 COPPER	20 COPPER	1.46 NSL HSE 138.74 NNL GROSVENOR	OPP S/C	–
* 356 OAK ST RESIDENTIAL	12 LEAD	20 COPPER	OPP NL HSE 145.85 NNL GROSVENOR	0.3 N OF S/C	RENEW TO ℄ W/ 20 COPPER –
* 359 OAK ST RESIDENTIAL	12 LEAD	20 COPPER	3.44 NSL HSE 127.92 NNL GROSVENOR	0.1 N OF S/C	RENEW TO ℄ W/ 20 COPPER –
* 360 OAK ST RESIDENTIAL	12 LEAD	20 COPPER	3.55 NSL HSE 127.31 NNL GROSVENOR	OPP S/C	RENEW TO ℄ W/ 20 COPPER –
* 362 OAK ST RESIDENTIAL	12 LEAD	12 LEAD	0.55 NSL HSE 112.89 NNL GROSVENOR	0.2 S OF S/C	RENEW TO ℄ W/ 20 COPPER –
* 363 OAK ST RESIDENTIAL	12 LEAD	12 LEAD	1.05 NSL HSE 112.55 NNL GROSVENOR	0.5 N OF S/C	RENEW TO ℄ W/ 20 COPPER –
367 OAK ST RESIDENTIAL	20 COPPER	20 COPPER	0.49 NSL HSE 99.72 NNL GROSVENOR	OPP S/C	–
* 368 OAK ST RESIDENTIAL	12 COPPER	12 LEAD	3.08 NSL HSE 102.18 NNL GROSVENOR	OPP S/C	RENEW TO ℄ W/ 20 COPPER –

*SERVICES TO BE RENEWED TO ℄. ALL OTHERS TO BE RECONNECTED

CAUTION:
GAS, SL & CS ON
W SIDE OF OAK ST

OAK STREET

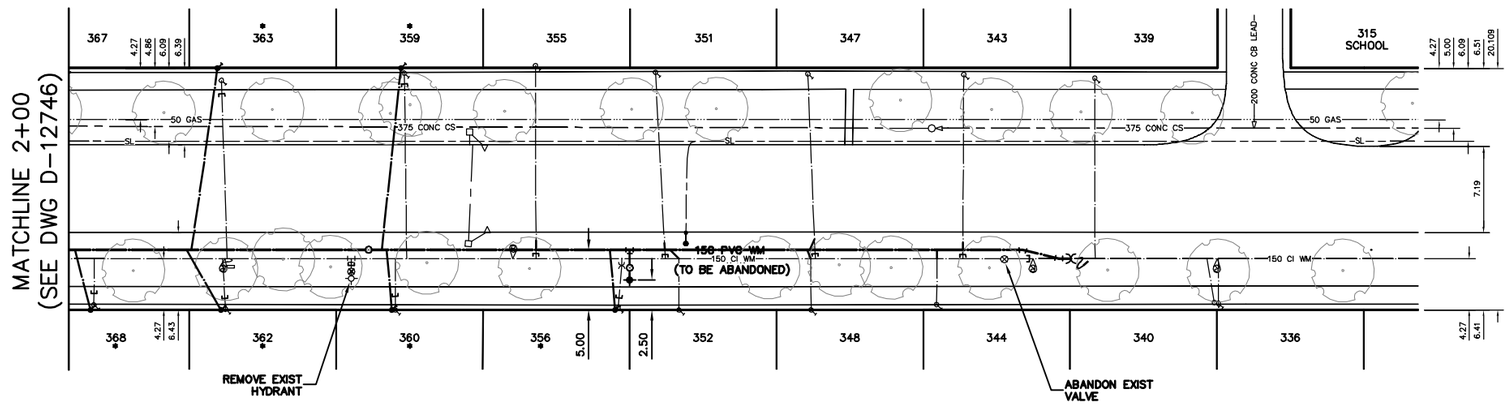

VALVES TO BE COUNTER-CLOCKWISE TO CLOSE (RED OPERATING NUT)

METRIC
WHOLE NUMBERS INDICATE MILLIMETRES
DECIMALIZED NUMBERS INDICATE METRES

0.0 5.0 10.0 15.0 20.0 25.0

WARNING

IF POWER EQUIPMENT OR EXPLOSIVES ARE TO BE USED FOR EXCAVATION ON THIS PROJECT THE CONTRACTOR MUST:

1) NOTIFY THE GAS COMPANY OF THE PROPOSED LOCATION OF EXCAVATION.

2) TAKE PRECAUTION TO AVOID DAMAGE TO GAS COMPANY INSTALLATIONS.

SEE PROVINCIAL REGULATION 210/72 FOR DETAILS

LOCATION APPROVED
UNDERGROUND STRUCTURES

SUPV. U/G STRUCTURES COMMITTEE _____ DATE _____

NOTE:
LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.

B.M.
ELEV.

COSTRUCTION COMPLETION DATE: YYYY MM DD

NO.	REVISIONS	DATE	BY

DESIGNED BY	SC	CHECKED BY	SC
DRAWN BY	CJH	APPROVED BY	KZ
SCALE: HORIZONTAL	1:250	RELEASED FOR CONSTRUCTION	KAS ZUREK
VERTICAL	1:50	DATE	MARCH 28, 2012
DATE	2012 03 28		
PLOT DATE:	2012 03 29		

ENGINEER'S SEAL
ORIGINAL SIGNED BY S.R.J. COURNOYER 12-03-28

CONSULTANT DRAWING NUMBER
–

BID OPPORTUNITY: 271-2012
CONTRACT NUMBER: 2

Winnipeg

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT
ENGINEERING DIVISION

2012 WATERMAIN RENEWALS

OAK STREET
100 N OF GROSVENOR AVENUE TO
200 N OF GROSVENOR AVENUE

SHEET 10 OF 11

CITY DRAWING NUMBER
D-12747

FILE PATH: R:\DRAWINGS\WATER\RENEWAL\2012_RENEWALS\CONTRACT 2\
FILE NAME: D-12747.dwg